

# Water Quality

# 5

*Wastewater generated from operations at Brookhaven National Laboratory is treated at the Sewage Treatment Plant (STP) before it is discharged to nearby groundwater recharge basins. Some wastewater may contain very low levels of radiological, organic, or inorganic contaminants. Monitoring, pollution prevention, and vigilant operation of treatment facilities ensure that these discharges comply with all applicable regulatory requirements and that the public, employees, and the environment are protected.*

*Analytical data for 2016 show that the average gross alpha and beta activity levels in the STP discharge (EA, Outfall 001) were within the typical range of historical levels and were well below New York State Drinking Water Standards (NYS DWS). Tritium was not detected above method detection limits in the STP discharge during the entire year and no cesium-137, strontium-90, or other gamma-emitting nuclides attributable to Laboratory operations were detected. Non-radiological monitoring of the STP effluent showed that organic and inorganic parameters were within State Pollutant Discharge Elimination System (SPDES) effluent limitations or other applicable standards.*

*The average concentrations of gross alpha and beta activity in stormwater and cooling water discharged to recharge basins were within typical ranges and no gamma-emitting radionuclides were detected. Disinfection byproducts continue to be detected at low concentrations, above the method detection limit, in discharges to recharge basins due to the use of chlorine and bromine for the control of algae and bacteria in potable and cooling water systems. Inorganics (i.e., metals) were detected; however, their presence is due primarily to sediment runoff in stormwater discharges.*

*With the exception of the most upstream sampling location, the on-site portions of the Peconic River were dry throughout 2016 due to drought conditions. Radiological data from Peconic River surface water sampling show that the average concentrations of gross alpha and gross beta activity from on-site locations were indistinguishable from off-site locations and control locations, and all detected levels were below the applicable NYS DWS. No gamma-emitting radionuclides attributable to Laboratory operations were detected either upstream or downstream of the STP area, and tritium was not detected above method detection limits in any of the surface water samples.*

## 5.1 SURFACE WATER MONITORING PROGRAM

In addition to monitoring discharges to surface waters under the SPDES program described in Chapter 3, BNL routinely monitors surface water quality (including radionuclides) as part of the site Surveillance Program. Although discharges of treated wastewater from the Laboratory's STP into the headwaters of the Peconic River ceased in October 2014, the

Laboratory continues to monitor surface water at several locations along the Peconic River to assess the impact that site operations may have on surface water quality. On-site monitoring station HY is located upstream of all Laboratory operations, and provides information on the background water quality of the Peconic River (see Figure 5-4). The Carmans River is monitored as a geographic control location for

comparative purposes, as it is not affected by operations at BNL and is not within the Peconic River watershed.

On the Laboratory site, the Peconic River is an intermittent, groundwater fed stream. Off-site flow occurs only following periods of sustained precipitation and a concurrent rise in the water table, typically in the spring. There was no off-site flow in 2016. The on-site portions of the Peconic River remained dry throughout the year due to drought conditions.

Five years of analytical data associated with BNL's surface water monitoring program were evaluated in 2012, and a determination was made to reduce the sampling frequencies for both on- and off-site Peconic River monitoring stations starting in 2013. This decision was based on the fact that historical monitoring data indicates no significant variations in water quality throughout the Peconic River system and pollution prevention efforts at the Laboratory have significantly reduced the risk of accidental releases. This decision is further supported by the October 2014 redirection of STP discharges away from the Peconic River. The following sections describe BNL's surface water monitoring and surveillance program.

## 5.2 SANITARY SYSTEM EFFLUENTS

The STP effluent (Outfall 001) is a discharge point authorized under BNL's SPDES permit that is issued by NYSDEC (Section 3.6.1). Figure 5-1 shows a schematic for discharge of treated STP effluent to nearby groundwater recharge basins. The Laboratory's STP treatment process includes three principal steps: 1) aerobic oxidation for secondary removal of biological matter and nitrification of ammonia, 2) secondary clarification, and 3) filtration for final solids removal. Tertiary treatment for nitrogen removal is also provided by controlling the oxygen levels in the aeration tanks. During the aeration process, the oxygen levels are allowed to drop to the point where microorganisms use nitrate-bound oxygen for respiration; this liberates nitrogen gas and consequently reduces the concentration of nitrogen in the STP discharge.

Real-time monitoring of the sanitary waste stream for radioactivity, pH, and conductivity


occurs at two locations. The first site, MH-192, is approximately 1.1 miles upstream of the STP, and provides a minimum of 30 minutes' warning to the STP operators that wastewater is en-route that may exceed SPDES limits or BNL administrative effluent release criteria. The second monitoring site is at the point where the STP influent enters the treatment process.

Based on the data collected by the real-time monitoring systems, any influent to the STP that may not meet SPDES limits and BNL effluent release criteria can be diverted to two double-lined holding ponds. The total combined capacity of the two holding ponds exceeds 6 million gallons, or approximately 18 days of flow. Diversion would continue until the effluent's water quality meets the permit limits and release criteria. If wastewater is diverted to the holding ponds, it is tested and evaluated against the requirements for release. If necessary, the wastewater is treated and then reintroduced into the STP at a rate that ensures compliance with SPDES permit limits for non-radiological parameters or BNL effluent release criteria for radiological parameters. In 2016, there were no instances that required diversion of wastewater to the hold-up ponds.

Solids separated in the clarifier are pumped to aerobic digesters for continued biological solids reduction and sludge thickening. Once the sludge in the aerobic digester reaches a solids content of 6 percent, the sludge is sampled to ensure it meets the waste acceptance criteria for disposal at the Suffolk County Department of Public Works Sewage Treatment Facility at Bergen Point, in West Babylon, New York.

### 5.2.1 Sanitary System Effluent–Radiological Analyses

Wastewater at the STP is sampled at the inlet to the treatment process, Station DA, and at the STP outfall, Station EA, as shown on Figure 5-1. At each location, samples are collected on a flow-proportional basis; that is, for every 1,000 gallons of water treated, approximately four fluid ounces of sample are collected and composited into a 5-gallon collection container. These samples are analyzed weekly for gross alpha and gross beta activity and for tritium. Samples collected from

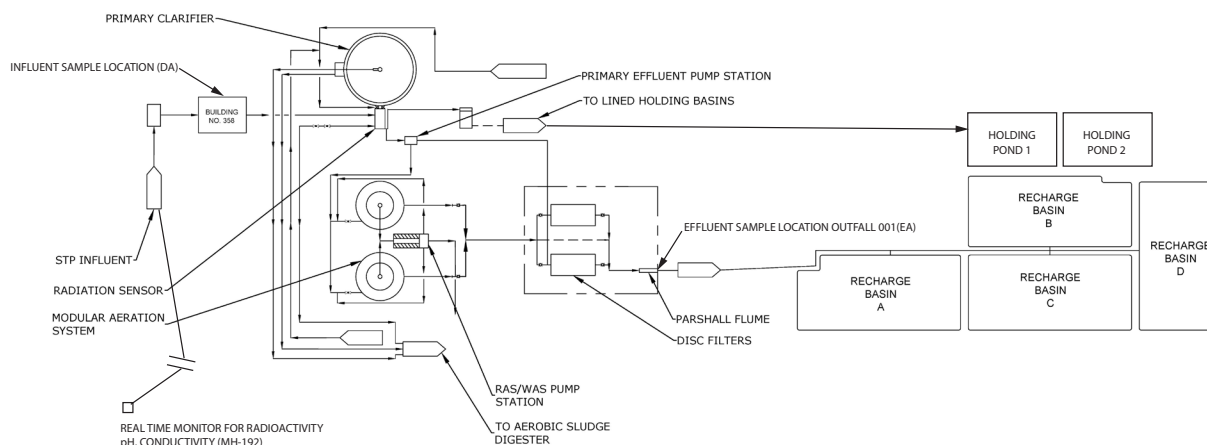

**Figure 5-1. Schematic of BNL's Sewage Treatment Plant (Recharge Basin Discharge)**

these locations are also composited and analyzed monthly for gamma-emitting radionuclides and strontium-90 (Sr-90: half-life, 29 years).

Although the STP discharge is not used as a direct source of potable water, the Laboratory applies the stringent Safe Drinking Water Act (SDWA) standards for comparison purposes when monitoring the effluent, in lieu of DOE wastewater criteria. Under the SDWA, water standards are based on a 4 mrem (40  $\mu$ Sv) dose limit. The SDWA specifies that no individual may receive an annual dose greater than 4 mrem from radionuclides that are beta or photon emitters, which includes up to 168 individual radioisotopes. BNL performs radionuclide-specific gamma analysis to ensure compliance with this standard. The SDWA annual average gross alpha activity limit is 15 pCi/L, including radium-226 (Ra-226: half-life, 1,600 years), but excluding radon and uranium. Other SDWA-specified drinking water limits are 20,000 pCi/L for tritium (H-3: half-life, 12.3 years), 8 pCi/L for Sr-90, 5 pCi/L for Ra-226 and radium-228 (Ra-228: half-life, 5.75 years), and 30  $\mu$ g/L for uranium. Gross alpha and beta activity measurements are used as a screening tool for detecting the presence of radioactivity.

Table 5-1 shows the monthly gross alpha and beta activity data and tritium concentrations for the STP influent and effluent during 2016.

Annual average gross alpha and beta activity levels in the STP effluent were  $0.6 \pm 0.3$  pCi/L and  $5.7 \pm 0.4$  pCi/L, respectively. These average concentrations are higher than control location data (Carman's River Station HH) reported in Table 5-5; however, they are well below the SDWA standards that are used for comparison purposes. Tritium was not detected above minimum detection limits in the discharge of the STP (EA, Outfall 001) for the entire year. The annual average tritium concentration, as measured in the STP effluent, was below background and well below the NYS DWS of 20,000 pCi/L. In 2016, there were no gamma-emitting nuclides detected in the STP effluent, which is consistent with data reported since 2003. Sr-90 was detected in one effluent sample collected in September ( $0.31 \pm 0.21$  pCi/L); however, this value is consistent with historical levels and most likely attributable to worldwide fallout and not BNL-derived.

### 5.2.2 Sanitary System Effluent – Nonradiological Analyses

Starting in 2013, monitoring of the STP effluent for volatile organic compounds (VOCs), inorganics, and anions as part of the Surveillance Program was discontinued. These parameters are now only monitored as part of the SPDES Compliance Program, which is discussed in further detail in Chapter 3.

Table 5-1. Tritium and Gross Activity in Water at the BNL Sewage Treatment Plant (STP).

		Flow (Liters)	Tritium (pCi/L)		Gross Alpha (pCi/L)		Gross Beta (pCi/L)	
			max.	avg.	max.	avg.	max.	avg.
January	influent	2.58E+07	< 344	< MDL	< 3.8	0.7 ± 1.6	5.6 ± 2.4	3.9 ± 1.3
	effluent	2.02E+07	< 342	< MDL	< 1.8	0.0 ± 0.4	5.3 ± 1.6	4.1 ± 1.3
February	influent	3.02E+07	< 483	< MDL	< 2.9	1.2 ± 0.6	6.7 ± 1.5	4.5 ± 1.6
	effluent	2.36E+07	< 338	< MDL	3.0 ± 2.1	0.6 ± 1.2	6.5 ± 1.3	5.4 ± 0.8
March	influent	2.76E+07	< 330	< MDL	< 4.3	1.6 ± 1.7	7.0 ± 1.6	5.8 ± 1.3
	effluent	1.83E+07	< 338	< MDL	2.4 ± 1.4	1.1 ± 1.1	7.4 ± 1.5	6.2 ± 0.8
April	influent	2.82E+07	< 330	< MDL	< 3.0	0.8 ± 1.1	6.0 ± 1.4	5.4 ± 0.5
	effluent	1.97E+07	< 322	< MDL	< 4.2	0.6 ± 0.8	7.4 ± 1.4	6.6 ± 0.7
May	influent	3.68E+07	< 363	< MDL	4.8 ± 2.9	2.1 ± 1.7	5.3 ± 1.8	4.2 ± 0.6
	effluent	3.30E+07	< 356	< MDL	< 1.7	-0.1 ± 0.6	5.2 ± 1.2	4.4 ± 0.4
June	influent	2.93E+07	< 366	< MDL	5.4 ± 3.2	2.1 ± 2.2	5.3 ± 2.0	4.3 ± 0.8
	effluent	2.20E+07	< 370	< MDL	< 2.4	0.1 ± 0.8	8.7 ± 1.4	7.0 ± 1.2
July	influent	3.29E+07	< 286	< MDL	< 8.4	3.1 ± 3.7	4.0 ± 0.8	3.2 ± 0.5
	effluent	2.88E+07	< 277	< MDL	< 1.7	0.5 ± 0.6	5.7 ± 1.0	4.9 ± 1.0
August	influent	4.49E+07	< 293	< MDL	< 3.5	1.1 ± 0.5	5.6 ± 1.2	3.7 ± 1.1
	effluent	3.53E+07	< 304	< MDL	< 2.0	0.6 ± 0.4	8.4 ± 1.4	6.2 ± 1.4
September	influent	3.29E+07	< 326	< MDL	< 4.1	2.5 ± 0.6	9.2 ± 1.9	8.0 ± 1.3
	effluent	2.58E+07	< 319	< MDL	3.7 ± 2.1	1.7 ± 1.6	11.3 ± 2.3	6.0 ± 3.6
October	influent	3.35E+07	< 292	< MDL	< 3.4	0.0 ± 1.0	7.1 ± 1.4	5.3 ± 1.3
	effluent	2.61E+07	< 283	< MDL	< 4.3	0.9 ± 0.7	6.8 ± 1.2	5.6 ± 0.8
November	influent	2.44E+07	< 283	< MDL	< 9.1	1.1 ± 2.7	10.8 ± 2.6	7.5 ± 2.5
	effluent	1.92E+07	< 369	< MDL	< 4.2	0.4 ± 1.2	7.7 ± 1.7	6.8 ± 0.8
December	influent	2.38E+07	< 363	< MDL	< 14.2	1.4 ± 2.3	12.1 ± 5.3	7.8 ± 3.2
	effluent	1.93E+07	< 356	< MDL	< 4.5	0.3 ± 2.1	7.4 ± 1.8	6.0 ± 0.9
Annual Avg.	influent			< MDL		1.5 ± 0.5		5.2 ± 0.6
	effluent			< MDL		0.6 ± 0.3		5.7 ± 0.4
Total Release		2.91E+08		13.4 mCi (a)		0.2 mCi		1.7 mCi
Average MDL (pCi/L)				362		2.6		1.3
SDWA Limit (pCi/L)				20,000		15		(b)

## Notes:

All values are reported with a 95% confidence interval.

To convert values from pCi to Bq, divide by 27.03.

MDL = minimum detection limit

SDWA = Safe Drinking Water Act

(a) The total released value for tritium is a conservative calculation that is based on an average of the 95% confidence interval maximums as estimates of monthly average release concentrations. The majority of the effluent samples showed average concentrations less than zero and all results were less than the MDL.

(b) The drinking water standards were changed from 50 pCi/L (concentration based) to 4 mrem/yr (dose based) in 2003. As gross beta activity activity does not identify specific radionuclides, a dose equivalent cannot be calculated for the values in the table.

**5.3 PROCESS-SPECIFIC WASTEWATER**

Wastewater that may contain constituents above SPDES permit limits or ambient water quality discharge standards must be held by the generating facility and characterized to determine the appropriate means of disposal. The analytical results are compared with the

appropriate discharge limit, and the wastewater is released to the sanitary system if the volume and concentration of contaminants in the discharge would not jeopardize the quality of the STP effluent and, subsequently, potentially impact groundwater quality (BNL 2014).

The Laboratory's SPDES permit includes

requirements for quarterly sampling and analysis of process-specific wastewater discharged from metal cleaning operations in Building 498 and cooling tower discharges from Building 902. Although still listed as a discharge monitoring location, discharges from the printed-circuit-board fabrication operations that had been conducted in Building 535B have been discontinued. These operations are monitored for contaminants such as metals, cyanide, VOCs, and semi-volatile organic compounds (SVOCs). In 2016, analyses of these waste streams showed that, although several operations contributed contaminants (principally metals) to the STP influent in concentrations exceeding SPDES-permitted levels, these discharges did not affect the quality of the STP effluent.

Process wastewaters that were not expected to be of consistent quality, because they were not routinely generated, were held for characterization before release to the sanitary system. The process wastewaters typically included purge water from groundwater sampling, wastewater from cleaning of heat exchangers, wastewater generated as a result of restoration activities, and other industrial wastewaters. To determine the appropriate disposal method, samples were analyzed for contaminants specific to the process. The analyses were then reviewed and the concentrations were compared to the SPDES effluent limits and BNL's effluent release criteria (BNL 2014). If the concentrations were within limits, authorization for sewer system discharge was granted; if not, alternate means of disposal were used. Any waste that contained elevated levels of hazardous or radiological contaminants in concentrations that exceeded Laboratory effluent release criteria was sent to the BNL Waste Management Facility for proper management and off-site disposal.

#### 5.4 RECHARGE BASINS

Recharge basins are used for the discharge of "clean" wastewater, including once-through cooling water, stormwater runoff, and cooling tower blowdown. These wastewaters are suitable for direct replenishment of the groundwater aquifer. Figure 5-2 shows the locations of the Laboratory's discharges to recharge basins

(also called "outfalls" under BNL's SPDES permit). Figure 5-3 presents an overall schematic of potable water use at the Laboratory, and how much of this water is discharged to the 11 on-site recharge basins:

- Basins HN, HT-W, and HT-E receive once-through cooling water discharges generated at the Alternating Gradient Synchrotron (AGS) and Relativistic Heavy Ion Collider (RHIC), as well as cooling tower blowdown and stormwater runoff.
- Basin HS receives predominantly stormwater runoff, once-through cooling water from Building 555 (Chemistry Department) and minimal cooling tower blowdown from the National Synchrotron Light Source (NSLS).
- Basin HX receives Water Treatment Plant filter backwash water.
- Basin HO receives cooling water discharges from the AGS and stormwater runoff from the area surrounding the High Flux Beam Reactor (HFBR).
- Several other recharge areas are used exclusively for discharging stormwater runoff. These areas include Basin HW near the National Synchrotron Light Source II (NSLS-II) site, Basin CSF at the Central Steam Facility (CSF), Basin HW-M at the former Hazardous Waste Management Facility (FHWMF), and Basin HZ near Building 902. Recharge Basins HP and RAV are used for discharge of treated water from the groundwater remediation systems and are monitored under BNL's Comprehensive Environmental Response, Compensation and Liability Act (CERCLA) equivalency permits.

Each of the recharge basins is a permitted point-source discharge under the Laboratory's SPDES permit. Where required by the permit, the basins are equipped with a flow monitoring station; allowing for weekly recordings of flow rates. The specifics of the SPDES compliance monitoring program are provided in Chapter 3. To supplement the monitoring program, samples are also routinely collected and analyzed under BNL's Environmental Surveillance Program for radioactivity, VOCs, metals, and anions. During 2016, water samples were collected from all the basins listed above semi-annually except



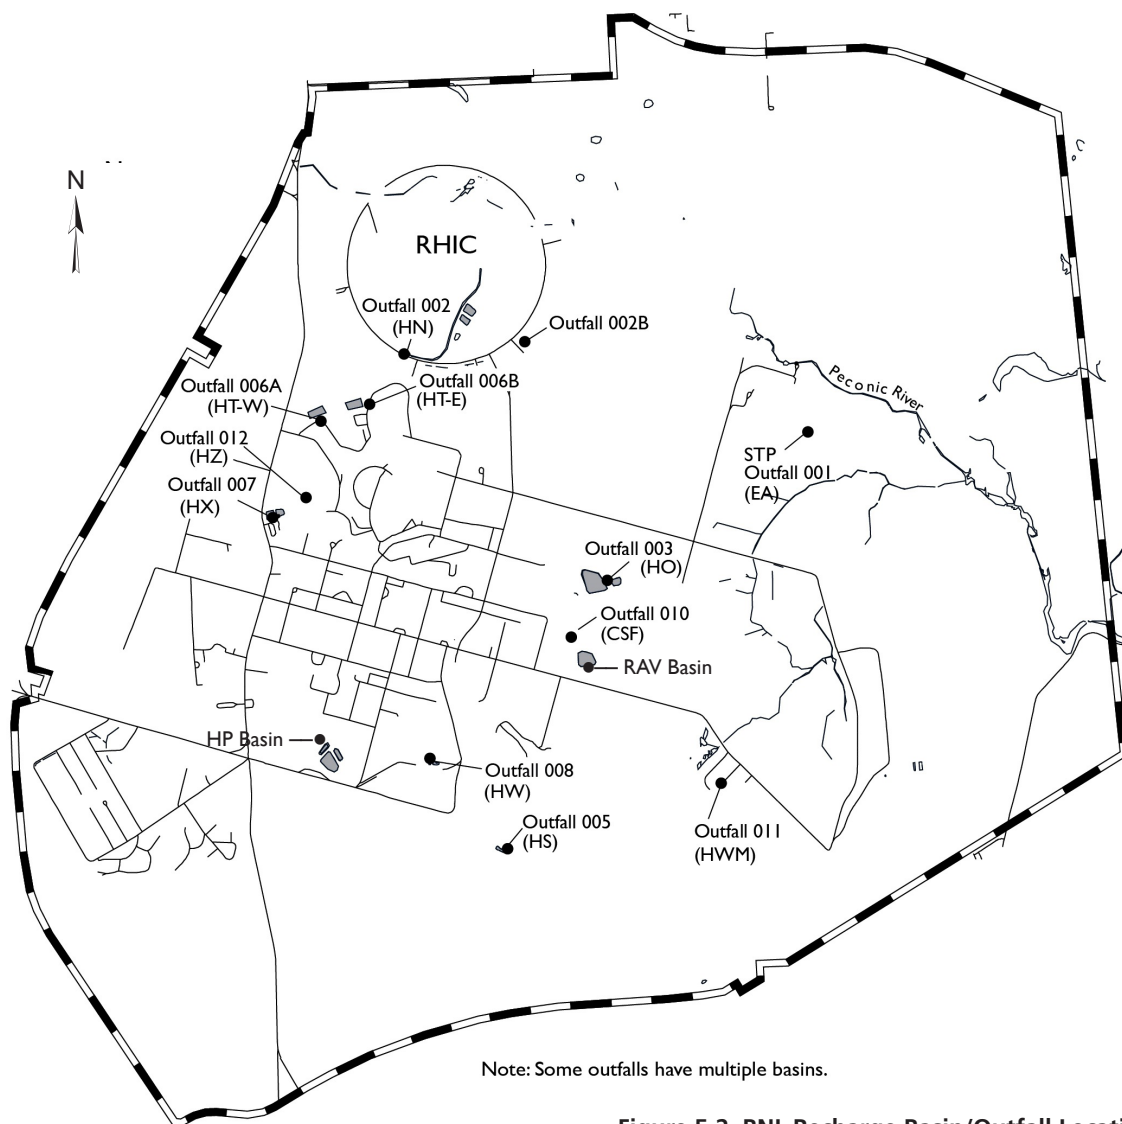


Figure 5-2. BNL Recharge Basin/Outfall Locations.

for recharge Basin HX at the Water Treatment Plant (due to previously documented non-impact to groundwater from plant operations) and recharge basin at the FHWMF (there are no longer any operations at the FHWMF that could lead to the contamination of runoff).

#### 5.4.1 Recharge Basins – Radiological Analyses

Discharges to the recharge basins were sampled semi-annually and analyzed for gross alpha and beta activity, gamma-emitting radionuclides, and tritium. The results are presented in Table 5-2. Gross alpha activity ranged from

non-detect to  $3.98 \pm 2.21$  pCi/L and gross beta activity ranged from non-detectable to  $6.07 \pm 1.41$  pCi/L. Low-level detections of beta activity are attributable to very low levels of naturally occurring radionuclides, such as potassium-40 (K-40: half-life,  $1.3E+09$  years). No gamma-emitting nuclides attributable to BNL operations were detected in any discharges to recharge basins in 2016. Tritium was also not detected at any of the basins in 2016.

#### 5.4.2 Recharge Basins – Nonradiological Analyses

During 2016, discharge samples were

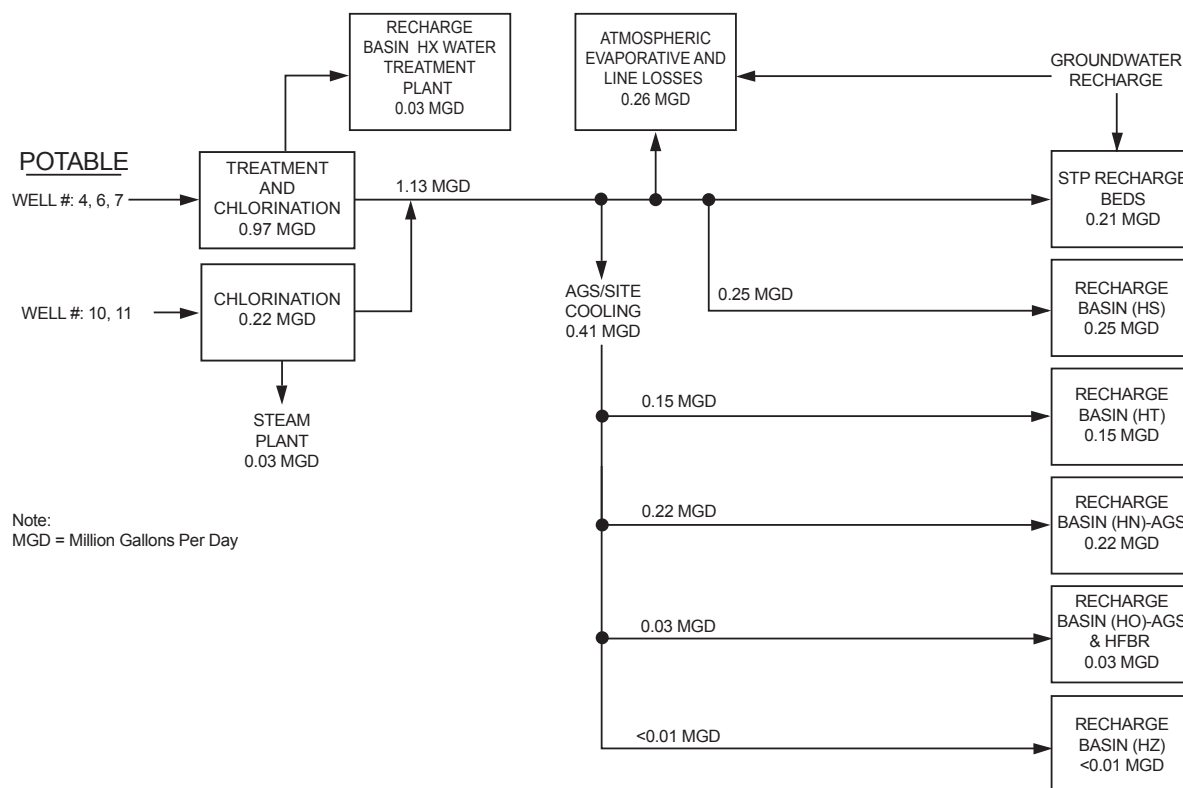


Figure 5-3. Schematic of Potable Water Use and Flow at BNL.

collected semi-annually for water quality parameters, metals, and VOCs. Field-measured parameters (pH, conductivity, and temperature) were routinely monitored and recorded. The water quality and metals analytical results are summarized in Tables 5-3 and 5-4. To determine the overall impact on the environment from discharges to the recharge basins, the nonradiological analytical results were compared to groundwater discharge standards promulgated under Title 6 of the New York Codes, Rules, and Regulations (NYCRR), Part 703.6.

Low concentrations of disinfection byproducts were periodically detected above method detection limits in discharges to several of the basins throughout the year. Sodium hypochlorite and bromine, used to control bacteria in the drinking water and algae in cooling towers, lead to the formation of VOCs, including bromoform, chloroform, dibromochloromethane, and dichlorobromomethane. All concentrations were less than 3 µg/L with the exception of bromoform with all

values less than 19 µg/L. No other VOCs were detected above method detection limits in any of the discharges to the recharge basins.

The analytical data presented in Table 5-3 show that for 2016, the concentrations of all analytes were within effluent standards, except for high detections of chlorides in Basins HS, HT-E, and HZ. Chlorides are found to be higher in samples collected during the winter and are attributed to road salt used to control snow and ice buildup. The samples with elevated chloride levels from Basins HS, HT-E, and HZ were collected in February during a rain event and likely reflect the washing out of road salt applied during previous snow events. High concentrations of sodium detected in samples from the three basins confirmed road salt as the source of chlorides. The data in Table 5-4 show that all parameters, except for iron and antimony, complied with the respective water quality or groundwater discharge standards. Iron is a natural component of soil and its presence is likely

**Table 5-2. Radiological Analysis of Samples from BNL On-Site Recharge Basins.**

Basin		Gross Alpha	Gross Beta	Tritium
		(pCi/L)		
No. of samples		2	2	2
HN	max.	< 1.6	2.33 ± 0.64	< 251
	avg.	0.13 ± 0.79	2.18 ± 0.28	<MDL
HO	max.	< 1.36	1.41 ± 0.76	<354
	avg.	-0.6 ± 0.43	0.87 ± 1.07	<MDL
HS	max.	< 1.72	1.47 ± 0.72	<249
	avg.	-15.12 ± 32.51	-7.06 ± 16.73	<MDL
HT-E	max.	1.76 ± 1.22	1.97 ± 0.8	<249
	avg.	-80.62 ± 161.46	-41.12 ± 84.45	<MDL
HT-W	max.	1.68 ± 1.04	1.66 ± 0.76	<247
	avg.	-0.52 ± 4.3	0.83 ± 1.63	<MDL
HW	max.	3.98 ± 2.21	6.07 ± 1.41	<486
	avg.	2.37 ± 3.15	3.52 ± 5	<MDL
HZ	max.	< 1.2	< 0.99	<352
	avg.	-4.79 ± 9.59	-0.54 ± 1.42	<MDL
SDWA Limit		15	(a)	20,000

**Notes:**

See Figure 5-2 for recharge basin/outfall locations.

All values reported with a 95% confidence interval.

Negative numbers occur when the measured value is lower than background (see Appendix B for description).

To convert values from pCi to Bq, divide by 27.03.

(a) The drinking water standard was changed from 50 pCi/L (concentration based) to 4 mrem/yr (dose based) in 2003. As gross beta activity does not identify specific radionuclides, a dose equivalent of this value cannot be calculated.

MDL = minimum detection limit

SDWA = Safe Drinking Water Act

due to suspended soil in the sample at the time of collection. Acidification of the sample (part of the analytical process) results in the dissolution of the element and its detection during analysis. This is supported by the observation that the concentration of iron in filtered samples are typically much less, and well below the discharge standard or NYS AWQS. Antimony was detected in one sample collected at Basin HT-E slightly above the groundwater discharge standard. However, these values were estimated and are suspect, due to the presence of antimony in the laboratory blank.

**5.4.3 Stormwater Assessment**

All recharge basins receive stormwater runoff. Stormwater at BNL is managed by collecting runoff from paved surfaces, roofs, and other impermeable surfaces and directing it to recharge basins via underground piping and above-grade vegetated swales. Recharge Basin HS receives most of the stormwater runoff from the central, developed portion of the Laboratory site. Basins HN, HZ, HT-W, and HT-E receive runoff from the Collider-Accelerator complex. Basin HO receives runoff from the area surrounding the HFBR. Basin CSF receives runoff from the CSF area and along Cornell Avenue east of Renaissance Road. Basin HW receives runoff from the NSLS-II site, and HW-M receives runoff from the fenced area at the FHWMF.

Stormwater runoff at the Laboratory typically has elevated levels of inorganics (i.e., metals) and has a low pH. The inorganics are attributable to high sediment content in stormwater (inorganics occur naturally in native soil). In an effort to further improve the quality of stormwater runoff on site, BNL has formal procedures for managing and maintaining outdoor work and storage areas. The requirements include covering of equipment and materials (e.g., road salt storage, bins/containers with potential to leak residual oils or any other hazardous materials), to prevent contact with stormwater, conducting an aggressive maintenance and inspection program, implementing erosion control measures during soil disturbance activities, and restoring these areas when operations cease. Basin sediment sampling is conducted on a five-year testing cycle to ensure these discharges are in compliance with regulatory requirements. The next sampling event will occur in 2017.

**5.5 PECONIC RIVER SURVEILLANCE**

Several locations are monitored along the Peconic River to assess the overall water quality of the river and to assess any impact from BNL operations. Sampling points along the Peconic River are identified in Figure 5-4. In total, eight stations (three upstream and five downstream of the former STP discharge) may be sampled to support the Peconic River Surveillance Program. A sampling station along the Carmans



Table 5-3. Water Quality Data for BNL On-Site Recharge Basin Samples.

ANALYTE		Recharge Basin								NYSDEC Effluent Standard	Typical MDL
		HN (RHIC)	HO (AGS)	HS (s)	HT-W (Linac)	HT-E (AGS)	HW (s)	CSF (s)	HZ (s)		
No. of samples		2	2	2	2	2	2	2	2	6.5 - 8.5	NA
pH (SU)	min.	6.6	7.5	7.1	7.1	6.8	7.5	7.3	7.2		
	max.	7.6	7.5	7.2	7.3	7.3	7.9	7.4	7.4		
Conductivity (µS/cm)	min.	255	126	213	211	388	27	185	109	SNS	NA
	max.	716	504	3337	821	18002	819	1031	4863		
	avg.	486	315	1775	516	9195	423	608	2486		
Temperature (°C)	min.	5.4	13.4	3.5	8.8	5.7	11.4	6.6	11.1	SNS	NA
	max.	7.2	21.5	8.8	16.1	13.4	22.1	22.4	21.2		
	avg.	6.3	17.5	6.1	12.4	9.5	16.7	14.5	16.2		
Dissolved oxygen (mg/L)	min.	9.3	9.0	9.1	9.5	10.2	10.1	9.7	8.9	SNS	NA
	max.	13.1	10.0	13.6	11.1	13.1	11.2	11.1	10.2		
	avg.	11.2	9.5	11.3	10.3	11.7	10.7	10.4	9.5		
Chlorides (mg/L)	min.	56	52	63	53	98	2.6	34	47	500	2.5
	max.	158	122	5310	361	12400	230	270	1390		
	avg.	107	87	2687	207	6249	116	152	719		
Sulfates (mg/L)	min.	10	9.7	9.8	10	9.9	0.7	2.8	8.9	500	1.3
	max.	13.7	9.8	37	11.2	46	4.3	5.3	15.1		
	avg.	11.9	9.7	23.4	10.6	28.0	2.5	4.1	12.0		
Nitrate as nitrogen (mg/L)	min.	0.2	0.2	0.1	0.2	0.2	0.1	0.2	0.2	10	0.04
	max.	0.4	0.2	0.5	0.2	0.2	0.6	0.3	0.2		
	avg.	0.3	0.2	0.3	0.2	0.2	0.3	0.2	0.2		

## Notes:

See Figure 5-2 for the locations of recharge basins/outfalls.

(s) = stormwater

AGS = Alternating Gradient Synchrotron

Linac = Linear Accelerator

MDL = minimum detection level

NA = Not Applicable

NYSDEC = New York State Department of Environmental Conservation

RHIC = Relativistic Heavy Ion Collider

SNS = Effluent Standard Not Specified

River (HH) is monitored as a geographic control location, not affected by Laboratory operations or located within the Peconic River watershed. The following locations may be monitored for radiological and nonradiological parameters:

*Upstream sampling station*

- HY, on site, immediately east of the William Floyd Parkway

*Downstream sampling stations*

- HV, on site, just east of the 10 o'clock experimental hall in the RHIC Ring
- HE, on site, approximately 20 feet upstream of the former STP outfall
- HM-N, on site, at the east firebreak

- HM-S, on site, on a typically dry tributary of the Peconic River at the east firebreak
- HQ, on site, near the site boundary
- HA, first station downstream of the BNL boundary
- Donahue's Pond, off site

*Control location*

- HH, Carmans River

**5.5.1 Peconic River – Radiological Analyses**

During 2016, radionuclide analyses were performed on surface water samples collected from three of the eight Peconic River sampling locations and the Carmans River control location. The

## CHAPTER 5: WATER QUALITY

**Table 5-4. Metals Analysis of Water Samples from BNL On-Site Recharge Basins.**

METAL		HO (AGS)		HT-E (AGS)		HT-W (Linac)		HZ (stormwater)		NYSDEC Effluent Limit or AWQS	Typical MDL
		Total (T) or Filtered (F)									
No. of samples		2	2	2	2	2	2	2	2		
<b>Ag</b> Silver (µg/L)	min.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	50	1.5
	max.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0		
	avg.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0		
<b>Al</b> Aluminum (µg/L)	min.	66	< 50.0	160	< 50	< 68	< 50	< 50.0	< 50.0	2000	59
	max.	< 68.0	< 68.0	211	< 68	150	< 68	< 68.0	< 68.0		
	avg.	< 68.0	< 68.0	186	< 68	109	< 68	< 68.0	< 68.0		
<b>As</b> Arsenic (µg/L)	min.	< 1.7	< 1.7	< 5.0	< 5.0	< 1.7	< 1.7	< 1.7	< 5.0	50	5.7
	max.	< 5.0	< 5.0	< 17.0	< 17.0	< 5.0	< 5.0	< 5.0	< 8.5		
	avg.	< 5.0	< 5.0	< 17.0	< 17.0	< 5.0	< 5.0	< 5.0	< 8.5		
<b>Ba</b> Barium (µg/L)	min.	24.4	24.5	36	33	32.9	30.8	30.2	30.4	2000	10.5
	max.	34	42	206	126	42	45	40	40		
	avg.	29.2	33.3	121	79.5	37.5	37.9	35.1	35.2		
<b>Be</b> Beryllium (µg/L)	min.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	SNS	1.5
	max.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0		
	avg.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0		
<b>Cd</b> Cadmium (µg/L)	min.	< 1.0	< 1.0	0.1	< 2.0	< 1.0	< 1.0	1.2	1.08	10	1.5
	max.	< 2.0	< 2.0	4.8	2.5	< 2.0	< 2.0	< 2.0	< 2.0		
	avg.	< 2.0	< 2.0	2.5	2.2	< 2.0	< 2.0	< 2.0	< 2.0		
<b>Co</b> Cobalt (µg/L)	min.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	5	3
	max.	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
	avg.	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
<b>Cr</b> Chromium (µg/L)	min.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	100	5.5
	max.	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0		
	avg.	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0		
<b>Cu</b> Copper (µg/L)	min.	< 3.0	< 3.0	11.2	6.5	6.5	< 3.0	6.8	5.6	1000	6.5
	max.	< 10.0	< 10.0	12	8.4	69	31	31	30		
	avg.	< 10.0	< 10.0	11.6	7.44	37.74	17	18.76	17.78		
<b>Fe</b> Iron (mg/L)	min.	0.06	0.03	0.35	0.08	0.11	< 0.03	0.1	0.03	0.6	0.04
	max.	< 0.05	< 0.05	0.42	0.09	0.65	< 0.05	< 0.05	< 0.05		
	avg.	< 0.05	< 0.05	0.39	0.08	0.38	< 0.05	< 0.05	< 0.05		
<b>Hg</b> Mercury (µg/L)	min.	< 0.07	< 0.07	< 0.07	< 0.07	< 0.07	< 0.07	< 0.07	< 0.07	1.4	0.1
	max.	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2		
	avg.	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2		
<b>Mn</b> Manganese (µg/L)	min.	3.2	< 2.0	49	13	10.8	2.5	9.5	5.7	600	2
	max.	30	13	108	51.1	76	13	13	8.2		
	avg.	16.6	7.5	78.5	32.1	43.4	7.8	11.2	8.2		

(continued on next page)

Table 5-4. Metals Analysis of Water Samples from BNL On-Site Recharge Basins. (concluded).

METAL	<i>Total (T) or Filtered (F)</i>	HO (AGS)		HT-E (AGS)		HT-W (Linac)		HZ (stormwater)		NYSDEC Effluent Limit or AWQS	Typical MDL
		T	F	T	F	T	F	T	F		
		No. of samples	2	2	2	2	2	2	2		
<b>Na</b> Sodium (mg/L)	<i>min.</i>	28	37	82	79	32	40	34	35	SNS	1.03
	<i>max.</i>	79.4	80.1	7860	3910	240	222	993	989		
	<i>avg.</i>	53.7	58.6	3971	1995	136	131	513.5	512		
<b>Ni</b> Nickel (µg/L)	<i>min.</i>	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	200	5.8
	<i>max.</i>	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10		
	<i>avg.</i>	< 10	< 10	< 10	< 10	< 10	< 10	< 10	< 10		
<b>Pb</b> Lead (µg/L)	<i>min.</i>	< 0.5	< 0.5	< 3.0	< 3.0	< 0.5	< 0.5	< 2.5	< 2.5	50	2.6
	<i>max.</i>	< 3.0	< 3.0	< 5.0	< 5.0	< 3.0	< 3.0	12	4.9		
	<i>avg.</i>	< 3.0	< 3.0	< 5.0	< 5.0	< 3.0	< 3.0	7.3	3.7		
<b>Sb</b> Antimony (µg/L)	<i>min.</i>	< 3.5	< 3.5	< 5.0	< 5.0	< 3.5	< 3.5	< 3.5	< 3.5	6	4.2
	<i>max.</i>	< 5.0	< 5.0	8.0	8.5	< 5.0	< 5.0	< 5.0	< 5.0		
	<i>avg.</i>	< 5.0	< 5.0	6.5	6.8	< 5.0	< 5.0	< 5.0	< 5.0		
<b>Se</b> Selenium (µg/L)	<i>min.</i>	< 1.5	< 1.5	< 5.0	< 5.0	< 1.5	< 1.5	< 1.5	< 5.0	20	5.3
	<i>max.</i>	< 5.0	< 5.0	< 15.0	< 15.0	< 5.0	< 5.0	< 5.0	< 7.5		
	<i>avg.</i>	< 5.0	< 5.0	< 15.0	< 15.0	< 5.0	< 5.0	< 5.0	< 7.5		
<b>Tl</b> Thallium (µg/L)	<i>min.</i>	< 0.45	< 0.45	< 4.5	< 4.5	< 0.45	< 4.5	< 2.25	< 2.25	SNS	3.5
	<i>max.</i>	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
	<i>avg.</i>	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
<b>V</b> Vanadium (µg/L)	<i>min.</i>	< 1.0	< 1.0	1.01	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	SNS	3
	<i>max.</i>	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
	<i>avg.</i>	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
<b>Zn</b> Zinc (µg/L)	<i>min.</i>	6.2	6.7	19	< 20	35.2	23	24	29	5000	11.6
	<i>max.</i>	< 20.0	< 20.0	80.7	19.4	69	28.6	54.7	53.1		
	<i>avg.</i>	< 20.0	< 20.0	59.4	34.7	52.1	25.8	39.4	41.1		

Notes:

See Figure 5-2 for the locations of recharge basins/outfalls.

AGS = Alternating Gradient Synchrotron


AWQS = Ambient Water Quality Standards

Linac = Linear Accelerator

MDL = minimum detection limit

majority of the Peconic River sampling locations were dry throughout 2016 due to drought conditions. The radiological data from Peconic River surface water samples are summarized in Table 5-5. Radiological analysis of water samples collected from all locations had very low concentrations of gross alpha and gross beta activity that are attributed to natural sources. All detected levels were below the applicable NYS DWS. No gamma-emitting radionuclides

attributable to Laboratory operations were detected, and tritium was not detected above method detection limits in any of the samples. There was one low-level detection of Sr-90 at the off-site control location HH ( $0.29 \pm 0.18$  pCi/L) that is well below the NYS DWS of 8 pCi/L. This value is consistent with background levels, and can be attributed to worldwide fallout.

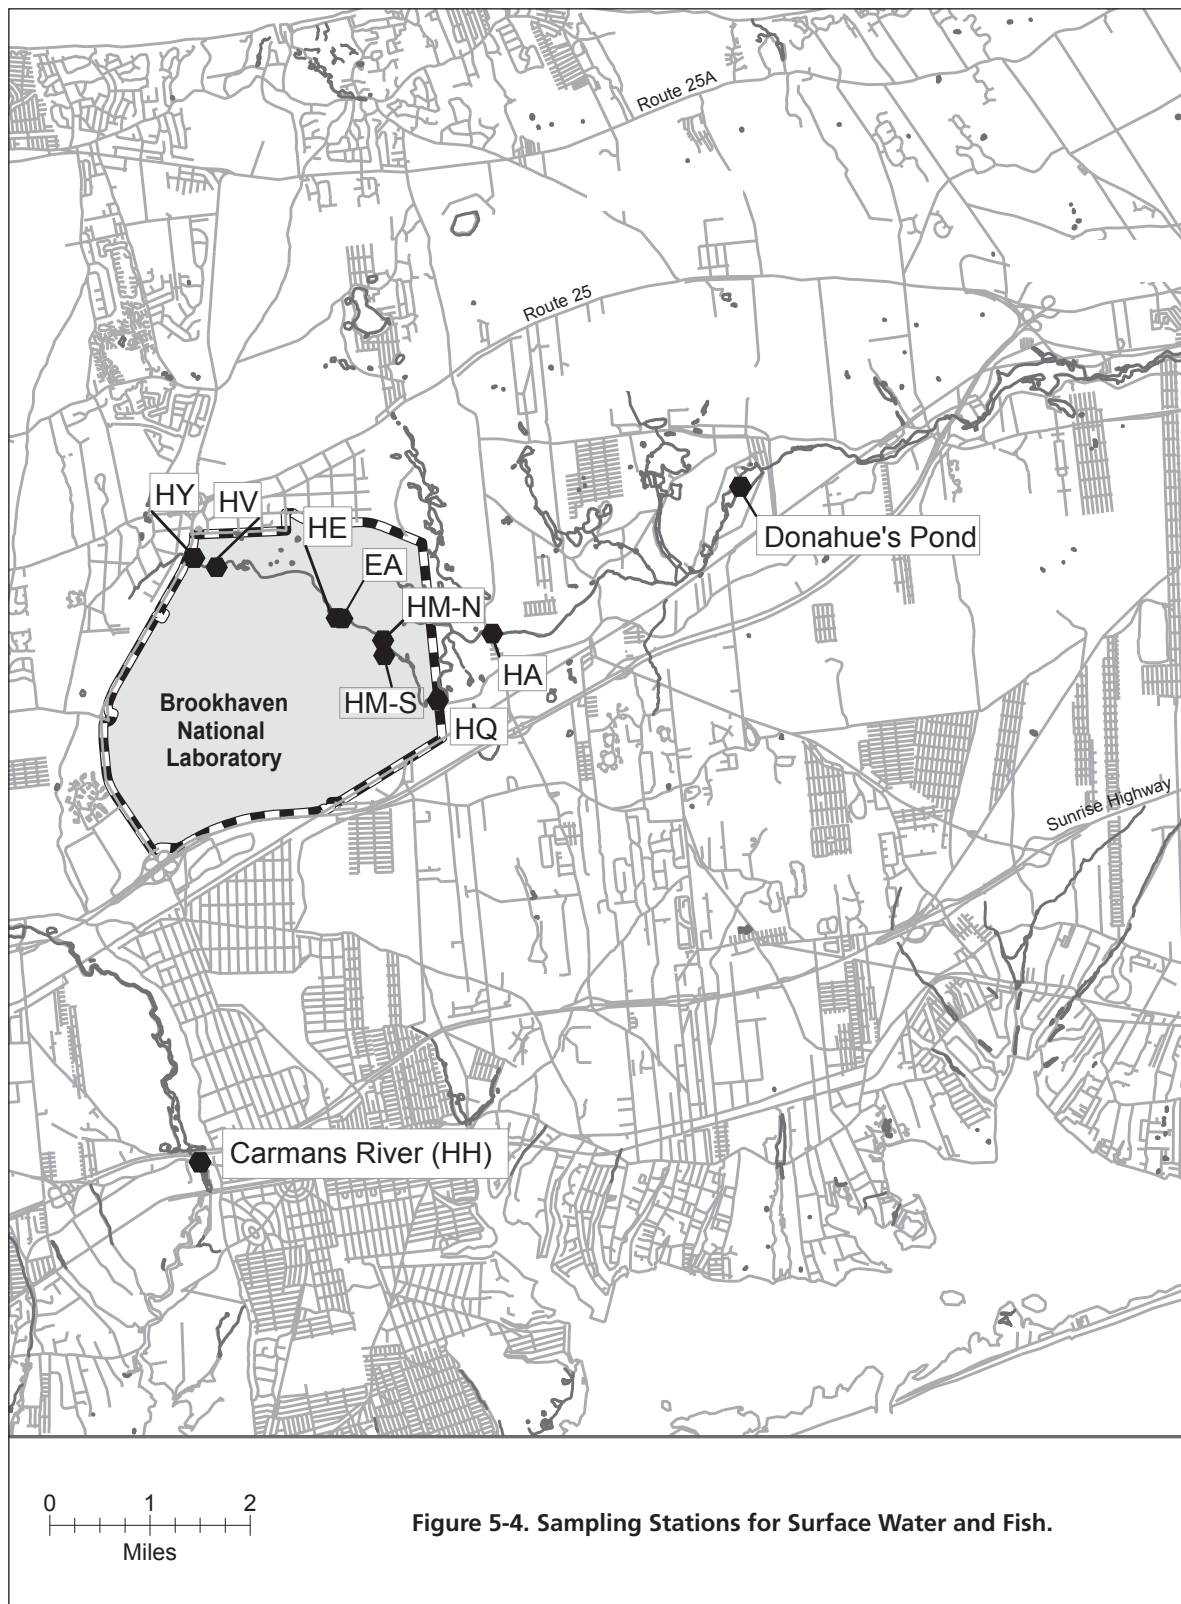

**Table 5-5. Radiological Results for Surface Water Samples Collected along the Peconic and Carmans Rivers.**

Sampling Station		Gross Alpha	Gross Beta	Tritium	Sr-90
		(pCi/L)			
<b>HY</b> (headwaters) on site, west of the RHIC ring	<i>N</i>	1	1	1	1
	<i>max</i>	< 1.3	< 0.92	< 332	< 0.18
	<i>avg</i>	NA	NA	NA	NA
<b>HV</b> (headwaters) on site, inside the RHIC ring	<i>N</i>	1	1	1	NA
	<i>max</i>	< 0.96	< 0.86	< 337	NA
	<i>avg</i>	NA	NA	NA	NA
<b>HE</b> upstream of STP outfall	<i>N</i>	NS	NS	NS	NS
	<i>max</i>	---	---	---	---
	<i>avg</i>	---	---	---	---
<b>HM-N</b> downstream of STP, on site	<i>N</i>	NS	NS	NS	NS
	<i>max</i>	---	---	---	---
	<i>avg</i>	---	---	---	---
<b>HM-S</b> tributary, on site	<i>N</i>	NS	NS	NS	NS
	<i>max</i>	---	---	---	---
	<i>avg</i>	---	---	---	---
<b>HQ</b> downstream of STP, at BNL site boundary	<i>N</i>	NS	NS	NS	NS
	<i>max</i>	---	---	---	---
	<i>avg</i>	---	---	---	---
<b>HA</b> off site	<i>N</i>	NS	NS	NS	NS
	<i>max</i>	---	---	---	---
	<i>avg</i>	---	---	---	---
<b>Donahue's Pond</b> off site	<i>N</i>	2	2	2	2
	<i>max</i>	< 1.41	1.47 ± 0.71	< 328	< 0.31
	<i>avg</i>	< MDL	1.26 ± 0.92	< MDL	< MDL
<b>Carmans River</b> <b>HH</b> control location, off site	<i>N</i>	2	2	2	2
	<i>max</i>	2.36 ± 1.22	2.7 ± 0.83	< 319	0.29 ± 0.18
	<i>avg</i>	0.96 ± 1.32	1.52 ± 0.95	< MDL	0.15 ± 0.21
<b>SDWA Limit (pCi/L)</b>		<b>15</b>	<b>(a)</b>	<b>20,000</b>	<b>8</b>

**Notes:**

See Figure 5-4 sampling station locations.

All values reported with a 95% confidence interval.

To convert values from pCi to Bq, divide by 27.03.

MDL = minimum detection limit

N = number of samples analyzed

NA = not applicable

NS = not sampled due to dry conditions

RHIC = Relativistic Heavy Ion Collider

SDWA = Safe Drinking Water Act

STP = Sewage Treatment Plant

(a) The drinking water standard was changed from 50 pCi/L (concentration based) to 4 mrem/yr (dose based) in 2003. Because gross beta activity does not identify specific radionuclides, a dose equivalent cannot be calculated for the values in the table.



### 5.5.2 Peconic River – Nonradiological Analyses

River water samples collected in 2016 were analyzed for water quality parameters (pH, temperature, conductivity, and dissolved oxygen), anions (chlorides, sulfates, and nitrates), metals, and VOCs. The analytical data for the Peconic River and Carmans River samples are summarized in Table 5-6 (water quality) and Table 5-7 (metals). There were no VOCs detected above the method detection limits in any samples collected from any of the Peconic River or Carmans River stations in 2016.

Water quality in the two Peconic River locations (one on site and one off site) and the

Carmans River control location (HH) were below applicable NYS standards. Ambient water quality standards for metallic elements are based on their solubility state. Certain metals are only biologically available to aquatic organisms if they are in a dissolved or ionic state, whereas other metals are toxic in any form (i.e., dissolved and particulate combined).

In 2016, the BNL monitoring program continued to assess water samples for both the dissolved and particulate form. Dissolved concentrations were determined by filtering the samples prior to acid preservation and analysis. Examination of the total (i.e., particulate form)

**Table 5-6. Water Quality Analytical Results for Surface Water Samples Collected Along the Peconic and Carmans Rivers.**

Analyte		Peconic River Station Locations							NYSDEC Effluent Standard	Typical MDL
		HY	HE	HM-N	HM-S	HQ	HA	Donahue's Pond (Control) HH		
	No. of samples	1	Dry	Dry	Dry	Dry	Dry	2	2	
pH (SU)	min.	6.6	-	-	-	-	-	6.3	6.7	6.5-8.5
	max.	6.6	-	-	-	-	-	6.6	7.5	
Conductivity (μS/cm)	min.	NA	-	-	-	-	-	109	206	SNS
	max.	314	-	-	-	-	-	122	228	
	avg.	NA	-	-	-	-	-	116	217	
Temperature (°C)	min.	NA	-	-	-	-	-	9.9	11	SNS
	max.	10.4	-	-	-	-	-	20.4	19.8	
	avg.	NA	-	-	-	-	-	15.2	15.4	
Dissolved oxygen (mg/L)	min.	NA	-	-	-	-	-	3.2	8.2	>4.0
	max.	12.1	-	-	-	-	-	12.1	12.2	
	avg.	NA	-	-	-	-	-	7.6	10.2	
Chlorides (mg/L)	min.	NA	-	-	-	-	-	13	36	250(a)
	max.	78	-	-	-	-	-	15	42	
	avg.	NA	-	-	-	-	-	14	39	
Sulfate (mg/L)	min.	NA	-	-	-	-	-	6.5	11	250(a)
	max.	1.2	-	-	-	-	-	23	11	
	avg.	NA	-	-	-	-	-	14.8	11	
Nitrate as nitrogen (mg/L)	min.	NA	-	-	-	-	-	0.02	0.8	10(a)
	max.	0.11	-	-	-	-	-	0.03	1.1	
	avg.	NA	-	-	-	-	-	0.03	0.9	

**Notes:**

See Figure 5-2 for recharge basin/outfall locations.

Donahue's Pond = Peconic River, off site

HA = Peconic River, off site

HE = Peconic River, upstream of former STP Outfall

HH = Carmans River control location, off site

HM-N = Peconic River on site, at the east firebreak

HM-S = Peconic River tributary, on site

(a) Since there are no NYSDEC Class C surface Ambient Water Quality Standards (AWQS) for these compounds, the AWQS for Class GA groundwater is provided for reference.

HQ = Peconic River, at BNL site boundary

HY = Peconic River headwaters, on site, east of Wm Floyd Pkwy.

MDL = minimum detection limit

NA = not applicable

NYSDEC = New York State Department of Environmental Conservation

SNS = effluent standard not specified

Table 5-7. Metals Analytical Results for Surface Water Samples Collected Along the Peconic and Carmans Rivers.

METAL		Peconic River Locations																		NYSDEC AWQS	Typical MDL				
Total (T) or Dissolved (D)		HY			HE			HM-N			HM-S			HQ			HA			Donahue's Pond			Control HH		
	No. of samples	T	D	T	D	T	D	T	D	T	D	T	D	T	D	T	D	T	D	T	D	T	D		
Ag (I) Silver (µg/L)		1	1	Dry	-	-	-	-	-	Dry	-	-	-	-	-	-	-	-	-	2	2	2	2		
	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<2.0	<2.0	<2.0	<2.0			
	max.	<2.0	<2.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<2.0	<2.0	<2.0	<2.0			
Al (I) Aluminum (µg/L)		NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<2.0	<2.0	<2.0	<2.0			
	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	110	82	53	31			
	max.	230	86	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	120	150	62	48			
As (D) Arsenic (µg/L)		NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	115	116	57.5	39.5			
	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<5.0	<5.0	<5.0	<5.0			
	max.	<5.0	<5.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<5.0	<5.0	<5.0	<5.0			
Ba Barium (µg/L)		NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	26	26	34	35			
	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	28	28	45	53			
	max.	<20	<20	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	27	27	40	44			
Be (AS) Beryllium (µg/L)		NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<2.0	<2.0	<2.0	<2.0			
	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<2.0	<2.0	<2.0	<2.0			
	max.	<2.0	<2.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<2.0	<2.0	<2.0	<2.0			
Cd (D) Cadmium (µg/L)		NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<2.0	<2.0	<2.0	<2.0			
	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<2.0	<2.0	<2.0	<2.0			
	max.	<2.0	<2.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<2.0	<2.0	<2.0	<2.0			
Co (AS) Cobalt (µg/L)		NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<5.0	<5.0	<5.0	<5.0			
	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<5.0	<5.0	<5.0	<5.0			
	max.	<5.0	<5.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<5.0	<5.0	<5.0	<5.0			
Cr (I) Chromium (µg/L)		NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<5.0	<5.0	<5.0	<5.0			
	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<10.0	<10.0	<10.0	<10.0			
	max.	<10.0	<10.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<10.0	<10.0	<10.0	<10.0			
Cu (D) Copper (µg/L)		NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<10.0	<10.0	<10.0	<10.0			
	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	2.9	0.8	7.4	0.73			
	max.	6	4.5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<10.0	0.83	<10.0	<10.0			
		NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<10.0	0.81	<10.0	<10.0			
	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<10.0	<10.0	<10.0	<10.0			
	max.	<10.0	<10.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	<10.0	<10.0	<10.0	<10.0			

(continued on next page)

Table 5-7. Metals Analytical Results for Surface Water Samples Collected Along the Peconic and Carmans Rivers. (continued)

METAL		Peconic River Locations																				NYSDEC AWQS	Typical MDL				
		HY		HE		HM-N		HM-S		HQ		HA		Donahue's Pond				Control HH									
Total (T) or Dissolved (D)		T	D	T	D	T	D	T	D	T	D	T	D	T	D	T	D	T	D	T	D	T	D				
No. of samples		1	1	Dry				Dry				Dry				Dry				2				2			
Fe (AS) Iron (mg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	max.	0.28	0.24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
Hg (D) Mercury (µg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	max.	< 0.2	< 0.2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
Mn Manganese (µg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	max.	5.1	4.9	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
Na Sodium (mg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	max.	74	72	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
Ni (D) Nickel (µg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	max.	< 10.0	< 10.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
Pb (D) Lead (µg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	max.	1.7	0.81	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
Sb Antimony (µg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	max.	< 5.0	< 5.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
Se (D) Selenium (µg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	max.	< 5.0	< 5.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
Tl (AS) Thallium (µg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	max.	< 5.0	< 5.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				

(continued on next page)

Table 5-7. Metals Analytical Results for Surface Water Samples Collected Along the Peconic and Carmans Rivers (concluded).

METAL		Peconic River Locations																NYSDEC AWQS	Typical MDL		
		HY		HE		HM-N		HM-S		HQ		HA		Donahue's Pond						Control HH	
		T	D	T	D	T	D	T	D	T	D	T	D	T	D	T	D			T	D
Total (T) or Dissolved (D)	No. of samples	1	1	Dry		Dry		Dry		Dry		Dry		Dry		2	2	2	2		
V (AS) Vanadium (µg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	< 5.0	< 5.0	< 5.0	< 5.0		
	max.	6.6	6.1	-	-	-	-	-	-	-	-	-	-	-	-	< 5.0	< 5.0	< 5.0	< 5.0		
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	< 5.0	< 5.0	< 5.0	< 5.0		
Zn (D) Zinc (µg/L)	min.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	< 20.0	< 20.0	< 20.0	< 20.0		
	max.	< 20.0	< 20.0	-	-	-	-	-	-	-	-	-	-	-	-	36	< 20.0	< 20.0	< 20.0		
	avg.	NA	NA	-	-	-	-	-	-	-	-	-	-	-	-	< 20.0	< 20.0	< 20.0	< 20.0		

Notes:

See Figure 5-4 sampling station locations.

AWQS = Ambient Water Quality Standards

AS = Acid Soluble

DP = Donahue's Pond

MDL = minimum detection level

NA = Not Applicable

SNS = Effluent Standard Not Specified for these elements in Class C surface waters

(a) NYS AWQS for Class C surface waters

metals data showed that aluminum, copper, iron, lead and zinc were present in concentrations at some locations that exceeded NYS AWQS. Aluminum and iron are detected throughout the Peconic and Carmans River systems at concentrations that exceed the NYS AWQS in both the filtered and unfiltered fractions. Iron and aluminum are found in high concentrations in native Long Island soil and, for iron, at high levels in groundwater. Levels of copper, lead, and zinc at concentrations greater than the NYS AWQS were found in samples collected at station HY, which is immediately east of the William Floyd Parkway and not within the influence of BNL operations, Donahue's Pond, and the Carman's River control location (HH). Filtration of the samples reduced concentrations for most metals to below the NYS AWQS, indicating that most detections were due to sediment carryover

## REFERENCES AND BIBLIOGRAPHY

BNL. 2014. Standards Based Management System Subject Area: Liquid Effluents. Brookhaven National Laboratory, Upton, NY. December 2014.

NYCRR Part 703.6. Title 6. 1999. Surface Water and Groundwater Quality Standards and Groundwater Effluent Limitations. New York State Department of Environmental Conservation. Albany, NY. Change 8-4-99.