

Water Quality

5

Wastewater generated from operations at Brookhaven National Laboratory (BNL) is treated at the Sewage Treatment Plant (STP) before it is discharged to nearby groundwater recharge basins. Some wastewater may contain very low levels of radiological, organic, or inorganic contaminants. Monitoring, pollution prevention, and vigilant operation of treatment facilities ensure that these discharges comply with all applicable regulatory requirements and that the public, employees, and the environment are protected. Analytical data for 2019 shows that the average gross alpha and beta activity levels in the STP discharge (EA, Outfall 001) were within the typical range of historical levels and were well below New York State Drinking Water Standards (NYS DWS). Tritium was not detected above method detection limits in the STP discharge during the entire year and no cesium-137, strontium-90, or other gamma-emitting nuclides attributable to Laboratory operations were detected. Non-radiological monitoring of the STP effluent showed that, with the exception of multiple tolyltriazol exceedances, organic and inorganic parameters were within State Pollutant Discharge Elimination System (SPDES) effluent limits or other applicable standards.


The average concentrations of gross alpha and beta activity in stormwater and cooling water discharged to recharge basins were within typical ranges and no gamma-emitting radionuclides were detected. Disinfection byproducts continue to be detected at low concentrations, above the method detection limit, in discharges to recharge basins due to the use of chlorine and bromine for the control of algae and bacteria in potable and cooling water systems. Inorganics (i.e., metals) were detected; however, their presence is due primarily to sediment runoff in stormwater discharges.

The Peconic River flowed the first half of 2019, then stopped flowing offsite by July as groundwater levels began subsiding. Radiological data from Peconic River surface water sampling show that the average concentrations of gross alpha and gross beta activity from on-site locations were indistinguishable from control locations, and all detected levels were below the applicable NYS DWS. No gamma-emitting radionuclides attributable to Laboratory operations were detected either upstream or downstream of the former STP outfall, and tritium was not detected above method detection limits in any of the surface water samples.

5.1 SURFACE WATER MONITORING PROGRAM

In addition to monitoring discharges to surface waters under the SPDES program described in Chapter 3, BNL routinely monitors surface water quality (including radionuclides) as part of its site Surveillance Program. Although discharges of treated wastewater from the Laboratory's STP into the headwaters of the Peconic

River ceased in October 2014, the Laboratory continues to monitor surface water at several locations along the Peconic River to assess the impact that site operations may have on surface water quality. On-site monitoring station HY is located upstream of all Laboratory operations and provides information on the background water quality of the Peconic River (see Figure 5-1).

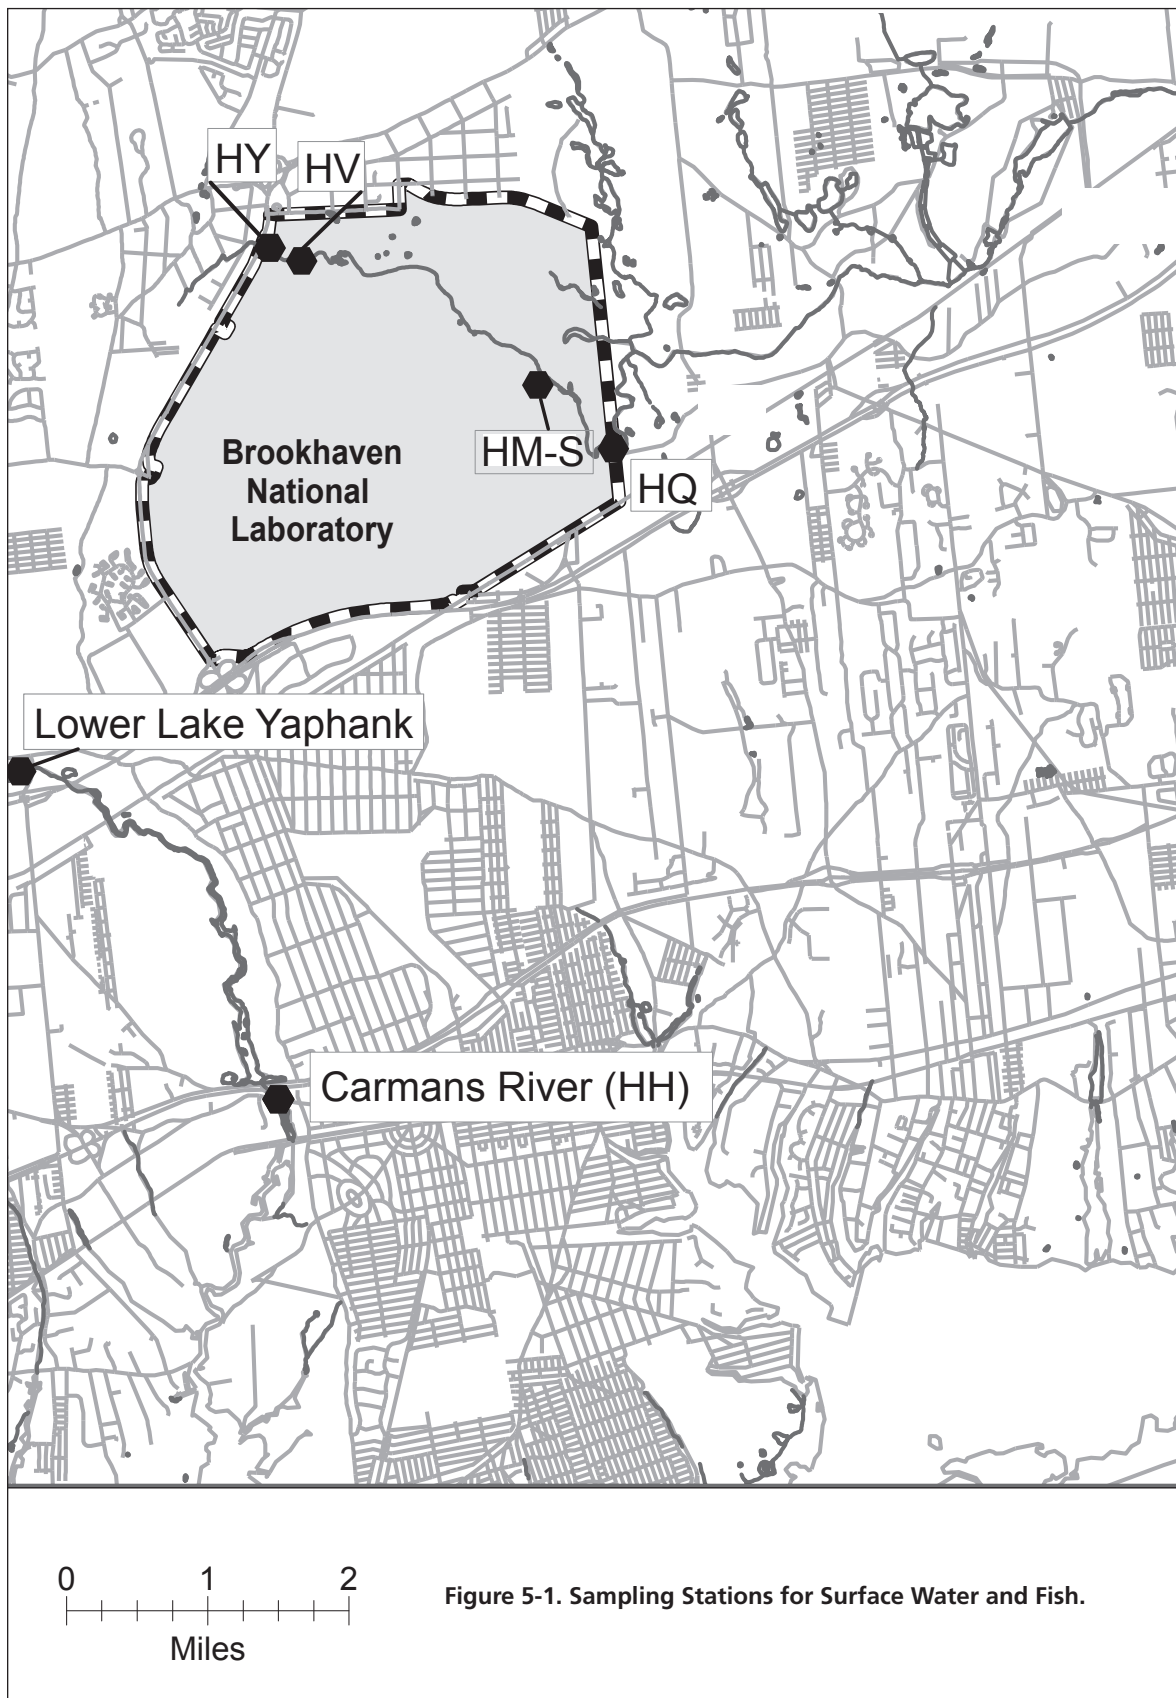

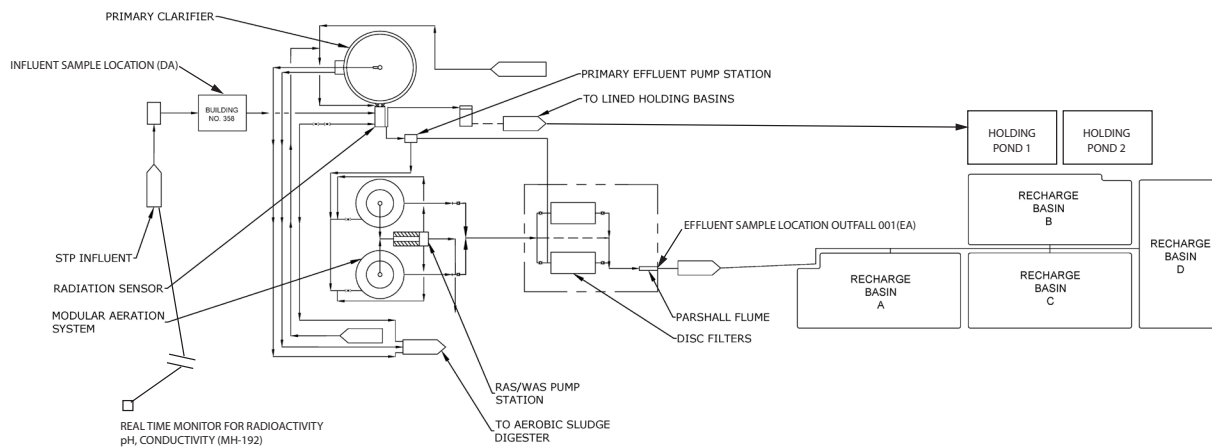


Figure 5-2. Schematic of BNL's Sewage Treatment Plant (Recharge Basin Discharge)

The Carmans River is monitored as a geographic control location for comparative purposes, as it is not affected by operations at BNL and is not connected to the Peconic River watershed.

On the Laboratory site, the Peconic River is an intermittent, groundwater-fed stream. Off-site flow occurs only following periods of sustained precipitation and a concurrent rise in the water table, typically in the spring. There was off-site flow during the first half of 2019 followed by drying conditions through the end of the year. The fluctuating cycles with periods of flow and no-flow are indicative of the combined influences of precipitation and groundwater.

Historical monitoring data indicates no significant variations in water quality throughout the Peconic River system on site, and pollution prevention efforts at the Laboratory have significantly reduced the risk of accidental releases. The following sections describe BNL's surface water monitoring and surveillance program.

5.2 SANITARY SYSTEM EFFLUENTS

The STP effluent (Outfall 001) is a discharge point authorized under BNL's SPDES permit that is issued by the NYSDEC (Section 3.6.1). Figure 5-2 shows a schematic for discharge of treated STP effluent to nearby groundwater recharge basins. The Laboratory's STP treatment process includes three principal steps:

- 1) aerobic oxidation for secondary removal of biological matter and nitrification of ammonia,
- 2) secondary clarification, and
- 3) filtration for final solids removal.

Tertiary treatment for nitrogen removal is also provided by controlling the oxygen levels in the aeration tanks. During the aeration process, the oxygen levels are allowed to drop to the point where microorganisms use nitrate-bound oxygen for respiration; this liberates nitrogen gas and consequently reduces the concentration of nitrogen in the STP discharge.

Solids separated in the clarifier are pumped to aerobic digesters for continued biological solids reduction and sludge thickening. Once the sludge in the aerobic digester reaches a solids content of six percent, the sludge is sampled to ensure it meets the waste acceptance criteria for disposal at the Suffolk County Department of Public Works Sewage Treatment Facility at Bergen Point, in West Babylon, New York.

Real-time monitoring of the sanitary waste stream for radioactivity, pH, and conductivity occurs at two locations. The first site, MH-192, is approximately 1.1 miles upstream of the STP, and provides a minimum of 30 minutes to warn the STP operators that wastewater exceeding SPDES limits or BNL administrative effluent release criteria is en route. The second monitoring site is at the point where the STP influent enters the treatment process.

CHAPTER 5: WATER QUALITY

Table 5-1. Tritium and Gross Activity in Water at the BNL Sewage Treatment Plant (STP).

		Flow (liters)	Tritium (pCi/L)		Gross Alpha (pCi/L)		Gross Beta (pCi/L)	
			max.	avg.	max.	avg.	max.	avg.
January	influent	2.38E+07	< 368	< MDL	< 3.1	0.3 ± 0.4	5.1 ± 1.4	4.3 ± 0.7
	effluent	1.60E+07	< 364	< MDL	< 2.6	0.8 ± 0.4	5.7 ± 1.4	4.2 ± 1.4
February	influent	2.40E+07	< 399	< MDL	< 6.2	0.9 ± 1.5	7.2 ± 2.7	4.6 ± 1.8
	effluent	2.40E+07	< 399	< MDL	< 2.5	0.3 ± 0.9	3.3 ± 1.2	2.6 ± 0.8
March	influent	2.33E+07	< 390	< MDL	< 3.9	0.2 ± 1.2	5.4 ± 2.1	5.0 ± 0.4
	effluent	2.79E+07	< 384	< MDL	< 3.0	0.7 ± 1.1	5.2 ± 1.5	4.0 ± 1.0
April	influent	2.95E+07	< 320	< MDL	< 3.6	1.1 ± 1.3	5.8 ± 1.2	5.1 ± 1.0
	effluent	3.65E+07	< 322	< MDL	< 1.8	0.0 ± 0.3	5.8 ± 1.1	4.4 ± 0.7
May	influent	3.07E+07	< 268	< MDL	< 2.5	0.3 ± 1.1	5.7 ± 1.3	5.1 ± 0.5
	effluent	2.94E+07	< 321	< MDL	< 1.9	0.1 ± 1.0	4.4 ± 0.9	3.9 ± 0.4
June	influent	3.10E+07	< 456	< MDL	< 2.6	1.5 ± 1.2	8.3 ± 1.4	7.2 ± 1.7
	effluent	2.56E+07	< 418	< MDL	< 1.8	0.3 ± 0.3	5.7 ± 1.0	4.8 ± 0.9
July	influent	3.13E+07	< 401	< MDL	< 5.4	1.5 ± 1.8	17.1 ± 1.7	8.2 ± 5.8
	effluent	3.39E+07	< 419	< MDL	< 2.1	0.3 ± 0.6	6.6 ± 1.6	5.6 ± 0.6
August	influent	2.82E+07	< 360	< MDL	< 2.1	0.4 ± 0.1	7.4 ± 4.5	5.4 ± 1.5
	effluent	2.01E+07	< 380	< MDL	< 1.2	-0.3 ± 0.6	4.7 ± 0.7	4.1 ± 1.0
September	influent	3.19E+07	< 389	< MDL	< 12.0	2.7 ± 3.7	15.6 ± 5.8	7.1 ± 4.6
	effluent	2.74E+07	< 393	< MDL	2.9 ± 3.0	0.7 ± 1.6	11.2 ± 3.6	6.0 ± 3.0
October	influent	2.51E+07	< 378	< MDL	< 10.2	-2.2 ± 1.8	9.3 ± 2.8	6.4 ± 2.6
	effluent	2.05E+07	< 345	< MDL	< 4.0	-2.4 ± 1.2	5.4 ± 1.2	4.6 ± 0.6
November	influent	1.82E+07	< 231	< MDL	< 16.5	7.1 ± 5.0	11.6 ± 3.8	8.2 ± 4.1
	effluent	2.01E+07	< 242	< MDL	< 3.5	-2.0 ± 1.0	5.8 ± 1.4	5.0 ± 1.1
December	influent	2.24E+07	< 411	< MDL	< 4.1	-3.7 ± 4.9	8.2 ± 2.9	5.4 ± 1.8
	effluent	2.41E+07	< 326	< MDL	< 4.1	-1.0 ± 1.8	4.9 ± 1.3	3.8 ± 0.5
Annual Avg.	influent			< MDL		1.8 ± 2.2		6.0 ± 0.8
	effluent			< MDL		-0.2 ± 0.4		4.5 ± 0.4
Total Release		3.06E+08		8.8 mCi (a)		0.1 mCi		1.3 mCi
Average MDL (pCi/L)				363.3		2.9		1.5
SDWA Limit (pCi/L)				20000		15		50 (b)

Notes:

All values above MDL are reported with a 95% confidence interval.

To convert values from pCi to Bq, divide by 27.03.

Negative numbers occur when the measured value is lower than background (see Appendix B for description).

MDL = minimum detection limit

SDWA = Safe Drinking Water Act

(a) The total released value for tritium is a conservative calculation that is based on an average of the 95% confidence interval maximums as estimates of monthly average release concentrations. The majority of the effluent samples showed average concentrations less than zero and all results were less than the MDL.

(b) The drinking water standards were changed from 50 pCi/L (concentration based) to 4 mrem/yr (dose based) in 2003. As gross beta activity activity does not identify specific radionuclides, a dose equivalent cannot be calculated for the values in the table.

Based on the data collected by the real-time monitoring systems, any influent to the STP that may not meet SPDES limits and BNL effluent release criteria can be diverted to two double-lined holding ponds. The total combined capacity of the two holding ponds exceeds six million gallons, or approximately 18 days of flow. Diversion would continue until the

influent water quality would allow for the permit limits and release criteria to be met. Wastewater diverted to the holding ponds is tested and evaluated against the requirements for release. If necessary, the wastewater is treated and then reintroduced into the STP at a rate that ensures compliance with SPDES permit limits for non-radiological parameters or BNL effluent release

criteria for radiological parameters. In 2019, there were no instances where influent water quality required diversion of wastewater to the hold-up ponds.

5.2.1 Sanitary System Effluent–Radiological Analyses

Wastewater at the STP is sampled at the inlet to the treatment process, Station DA, and at the STP outfall, Station EA, as shown in Figure 5-2. At each location, samples are collected on a flow-proportional basis; that is, for every 1,000 gallons of water treated, approximately

four fluid ounces of sample are collected and composited into a five-gallon collection container. These samples are analyzed weekly for gross alpha and gross beta activity and for tritium. Samples collected from these locations are also composited and analyzed monthly for gamma-emitting radionuclides and strontium-90 (Sr-90: half-life, 29 years).

Although the STP discharge is not used as a direct source of potable water, the Laboratory applies the more stringent Safe Drinking Water Act (SDWA) standards for comparison purposes when monitoring the effluent, in lieu of

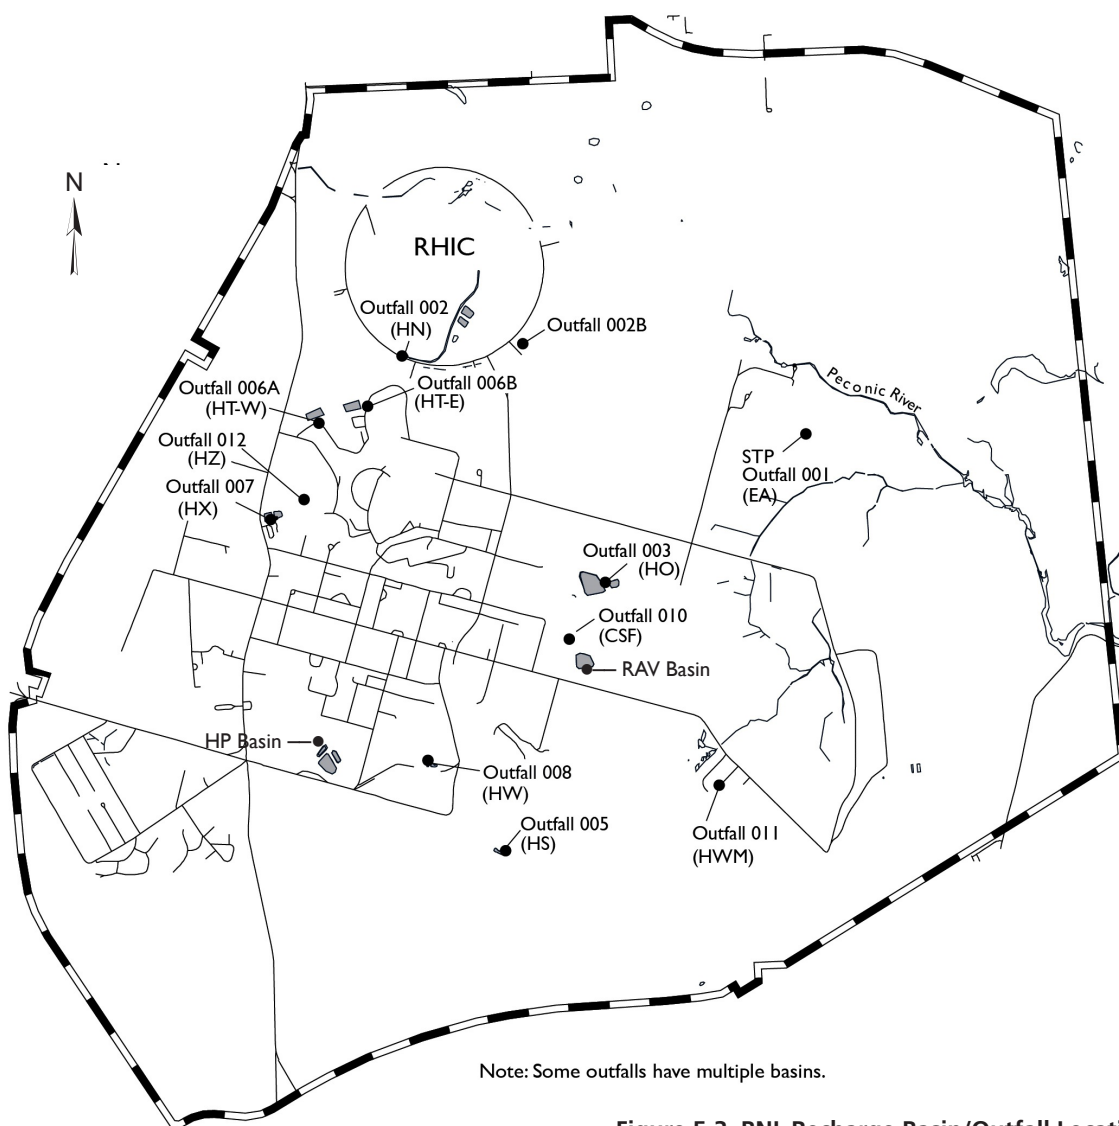


Figure 5-3. BNL Recharge Basin/Outfall Locations.

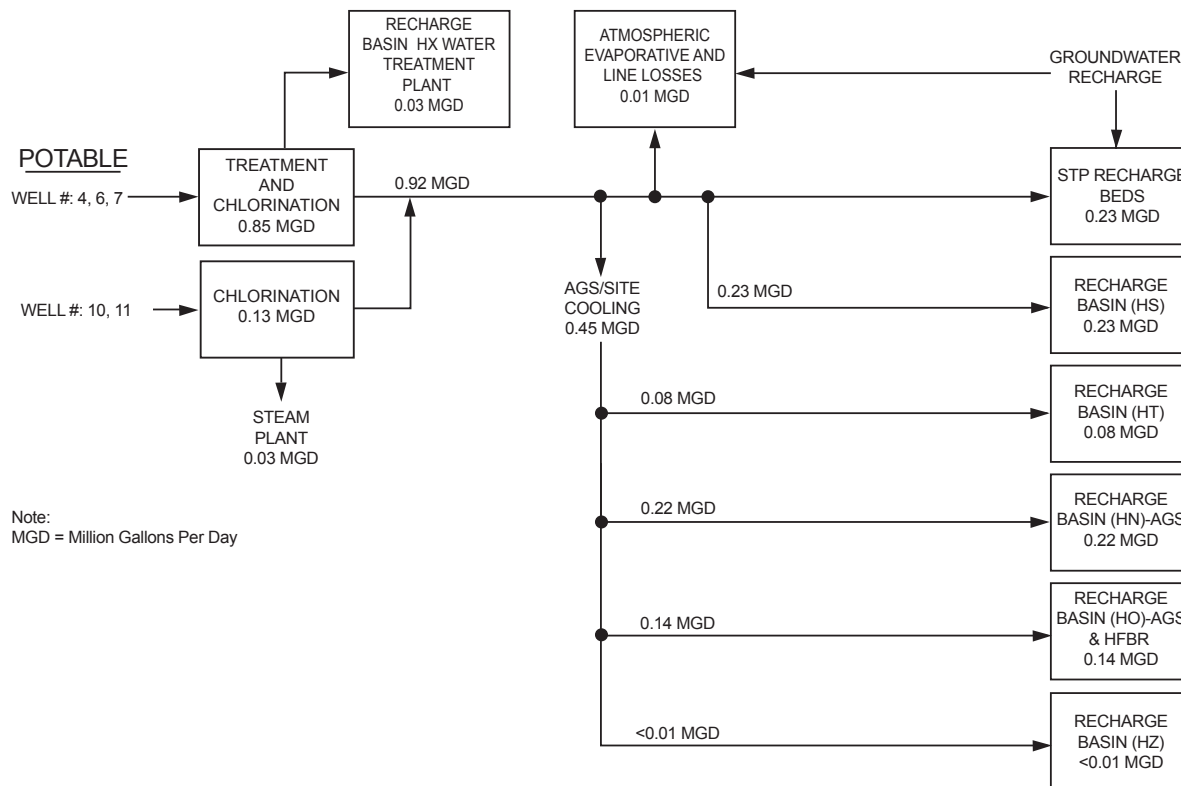


Figure 5-4. Schematic of Potable Water Use and Flow at BNL.

Department of Energy wastewater criteria. Under the SDWA, water standards are based on a 4 mrem (40 μ Sv) dose limit. The SDWA specifies that no individual may receive an annual dose greater than 4 mrem from radionuclides that are beta or photon emitters, which includes up to 168 individual radioisotopes. BNL performs radionuclide-specific gamma analysis to ensure compliance with this standard. The SDWA annual average gross alpha activity limit is 15 pCi/L, including radium-226 (Ra-226: half-life, 1,600 years), but excluding radon and uranium. Other SDWA-specified drinking water limits are 20,000 pCi/L for tritium (H-3: half-life, 12.3 years), 8 pCi/L for Sr-90, 5 pCi/L for Ra-226 and radium-228 (Ra-228: half-life, 5.75 years), and 30 μ g/L for uranium. Gross alpha and beta activity measurements are used as a screening tool for detecting the presence of radioactivity.

Table 5-1 shows the monthly gross alpha and beta activity data and tritium concentrations for

the STP influent and effluent during 2019. Annual average gross alpha and beta activity levels in the STP effluent were -0.2 ± 0.4 pCi/L and 4.5 ± 0.4 pCi/L, respectively. The gross alpha average concentrations were lower than those measured at the Carman's River control location (HH) while the gross beta was higher than the control location reported in Table 5-5; however, they were well below the SDWA standards that are used for comparison purposes. Tritium was not detected above MDL in the discharge of the STP (EA, Outfall 001) for the entire year. In 2019, there were no gamma-emitting nuclides detected in the STP effluent.

5.2.2 Sanitary System Effluent – Nonradiological Analyses

Monitoring of the STP effluent for volatile organic compounds (VOCs), inorganics, and anions is conducted as part of the SPDES Compliance Program, which is discussed in further detail in Chapter 3.

5.3 PROCESS-SPECIFIC WASTEWATER

Wastewater that may contain constituents above SPDES permit limits or ambient water quality discharge standards must be held by the generating facility and characterized to determine the appropriate means of disposal. The analytical results are compared with the appropriate discharge limit, and the wastewater is only released to the sanitary system if the volume and concentration of contaminants in the discharge would not jeopardize the quality of the STP effluent and, subsequently, potentially impact groundwater quality (BNL 2020).

The Laboratory's SPDES permit includes requirements for quarterly sampling and analysis of process-specific wastewater discharged from metal-cleaning operations in Building 498 and cooling tower discharges from Building 902. These operations are monitored for contaminants such as metals, cyanide, VOCs, and semi-volatile organic compounds. In 2019, analyses of these waste streams showed that, although several operations contributed contaminants (principally metals) to the STP influent in concentrations exceeding SPDES-permitted levels, these discharges did not affect the quality of the STP effluent.

Process wastewaters that are not expected to be of consistent quality and are not routinely generated are held for characterization before release to the sanitary system. The process wastewaters typically include purge water from groundwater sampling, wastewater from cleaning of heat exchangers, wastewater generated as a result of restoration activities, and other industrial wastewaters. To determine the appropriate disposal method, samples are analyzed for contaminants specific to the process, and the concentrations are compared to the SPDES effluent limits and BNL's effluent release criteria (BNL 2020). If the concentrations are within limits, authorization for sewer system discharge is granted; if not, alternate means of disposal are used. Any waste that contains elevated levels of hazardous or radiological contaminants in concentrations that exceeded Laboratory effluent release criteria are sent to the BNL Waste Management Facility for proper management and off-site disposal.

Table 5-2. Radiological Analysis of Samples from On-Site Recharge Basins.

Basin		Gross Alpha	Gross Beta	Tritium
		(pCi/L)		
No. of samples		2	2	2
HN	max.	< 1.97	2.37 ± 0.92	< 312
	avg.	0.53 ± 0.08	2.3 ± 0.15	< MDL
HO	max.	< 1.94	< 1.34	< 318
	avg.	0 ± 0.48	0.92 ± 0.14	< MDL
HS	max.	2.09 ± 1.46	4.14 ± 1.12	< 317
	avg.	1.32 ± 1.52	3.61 ± 1.04	< MDL
HT-E	max.	< 1.87	3.29 ± 1.22	< 320
	avg.	0.39 ± 0.61	2.46 ± 1.64	< MDL
HT-W	max.	< 1.76	1.43 ± 0.8	< 312
	avg.	-0.04 ± 0.02	1.27 ± 0.31	< MDL
HW	max.	< 1.93	1.58 ± 1	< 305
	avg.	1.01 ± 1.2	1.18 ± 0.78	< MDL
HZ	max.	< 1.97	1.32 ± 0.74	< 380
	avg.	0.16 ± 0.53	0.54 ± 1.53	< MDL
SDWA Limit		15	(a)	20,000

Notes:

See Figure 5-3 for recharge basin/outfall locations.

All values above MDL reported with a 95% confidence interval.

Negative numbers occur when the measured value is lower than background (see Appendix B for description).

To convert values from pCi to Bq, divide by 27.03.

(a) The drinking water standard was changed from 50 pCi/L (concentration based) to 4 mrem/yr (dose based) in 2003. As gross beta activity does not identify specific radionuclides, a dose equivalent of this value cannot be calculated.

MDL = minimum detection limit

SDWA = Safe Drinking Water Act

5.4 RECHARGE BASINS

Recharge basins are used for the discharge of “clean” wastewater, including once-through cooling water, stormwater runoff, and cooling tower blowdown. These wastewaters are suitable for direct replenishment of the groundwater aquifer. Figure 5-3 shows the locations of the Laboratory's discharges to recharge basins (also called “outfalls” under BNL's SPDES permit). Figure 5-4 presents an overall schematic of potable water use at the Laboratory, and how much of this water is discharged to the 11 on-site recharge basins:

- Basins HN, HT-W, and HT-E receive once-

Table 5-3. Water Quality Data for BNL On-Site Recharge Basin Samples.

ANALYTE		Recharge Basin								NYSDEC Effluent Standard	Typical MDL
		HN (RHIC)	HO (AGS)	HS (s)	HT-W (Linac)	HT-E (AGS)	HW (s)	CSF (s)	HZ (s)		
No. of samples		2	2	2	2	2	2	2	2		
pH (SU)	min.	7.6	7.4	7.5	7.6	7.4	7.5	7.5	7.5	6.5 - 8.5	NA
	max.	7.7	7.7	7.9	7.9	7.8	7.6	8.4	7.5		
Conductivity (µS/cm)	min.	526	236	314	229	345	31	86	216	SNS	NA
	max.	566	245	587	282	1049	317	259	235		
	avg.	546	240.5	450.5	255.5	697	174	172.5	225.5		
Temperature (°C)	min.	9.9	14.8	8.1	9.9	10.4	9.4	10.3	13.0	SNS	NA
	max.	25.7	23.7	23.7	24.5	25.1	23.5	23.6	21.8		
	avg.	17.8	19.2	15.9	17.2	17.8	16.4	17.0	17.4		
Dissolved oxygen (mg/L)	min.	8.1	9.0	9.9	8.9	9.0	8.8	8.4	9.4	SNS	NA
	max.	11.5	10.5	12.1	11.7	11.9	11.7	11.2	11.0		
	avg.	9.8	9.8	11.0	10.3	10.4	10.2	9.8	10.2		
Chlorides (mg/L)	min.	92.5	39.2	61.9	41.3	51.8	2.6	5.8	33.4	500	2.1
	max.	99.1	42.6	144.0	42.2	196.0	80.0	61.0	38.5		
	avg.	95.8	40.9	103.0	41.8	123.9	41.3	33.4	36.0		
Sulfates (mg/L)	min.	12.5	9.2	3.9	9.9	8.8	1.1	0.9	8.5	500	0.6
	max.	18.7	9.9	10.6	10.4	11.5	1.1	2.3	10.0		
	avg.	15.6	9.5	7.3	10.2	10.1	1.1	1.6	9.2		
Nitrate as nitrogen (mg/L)	min.	0.21	0.22	0.34	0.24	0.24	0.12	0.12	0.23	10	0.05
	max.	0.31	0.26	0.57	0.25	0.28	0.05	0.05	0.27		
	avg.	0.26	0.24	0.45	0.24	0.26	0.09	0.08	0.25		

Notes:

See Figure 5-3 for recharge basin/outfall locations.

NA = not applicable

(s) = stormwater

NYSDEC = New York State Department of Environmental Conservation

AGS = Alternating Gradient Synchrotron

RHIC = Relativistic Heavy Ion Collider

Linac = Linear Accelerator

SNS = effluent standard not specified

through cooling water discharges generated at the Alternating Gradient Synchrotron (AGS), LINAC and Relativistic Heavy Ion Collider (RHIC), as well as cooling tower blowdown and stormwater runoff.

- Basin HS receives predominantly stormwater runoff, once-through cooling water from Building 555 (Chemistry Department), and minimal cooling tower blowdown from the Computational Science Initiative facility.
- Basin HX receives Water Treatment Plant filter backwash water.
- Basin HO receives cooling water discharges from the AGS and stormwater runoff from the area surrounding the High Flux Beam Reactor (HFBR).

- Several other recharge areas are used exclusively for discharging stormwater runoff. These areas include Basin HW near the National Synchrotron Light Source II (NSLS-II) site, Basin CSF at the Central Steam Facility (CSF), Basin HW-M at the former Hazardous Waste Management Facility (FHWMF), and Basin HZ near Building 902. Recharge Basins HP and RAV are used for discharge of treated water from the groundwater remediation systems and are monitored under BNL's Comprehensive Environmental Response, Compensation and Liability Act (CERCLA) equivalency permits.

Each of the recharge basins is a permitted point-source discharge under the Laboratory's

Table 5-4. Metals Analysis of Water Samples from BNL On-Site Recharge Basins.

METAL		Recharge Basin								NYSDEC Effluent Limit or AWQS	Typical MDL
		HO (AGS/HFBR)		HT-E (AGS)		HT-W (Linac)		HZ (stormwater)			
		Total (T) or Filtered (F)	T	F	T	F	T	F	T		
No. of samples		2	2	2	2	2	2	2	2		
Ag Silver (µg/L)	min.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	50	1
	max.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
	avg.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
Al Aluminum (µg/L)	min.	< 68.0	< 68.0	< 68.0	< 68.0	< 68.0	< 68.0	< 68.0	< 68.0	2000	68
	max.	< 68.0	< 68.0	< 68.0	< 68.0	101	< 68.0	< 68.0	< 68.0		
	avg.	< 68.0	< 68.0	< 68.0	< 68.0	84.5	< 68.0	< 68.0	< 68.0		
As Arsenic (µg/L)	min.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	50	2
	max.	2.3	2.1	< 2.0	< 2.0	< 2.0	< 2.0	2.3	2.2		
	avg.	2.1	2.0	< 2.0	< 2.0	< 2.0	< 2.0	2.1	2.1		
Ba Barium (µg/L)	min.	21.3	19.8	26.7	26.3	21.1	20.8	18.3	17.0	2000	1
	max.	24.6	23.2	27.1	27.8	23.7	22.0	20.0	20.1		
	avg.	23.0	21.5	26.9	27.1	22.4	21.4	19.2	18.6		
Be Beryllium (µg/L)	min.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	SNS	1
	max.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
	avg.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
Cd Cadmium (µg/L)	min.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	10	1
	max.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
	avg.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
Co Cobalt (µg/L)	min.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	5	1
	max.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
	avg.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
Cr Chromium (µg/L)	min.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	100	1
	max.	1.1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
	avg.	1.1	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
Cu Copper (µg/L)	min.	3.0	2.9	3.0	3.0	11.0	3.9	3.4	3.7	1000	2
	max.	1.6	3.0	6.0	4.9	13.1	10.9	39.3	33.7		
	avg.	2.3	2.9	4.5	4.0	12.1	7.4	21.3	18.7		
Fe Iron (mg/L)	min.	0.06	0.04	0.09	0.05	0.03	< 0.03	0.03	< 0.03	0.6	0.03
	max.	0.11	0.07	0.14	0.06	0.26	0.05	0.07	0.05		
	avg.	0.08	0.05	0.12	0.05	0.14	0.04	0.05	0.04		
Hg Mercury (µg/L)	min.	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	1.4	0.1
	max.	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1		
	avg.	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1		
Mn Manganese (µg/L)	min.	3.0	2.0	4.1	2.3	1.7	< 2.0	< 2.0	< 2.0	600	2
	max.	5.3	2.2	8.9	6.3	13.7	3.7	4.2	3.9		
	avg.	4.1	2.1	6.5	4.3	7.7	2.4	3.1	3.0		

(continued on next page)

Table 5-4. Metals Analysis of Water Samples from BNL On-Site Recharge Basins *(concluded)*.

METAL		Recharge Basin								NYSDEC Effluent Limit or AWQS	Typical MDL
		HO (AGS/HFBR)		HT-E (AGS)		HT-W (Linac)		HZ (stormwater)			
		T	F	T	F	T	F	T	F		
Total (T) or Filtered (F)		T	F	T	F	T	F	T	F		
No. of samples		2	2	2	2	2	2	2	2		
Na Sodium (mg/L)	min.	25.5	25.4	37.3	38.6	28.4	28.0	20.6	21.0	SNS	0.1
	max.	26.5	25.6	130.0	127.0	29.6	29.7	25.3	24.7		
	avg.	26.0	25.5	83.7	82.8	29.0	28.9	23.0	22.9		
Ni Nickel (µg/L)	min.	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	200	1.5
	max.	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5		
	avg.	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5	< 1.5		
Pb Lead (µg/L)	min.	< 0.5	< 0.5	< 0.5	< 0.5	< 0.5	< 0.5	< 0.5	< 0.5	50	0.5
	max.	< 0.5	< 0.5	< 0.5	< 0.5	1.7	< 0.5	11.2	8.6		
	avg.	< 0.5	< 0.5	< 0.5	< 0.5	1.1	< 0.5	5.9	4.6		
Sb Antimony (µg/L)	min.	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5	6	3.5
	max.	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5		
	avg.	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5	< 3.5		
Se Selenium (µg/L)	min.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	20	2
	max.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0		
	avg.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0		
Tl Thallium (µg/L)	min.	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6	SNS	0.6
	max.	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6		
	avg.	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6	< 0.6		
V Vanadium (µg/L)	min.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	SNS	1
	max.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
	avg.	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		
Zn Zinc (µg/L)	min.	3.3	3.7	16.3	14.0	18.0	15.6	19.7	23.1	5000	3.3
	max.	6.9	5.5	25.3	21.8	42.0	22.0	38.8	37.7		
	avg.	5.1	4.6	20.8	17.9	30.0	18.8	29.3	30.4		

Notes:

See Figure 5-3 for recharge basin/outfall locations.

AGS = Alternating Gradient Synchrotron

AWQS = Ambient Water Quality Standards

Linac = Linear Accelerator

HFBR = High Flux Beam Reactor

SNS = effluent standard not specified

MDL = Method Detection Limit

SPDES permit and equivalency permits under the CERCLA program. Where required by the permit, the basins are equipped with a flow monitoring station, allowing for weekly recordings of flow rates. The specifics of the SPDES compliance monitoring program are provided in Chapter 3. To supplement the monitoring program, samples are also routinely collected and analyzed under BNL's Environmental Surveillance

Program for radioactivity, VOCs, metals, and anions. During 2019, water samples were collected from all the basins listed above semi-annually except for recharge Basin HX at the Water Treatment Plant (due to previously documented non-impact to groundwater from plant operations) and recharge basin at the FHWMF (due to absence of operations at the FHWMF that could lead to the contamination of runoff).

Table 5-5. Radiological Results for Surface Water Samples Collected Along the Peconic and Carmans Rivers.

Sampling Station		Gross Alpha	Gross Beta	Tritium	Strontium-90
		(pCi/L)			
HY (headwaters) on site, west of the RHIC ring	<i>N</i>	2	2	2	2
	<i>max</i>	< 1.52	11.4 ± 1.72	< 393	< 0.27
	<i>avg</i>	0.13 ± 0.41	6.46 ± 9.69	<MDL	0.11 ± 0.14
HV (headwaters) on site, inside the RHIC ring	<i>N</i>	2	2	2	NS
	<i>max</i>	< 2.36	3.47 ± 0.94	< 395	
	<i>avg</i>	2 ± 0.68	2.86 ± 1.21	<MDL	
HM-S tributary, on-site	<i>N</i>	1	1	1	1
	<i>max</i>	< 1.82	< 1.62	< 397	< 0.7
	<i>avg</i>	NA	NA	NA	NA
HQ BNL site boundary	<i>N</i>	3	3	3	3
	<i>max</i>	< 1.96	39.9 ± 2.17	< 319	< 0.83
	<i>avg</i>	0.64 ± 0.85	15.15 ± 24.27	<MDL	0.44 ± 0.1
Carmans River HH control location, off site	<i>N</i>	1	1	2	2
	<i>max</i>	< 1.76	< 1.11	< 375	0.24 ± 0.15
	<i>avg</i>	NA	NA	<MDL	0.13 ± 0.23
SDWA Limit (pCi/L)		15	(a)	20,000	8

Notes:

See Figure 5-1 sampling station locations.

All values reported with a 95% confidence interval.

To convert values from pCi to Bq, divide by 27.03.

MDL = minimum detection limit

N = number of samples analyzed

NA = not applicable

NS = not sampled due to dry conditions

RHIC = Relativistic Heavy Ion Collider

SDWA = Safe Drinking Water Act

STP = Sewage Treatment Plant

(a) The drinking water standard was changed from 50 pCi/L (concentration based) to 4 mrem/yr (dose based) in 2003.

Because gross beta activity does not identify specific radionuclides, a dose equivalent cannot be calculated for the values in the table.

5.4.1 Recharge Basins – Radiological Analyses

Discharges to the recharge basins were sampled semi-annually and analyzed for gross alpha and beta activity, gamma-emitting radionuclides, and tritium. The results are presented in Table 5-2. Gross alpha activity ranged from non-detect to 2.09 ± 1.46 pCi/L and gross beta activity ranged from non-detect to 4.14 ± 1.12 pCi/L. Low-level detections of beta activity are attributable to naturally occurring radionuclides, such as potassium-40 (K-40: half-life, $1.3\text{E}+09$ years). No gamma-emitting nuclides attributable to BNL operations or tritium were detected in any discharges to recharge basins. All tritium values were below the method detection levels and were well below the 20,000 pCi/L drinking water standard.

5.4.2 Recharge Basins – Nonradiological Analyses

During 2019, discharge samples were collected

semi-annually for water quality parameters, metals, and VOCs. Field-measured parameters (e.g., pH, conductivity, and temperature) were routinely monitored and recorded. The water quality and metals analytical results are summarized in Tables 5-3 and 5-4, respectively. The nonradiological analytical results are compared to groundwater discharge standards promulgated under Title 6 of the New York Codes, Rules, and Regulations (NYCRR), Part 703.6.

Low concentrations of disinfection byproducts were periodically detected above method detection limits in discharges to several of the basins throughout the year. Sodium hypochlorite and bromine, used to control bacteria in the drinking water and algae in cooling towers, can break down to bromoform, chloroform, dibromochloromethane, and dichlorobromomethane. Concentrations were above the 1 ug/L method detection limit at Basins HO, HT-E, HT-W, and

Table 5-6. Water Quality Analytical Results for Surface Water Samples Collected Along the Peconic and Carmans Rivers.

Analyte	Peconic River Station Locations				NYSDEC Effluent Standard	Typical MDL
	HY	HM-S	HQ	Carmans River HH (Control)		
<i>No. of samples</i>	2	1	3	2		
pH (SU)	<i>min.</i>	5.7	-	4.8	6.5 - 8.5	NA
	<i>max.</i>	6.8	4.1	6.5		
Conductivity (µS/cm)	<i>min.</i>	78	-	181	SNS	NA
	<i>max.</i>	123	35	560		
	<i>avg.</i>	101	-	311		
Temperature (°C)	<i>min.</i>	7.0	-	2.1	SNS	NA
	<i>max.</i>	17.7	7.5	24.4		
	<i>avg.</i>	12.4	-	14.3		
Dissolved oxygen (mg/L)	<i>min.</i>	8.1	-	1.3	SNS	NA
	<i>max.</i>	10.4	9.3	11.5		
	<i>avg.</i>	9.3	-	5.2		
Chlorides (mg/L)	<i>min.</i>	16.0	-	12.0	250 (a)	2.3
	<i>max.</i>	50.0	4.5	29.7		
	<i>avg.</i>	33.0	-	19.3		
Sulfate (mg/L)	<i>min.</i>	1.8	-	3.4	250 (a)	1
	<i>max.</i>	3.1	5.4	12.2		
	<i>avg.</i>	2.5	-	6.8		
Nitrate as nitrogen (mg/L)	<i>min.</i>	0.02	-	0.02	10 (a)	0.01
	<i>max.</i>	0.34	0.05	0.10		
	<i>avg.</i>	0.18	-	0.04		

Notes:

See Figure 5-1 for monitoring locations.

HY = Peconic River headwaters, on site, east of Wm Floyd Pkwy.

HQ = Peconic River on site at east boundary

HM-S = Peconic River tributary at east firebreak

HH = Carmans River control location, off site

NYSDEC = New York State Department of Environmental Conservation

SNS = effluent standard not specified

(a) Since there are no NYSDEC Class C surface Ambient Water Quality Standards (AWQS) for these compounds, the AWQS for Class GA groundwater is provided for reference.

HN for all disinfection byproducts, the highest values all being under 9.26 ug/L, which was the highest value recorded for bromoform. The only other VOC detected above method detection limits was methylene chloride, which was detected in Basin HN during July 2019 at a concentration of 2.23 ug/L, just above the method detection limit of 2 ug/L and likely attributed to cross-contamination within the contract laboratory.

The analytical data presented in Table 5-3

show that, for 2019, the concentrations of all analytes were within effluent standards, including chlorides. Historically, chlorides are found to be higher in samples collected during the winter and are attributed to road salt used to control snow and ice buildup. The mild conditions during winter months in 2019 resulted in lower salt use. The data in Table 5-4 show that all parameters complied with the respective water quality or groundwater discharge standards.

Table 5-7: Metals Analytical Results for Surface Water Samples Collected Along the Peconic and Carmans Rivers.

METAL		Peconic River Locations								NYSDEC AWQS (a)	Typical MDL
		HY		HM-S		HQ		HH(Control)			
Total (T) or Dissolved (D)		T	D	T	D	T	D	T	D		
No. of samples		2	2	1	1	3	3	2	2		
Ag (I) Silver (µg/L)	min.	< 2.0	< 2.0	-	-	< 2.0	< 2.0	< 2.0	< 2.0	0.1	2
	max.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0		
	avg.	< 2.0	< 2.0	-	-	< 2.0	< 2.0	< 2.0	< 2.0		
Al (I) Aluminum (µg/L)	min.	250	290	-	-	< 68	< 68	25	50	100	50
	max.	610	430	780	770	260	300	91	70		
	avg.	430	360	-	-	187	193	58	60		
As (D) Arsenic (µg/L)	min.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0	150	5
	max.	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
	avg.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0		
Ba Barium (µg/L)	min.	< 20	< 20	-	-	< 20	< 20	36	43	SNS	20
	max.	< 20	< 20	< 20	< 20	< 20	< 20	46	48		
	avg.	< 20	< 20	-	-	< 20	< 20	41	46		
Be (AS) Beryllium (µg/L)	min.	< 2.0	< 2.0	-	-	< 2.0	< 2.0	< 2.0	< 2.0	11	2
	max.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0		
	avg.	< 2.0	< 2.0	-	-	< 2.0	< 2.0	< 2.0	< 2.0		
Cd (D) Cadmium (µg/L)	min.	< 2.0	< 2.0	-	-	< 2.0	< 2.0	< 2.0	< 2.0	1.1	2
	max.	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0	< 2.0		
	avg.	< 2.0	< 2.0	-	-	< 2.0	< 2.0	< 2.0	< 2.0		
Co (AS) Cobalt (µg/L)	min.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0	5	5
	max.	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
	avg.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0		
Cr (I) Chromium (µg/L)	min.	< 10.0	< 10.0	-	-	< 10.0	< 10.0	< 10.0	< 10.0	34	10
	max.	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0		
	avg.	< 10.0	< 10.0	-	-	< 10.0	< 10.0	< 10.0	< 10.0		
Cu (D) Copper (µg/L)	min.	25	27	-	-	< 10.0	< 10.0	19	< 10.0	4	10
	max.	25	100	22	< 10.0	< 10.0	< 10.0	89	24		
	avg.	25	64	-	-	< 10.0	< 10.0	54	17		
Fe (AS) Iron (mg/L)	min.	0.62	0.40	-	-	0.43	0.33	0.24	0.06	0.3	0.05
	max.	1.40	3.50	0.31	0.30	1.15	0.72	0.32	0.14		
	avg.	1.01	1.95	-	-	0.71	0.53	0.28	0.99		
Hg (D) Mercury (µg/L)	min.	< 0.2	< 0.2	-	-	< 0.2	< 0.2	< 0.2	< 0.2	0.2	0.2
	max.	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2		
	avg.	< 0.2	< 0.2	-	-	< 0.2	< 0.2	< 0.2	< 0.2		
Mn Manganese (µg/L)	min.	29	24	-	-	12	12	62	58	SNS	4
	max.	41	32	13	13	161	111	95	120		
	avg.	35	28	-	-	66	51	78.5	89		
Na Sodium (mg/L)	min.	12	54	-	-	7.5	9.4	2.5	29	SNS	0.25
	max.	38	13	2.9	2.8	21.2	20.9	2.9	32		
	avg.	25	33.5	-	-	13.5	14.0	2.7	30.5		

(continued on next page)

Table 5-7: Metals Analytical Results for Surface Water Samples Collected Along the Peconic and Carmans Rivers *(concluded)*.

METAL		Peconic River Locations								NYSDEC AWQS (a)	Typical MDL
		HY		HM-S		HQ		HH(Control)			
Total (T) or Dissolved (D)		T	D	T	D	T	D	T	D		
No. of samples		2	2	1	1	3	3	2	2		
Ni (D) Nickel (µg/L)	min.	< 10.0	< 10.0	-	-	< 10.0	< 10.0	< 10.0	< 10.0	23	10
	max.	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0	< 10.0		
	avg.	< 10.0	< 10.0	-	-	< 10.0	< 10.0	< 10.0	< 10.0		
Pb (D) Lead (µg/L)	min.	< 3.0	3.4	-	-	< 3.0	< 3.0	< 3.0	< 3.0	0.1	3
	max.	4.2	9.7	< 3.0	< 3.0	< 3.0	< 3.0	5.1	< 3.0		
	avg.	3.3	6.6	-	-	< 3.0	< 3.0	3.3	< 3.0		
Sb Antimony (µg/L)	min.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0	SNS	5
	max.	< 5.0	< 5.0	< 5.0	< 5.0	7.5	< 5.0	< 5.0	< 5.0		
	avg.	< 5.0	< 5.0	-	-	5.3	< 5.0	< 5.0	< 5.0		
Se (D) Selenium (µg/L)	min.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0	4.6	5
	max.	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
	avg.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0		
Tl (AS) Thallium (µg/L)	min.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0	8	5
	max.	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
	avg.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0		
V (AS) Vanadium (µg/L)	min.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0	14	5
	max.	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0	< 5.0		
	avg.	< 5.0	< 5.0	-	-	< 5.0	< 5.0	< 5.0	< 5.0		
Zn (D) Zinc (µg/L)	min.	32	34	-	-	< 20.0	< 20.0	< 20.0	< 20.0	37	20
	max.	38	150	25	< 20.0	< 20.0	< 20.0	62	21		
	avg.	35	92	-	-	< 20.0	< 20.0	39	< 20.0		

Notes:

See Figure 5-1 sampling station locations.

AWQS = Ambient Water Quality Standards

AS = Acid Soluble

SNS = effluent standard not specified for these elements in Class C surface waters

(a) NYS AWQS for Class C surface waters

5.4.3 Stormwater Assessment

All recharge basins receive stormwater runoff. Stormwater at BNL is managed by collecting runoff from paved surfaces, roofs, and other impermeable surfaces and directing it to recharge basins via underground piping and above-grade vegetated swales. Recharge Basin HS receives most of the stormwater runoff from the central, developed portion of the Laboratory site. Basins HN, HZ, HT-W, and HT-E receive runoff from the Collider-Accelerator complex. Basin HO receives runoff from the area surrounding the HFBR. Basin CSF receives runoff from the CSF area and along Cornell Avenue east of

Renaissance Road. Basin HW receives runoff from the NSLS-II site, and HW-M receives runoff from the fenced area at the FHWMF.

Stormwater runoff at the Laboratory typically has elevated levels of inorganics (i.e., metals) and has a low pH. The inorganics are attributable to high sediment content in stormwater (inorganics occur naturally in native soil). In an effort to further improve the quality of stormwater runoff on site, BNL has formal procedures for managing and maintaining outdoor work and storage areas. The requirements include covering of equipment and materials (e.g., road salt storage and bins/containers with potential

to leak residual oils or any other hazardous materials) to prevent contact with stormwater, conducting an aggressive maintenance and inspection program, implementing erosion control measures during soil disturbance activities, and restoring these areas when operations cease. Basin sediment sampling is conducted on a five-year testing cycle to ensure these discharges comply with regulatory requirements. Basin sediments were last sampled in 2017 and data were presented in Chapter 6 of the 2017 SER. The next sampling event will occur in 2022.

5.5 PECONIC RIVER SURVEILLANCE

Several locations are monitored along the Peconic River to assess the overall water quality of the river and assess any impact from BNL operations. Sampling points along the Peconic River are identified in Figure 5-1. In total, four stations (two upstream and two downstream of the former STP discharge) were sampled in 2019. A sampling station along the Carmans River (HH) was also monitored as a geographic control location, not affected by Laboratory operations or located within the Peconic River watershed. The following locations were monitored for radiological and nonradiological parameters:

Upstream sampling station:

- HY, on site, immediately east of William Floyd Parkway
- HV, on site, just east of the 10 o'clock experimental hall in the RHIC Ring, radiological only

Downstream sampling stations:

- HM-S, on site, at east firebreak south of mainstem of Peconic
- HQ, on site, at east boundary of BNL

Control location:

- HH, Carmans River

5.5.1 Peconic River – Radiological Analyses

During 2019, radionuclide analyses were performed on surface water samples collected from the four Peconic River sampling locations and the Carmans River control location. HM-N, located at the east firebreak, was removed from

sampling as HY and HV allow for radiological assessment of potential RHIC impacts and no other contributions from potential BNL operations enter the river until the tributary monitoring at HM-S. HQ sampling station is the final monitoring location before the river flows off site. The majority of the Peconic River on site held water for at least part of 2019. The radiological data from Peconic River surface water samples are summarized in Table 5-5. Radiological analysis of water samples collected from all locations had very low concentrations of gross alpha and gross beta activity that were attributed to natural sources. All detected levels were below the applicable NYS DWS. No gamma-emitting radionuclides attributable to Laboratory operations were detected, and neither tritium nor Sr-90 was detected above method detection limits in any of the Peconic River samples. Sr-90 was detected at a maximum concentration of 0.24 ± 0.15 pCi/L and was just above the detection limit and well below the drinking water standard of 8 pCi/L. This value is consistent with background levels, and can be attributed to worldwide fallout.

5.5.2 Peconic River – Nonradiological Analyses

River water samples collected in 2019 were analyzed for water quality parameters (e.g. pH, temperature, conductivity, and dissolved oxygen), anions (e.g. chlorides, sulfates, and nitrates), metals, and VOCs. The analytical data for the Peconic River and Carmans River samples are summarized in Table 5-6 (water quality) and Table 5-7 (metals). There were no VOCs detected above the method detection limits in any samples collected from the Peconic River or Carmans River stations in 2019.

Water quality parameters measured in the three Peconic River locations and the Carmans River control location (HH) show that pH, temperature, conductivity, and dissolved oxygen levels were all within applicable NYS standards.

Ambient water quality standards (AWQS) for metallic elements are based on their solubility state. Certain metals are only biologically available to aquatic organisms if they are in a dissolved or ionic state, whereas other metals are toxic in any form (i.e., dissolved and particulate

CHAPTER 5: WATER QUALITY

combined). In 2019, the BNL monitoring program continued to assess water samples for both the dissolved and particulate form. Dissolved concentrations were determined by filtering the samples prior to acid preservation and analysis. Examination of the total (i.e., particulate form) metals data showed that aluminum, copper, iron, lead, and zinc were present in concentrations at some locations that exceeded NYS AWQS. Aluminum and iron were detected throughout the Peconic and Carmans River systems at concentrations that exceed the NYS AWQS in both the filtered and unfiltered fractions. Iron and aluminum are found in high concentrations in native Long Island soil and, for iron, at high levels in groundwater. Levels of copper greater than the NYS AWQS were found at all locations except

station HQ. Lead at concentrations greater than the NYS AWQS were found in samples collected at station HY on the Peconic River and HH on the Carmans River, while zinc was found at station HY, HM-S on the Peconic River, and HH on the Carmans River. Filtration of the samples reduced concentrations for some metals but not all, suggesting that suspended sediment was responsible for some metals in the samples.

REFERENCES AND BIBLIOGRAPHY

- BNL. 2020. Standards Based Management System Subject Area: Liquid Effluents. Brookhaven National Laboratory, Upton, NY. March 2020.
- NYCRR Part 703.6. Title 6. 2019 Surface Water and Groundwater Quality Standards and Groundwater Effluent Limitations. New York State Department of Environmental Conservation. Albany, NY.