

Brookhaven National Laboratory (BNL) monitors both radioactive and nonradioactive emissions at several facilities on site to ensure compliance with the requirements of the Clean Air Act (CAA). In addition, BNL conducts ambient air monitoring to verify local air quality and assess possible environmental impacts from Laboratory operations.

During 2017, BNL facilities released a total of 10,660 curies of short-lived radioactive gases. Oxygen-15 and Carbon-11 emitted from the Brookhaven Linac Isotope Producer constituted more than 99.99 percent of the site's radiological air emissions.

Because natural gas prices were comparatively lower than residual fuel oil prices throughout the year, BNL's Central Steam Facility used natural gas to meet 98.3 percent of the heating and cooling needs of the Laboratory's major facilities in 2017. As a result, emissions of particulates, oxides of nitrogen, sulfur dioxide, and volatile organic compounds were well below the respective regulatory permit criteria pollutant limits.

4.1 RADIOLOGICAL EMISSIONS

Federal air quality laws and U.S. Department of Energy (DOE) regulations that govern the release of airborne radioactive material include 40 CFR 61 Subpart H: National Emission Standards for Hazardous Air Pollutants (NESHAPs)—part of the CAA and DOE Order 458.1 Chg. 3, *Radiation Protection of the Public and the Environment*. Under NESHAPs Subpart H, facilities that have the potential to deliver an annual radiation dose of greater than 0.1 mrem (1 μ Sv) to a member of the public must be continuously monitored for emissions. Facilities capable of delivering radiation doses below that limit require periodic, confirmatory monitoring.

BNL has two active facilities, the Brookhaven Linac Isotope Producer (BLIP) which is continuously monitored with an inline detection system, and the Target Processing Laboratory (TPL) that has a particulate filter sampling system to continuously collect gross alpha and gross beta samples, and one inactive facility, the High Flux Beam Reactor (HFBR), where periodic monitoring is conducted. Figure 4-1 provides the locations of these monitored facilities,

and Table 4-1 presents airborne release data from these facilities. Annual emissions from monitored facilities are discussed in the following sections of this chapter. The associated radiation dose estimates are presented in Chapter 8, Table 8-5.

4.2 FACILITY MONITORING

Radioactive emissions are monitored at the HFBR, BLIP, and TPL. The samplers in the exhaust stack for BLIP and the TPL exhaust duct are equipped with glass-fiber filters that capture samples of airborne particulate matter generated at these facilities (see Figure 4-1 for locations). The filters are collected and analyzed weekly for gross alpha and beta activity. Particulate filter analytical results for gross alpha and beta activity in 2017 are reported in Table 4-2. The average gross alpha and beta airborne activity levels for samples collected from the BLIP exhaust stack were 0.0005 and 0.0073 pCi/m³, respectively. Annual average gross alpha and beta airborne activity levels for samples collected from the TPL were 0.0008 and 0.0113 pCi/m³, respectively.



Figure 4-1. Air Emission Release Points Subject to Monitoring.

4.2.1 High Flux Beam Reactor

In 1997, a plume was traced back to a leak in the HFBR spent fuel storage pool. Consequently, the HFBR was put in standby mode until November 1999, when DOE declared that it was to be permanently shut down. Residual tritium in water in the reactor vessel and piping systems continued to diffuse into the building's air through valve seals and other system penetrations, though emission rates were much lower than during the years of operation.

In 2010, the HFBR was disconnected from the 100-meter stack, and a new HFBR exhaust system was installed in 2011. As part of the HFBR Long-Term Surveillance Program (BNL

2013), air samples are collected from outside the HFBR confinement structure using a permanently installed sample port. Samples are analyzed for tritium to evaluate facility emissions and to ensure that air quality within the building is acceptable to permit staff entry. Samples are collected for three or four weeks per month using a standard desiccant sampling system for tritium analysis. Desiccant samples are analyzed by an off-site contract laboratory.

4.2.2 Brookhaven Linac Isotope Producer

Protons from the Linear Accelerator (Linac) are sent via an underground beam tunnel to the BLIP, where they strike various metal targets

to produce new radionuclides for medical diagnostics. The activated metal targets are transferred to the TPL in Building 801 for separation and shipment to various radiopharmaceutical research laboratories. During irradiation, the targets become hot and are cooled by a continuously recirculating water system. The cooling water also becomes activated during the process, producing secondary radionuclides. The most significant of these radionuclides are oxygen-15 (O-15, half-life: 122 seconds) and carbon-11 (C-11, half-life: 20.4 minutes). Both isotopes are released as gaseous, airborne emissions through the facility's 33-foot stack. Emissions of these radionuclides are dependent on the current and energy of the proton beam used to manufacture the radioisotopes.

In 2017, BLIP operated over a period of 26 weeks, during which 3,553 Ci of C-11 and 7,107 Ci of O-15 were released (see Table 4-1). Tritium produced from activation of the target cooling water was also released, but in a much smaller quantity, 1.34 E-2 Ci. Combined emissions of C-11 and O-15 were 10,660 Ci, about two percent higher than the combined emissions of 10,425 Ci in 2016. This increase is primarily due to operation at higher average current levels for short periods, and occasional increased water gaps for Thorium targets in 2017. The Thorium target irradiations are in support of future actinium-225 production programs.

4.2.3 Target Processing Laboratory

As mentioned in Section 4.2.2, metal targets irradiated at the BLIP are transported to the TPL in Building 801, where isotopes are chemically extracted for radiopharmaceutical production.

Airborne radionuclides released during the extraction process are drawn through multi-stage HEPA and charcoal filters and the filtered air is then vented to the atmosphere. The types of radionuclides that are processed depend on the isotopes chemically extracted from the irradiated metal targets, which may change from year to year. Annual radionuclide quantities released from this facility are very small, typically in the μCi to mCi range. Gamma analysis of monthly composite samples was discontinued in 2013. This decision was based on historical

Table 4-1. Airborne Radionuclide Releases from Monitored Facilities.

Facility	Nuclide	Half-Life	Ci Released
HFBR	Tritium	12.3 years	3.91E-01
BLIP	Carbon-11	20.4 minutes	3.55E+03
	Oxygen-15	122 seconds	7.11E+03
	Tritium	12.3 years	1.34E-02
Total			1.07E+04

Notes:

Ci = 3.7×10^{10} Bq

BLIP = Brookhaven Linac Isotope Producer

HFBR = High Flux Beam Reactor (operations were terminated in November 1999)

analytical results of TPL particulate filters that showed gross alpha/beta levels to be very low and consistent with background concentrations. As a result, there are no reported radionuclide emissions from the TPL in Table 4-1. Should future gross beta analyses of TPL emissions show the potential for other radionuclide emissions, gamma analyses will be resumed.

4.2.4 Additional Minor Sources

Several research departments at BNL use designated fume hoods for work that involves small quantities of radioactive materials (in the μCi to mCi range). The work typically involves labeling chemical compounds and transferring material between containers. Due to the use of HEPA filters and activated charcoal filters, the nature of the work conducted, and the small quantities involved, these operations have a very low potential for atmospheric releases of significant quantities of radioactive materials. Compliance with NESHAPs Subpart H is demonstrated through the use of an inventory system that allows an upper estimate of potential releases to be calculated. Facilities that demonstrate compliance in this way include Buildings 197, 197B, 348, 463, 480, 490, 490A, 510A, 535, 555, 725, 734, 735, 801, and 815, where research is conducted in the fields of nuclear safety, biology, high energy physics, medicine, medical therapy, photon science, advanced technology, environmental chemistry, and synthetic biology. See Table 8-5 in Chapter 8 for the calculated dose from these facility emissions.

4.2.5 Nonpoint Radiological Emission Sources

Nonpoint radiological emissions from a variety of diffuse sources may be evaluated for compliance with NESHAPs Subpart H. Diffuse sources evaluated often include planned research, planned waste management activities, and planned decontamination and decommissioning (D&D) activities. Evaluations determine whether NESHAPs permitting and continuous monitoring requirements are applicable, or whether periodic confirmatory sampling is needed to ensure compliance with Subpart H standards for radionuclide emissions. Chapter 8 discusses the NESHAPs evaluations of diffuse sources in 2017, if any.

4.3 AMBIENT AIR MONITORING

As part of the Environmental Monitoring Program, air monitoring stations are in place around the perimeter of the BNL site (see Figure 4-2 for locations). There are four blockhouse stations equipped for collecting samples. At each blockhouse, vacuum pumps draw air through columns where particulate matter is captured on a glass-fiber filter. Particulate filters are collected weekly and are analyzed for gross alpha and beta activity using a gas-flow proportional counter. Also, water vapor for tritium analysis is collected on silica-gel adsorbent material for processing by liquid scintillation analysis. In 2017, silica-gel samples were collected every two weeks.

4.3.1 Gross Alpha and Beta Airborne Activity

Particulate filter analytical results for gross alpha and beta airborne activity are reported in Table 4-3. Ambient air samples are collected weekly from site perimeter monitoring stations P2, P4, P7, and P9. Validated samples are those not rejected due to equipment malfunction or other factors (e.g., sample air volumes were not acceptable).

The annual average gross alpha and beta airborne activity levels for the four monitoring stations were 0.0013 and 0.0137 pCi/m³, respectively. Annual gross beta activity trends recorded at Station P7 are plotted in Figure 4-3. The results for this location are typical for the site and show seasonal variation in activity

Table 4-2. Gross Activity in Facility Air Particulate Filters.

Monitored Facility		Gross Alpha	Gross Beta
		(pCi/m ³)	
BLIP	N	52	52
	Max.	0.0023 ± 0.0008	0.0200 ± 0.0015
	Avg.	0.0005 ± 0.0004	0.0073 ± 0.0010
	MDL	0.0006*	0.0008*
TPL - Bldg. 801	N	52	52
	Max.	0.0028 ± 0.0008	0.0316 ± 0.0017
	Avg.	0.0008 ± 0.0005	0.0113 ± 0.0012
	MDL	0.0006*	0.0008*

Notes:
 See Figure 4-1 for monitored facility locations.
 All values shown with a 95% confidence interval.
 BLIP = Brookhaven Linac Isotope Producer
 MDL = Minimum Detection Limit
 N = Number of validated samples collected
 TPL = Target Processing Laboratory
 *Average MDL for all validated samples taken at this location

Table 4-3. Gross Activity Detected in Ambient Air Monitoring Particulate Filters.

Sample Station		Gross Alpha	Gross Beta
		(pCi/m ³)	
P2	N	51	51
	Max.	0.0030 ± 0.0009	0.0223 ± 0.0016
	Avg.	0.0014 ± 0.0006	0.0135 ± 0.0012
	MDL	0.0006*	0.0007*
P4	N	52	52
	Max.	0.0047 ± 0.0025	0.0398 ± 0.0053
	Avg.	0.0011 ± 0.0005	0.0129 ± 0.0011
	MDL	0.0006*	0.0007*
P7	N	51	51
	Max.	0.0034 ± 0.0008	0.0182 ± 0.0013
	Avg.	0.0011 ± 0.0005	0.0128 ± 0.0011
	MDL	0.0005*	0.0007*
P9	N	41	41
	Max.	0.0030 ± 0.0008	0.0200 ± 0.0016
	Avg.	0.0015 ± 0.0007	0.0162 ± 0.0015
	MDL	0.0007*	0.0009*
Grand Average		0.0013 ± 0.0006	0.0137 ± 0.0012

Notes:
 See Figure 4-2 for sample station locations.
 All values shown with a 95% confidence interval.
 MDL = minimum detection limit
 N = Number of validated samples collected
 *Average MDL for all validated samples taken at this location

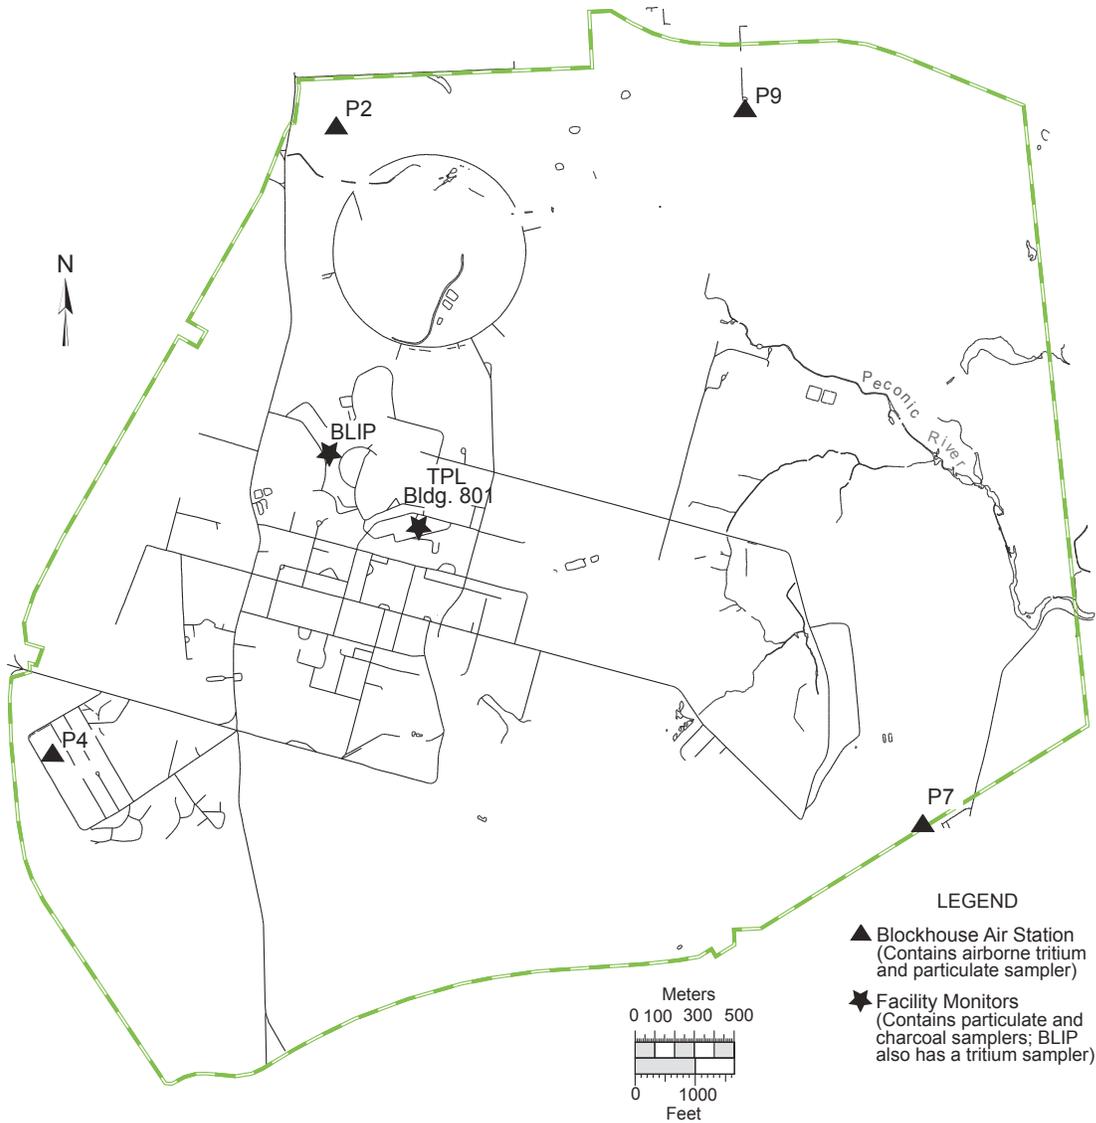


Figure 4-2. BNL On-Site Ambient Air Monitoring Stations.

within a range that is representative of natural background levels. The New York State Department of Health (NYSDOH) received duplicate filter samples that were collected at Station P7, using a sampler provided by NYSDOH. These samples were collected weekly and analyzed by the NYSDOH laboratory for gross beta activity. The analytical results were comparable to the Station P7 samples analyzed by General Engineering Lab, an analytical laboratory contracted by BNL. New York State's analytical results for gross beta activity at the Laboratory were

between 0.0009 and 0.0148 pCi/m³, with an average concentration of 0.0081 pCi/m³. BNL results ranged from 0.0057 to 0.0182 pCi/m³, with an average concentration of 0.0128 pCi/m³.

As part of a statewide monitoring program, NYSDOH also collects air samples in Albany, New York, a control location with no potential to be influenced by nuclear facility emissions. In 2017, NYSDOH reported that airborne gross beta activity at that location varied between 0.0026 and 0.0273 pCi/m³ and had an average concentration of 0.0113 pCi/m³. All sample

results measured at BNL fell within this range, demonstrating that on-site radiological air quality was consistent with that observed at locations in New York State not located near radiological facilities.

4.3.2 Airborne Tritium

Airborne tritium in the form of HTO (tritiated water) is monitored throughout the BNL site.

In 2017, tritium samples were collected from Stations P2, P4, P7, and P9 to assess the potential impacts from the Laboratory's two tritium sources. Table 4-4 lists the number of validated samples collected at each location, the maximum value observed, and the annual average concentration. Validated samples are those not rejected due to equipment malfunction or other factors (e.g., a battery failure in the sampler, frozen or supersaturated silica gel, insufficient sample volumes, or the loss of sample during preparation at the contract analytical laboratory). Airborne tritium samples were collected every two weeks from each sampling station during 2017; however, two samples could not be analyzed because the amount of moisture captured on the silica gel was insufficient for analysis. The average tritium concentrations at all the sampling locations were less than the typical minimum detection limits, which ranged from 4.0 to 12.6 pCi/m³.

4.4 NONRADIOLOGICAL AIRBORNE EMISSIONS

Various state and federal regulations governing nonradiological releases require facilities to conduct periodic or continuous emission monitoring to demonstrate compliance with emission limits. The Central Steam Facility (CSF) is the only BNL facility that requires monitoring for nonradiological emissions. The Laboratory has several other emission sources subject to state and federal regulatory requirements that do not require emission monitoring (see Chapter 3 for more details).


The CSF supplies steam for heating and cooling to major BNL facilities through an underground steam distribution and condensate grid. The location of the CSF is shown in Figure 4-1. The combustion units at the CSF are designated

as Boilers 1A, 5, 6, and 7. Boiler 1A, which was installed in 1962, has a heat input of 16.4 MW (56.7 million British thermal units [MMBtu] per hour). Boiler 5, installed in 1965, has a heat input of 65.3 MW (225 MMBtu/hr). The newest units, Boilers 6 and 7, were installed in 1984 and 1996, and each has a heat input of 42.6 MW (147 MMBtu/hr). For perspective, National Grid's Northport, New York, power station has four utility-sized turbine/generator boilers, each with a maximum rated heat input of 1,082 MW (3,695 MMBtu/hr).

Because the CSF boilers have the potential to emit more than 100 tons per year of oxides of nitrogen (NO_x), the CSF is considered a major facility, and all four of its boilers are subject to the Reasonably Available Control Technology (RACT) requirements of Title 6 of the New York Code, Rules, and Regulations (NYCRR) Subpart 227-2. Because of their design, heat inputs, and dates of installation, Boilers 6 and 7 are also subject to the Federal New Source Performance Standard (40 CFR 60 Subpart Db: Standards of Performance for Industrial-Commercial-Institutional Steam Boilers). Both boilers are equipped with continuous emission monitoring systems (CEMS) to show compliance with NO_x standards of Subpart 227-2 and Subpart Db, and with continuous opacity monitors to demonstrate compliance with Subpart Db opacity monitoring requirements. To measure combustion efficiency, the boilers are also monitored for carbon monoxide (CO). Continuous emission monitoring results from the two boilers are reported quarterly to EPA and the New York State Department of Environmental Conservation (NYSDEC).

On July 1, 2014, new Subpart 227-2 lower RACT for NO_x emissions became effective. The respective NO_x RACT emission limits of 0.20 lbs/MMBtu for the combustion of natural gas and 0.30 lbs/MMBtu for the combustion of No. 6 oil burned in the CSF three large boilers dropped to 0.15 lbs/MMBtu for both fuels. The NO_x RACT emission limit for the CSF's one mid-size boiler (Boiler 1A) dropped from 0.30 lbs/MMBtu to 0.20 lbs/MMBtu.

From May 1 to September 15 of each year, the peak ozone period, owners and operators of

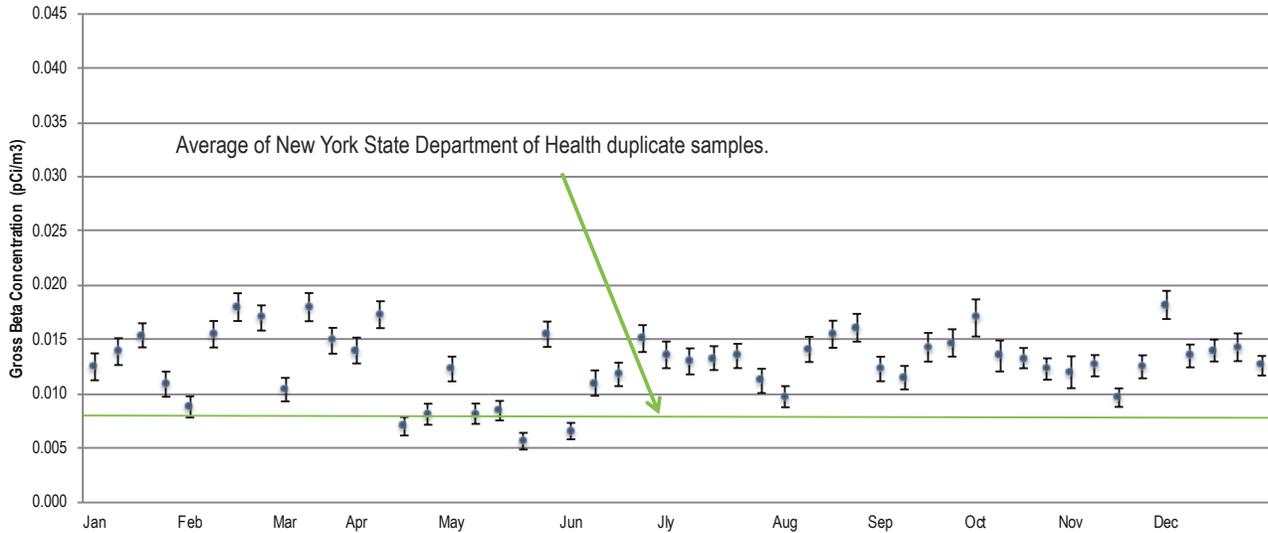

Note: All values are presented with a 95 percent confidence interval.

Figure 4-3. Airborne Gross Beta Concentration Trend Recorded at Station P7.

boilers equipped with CEMS must demonstrate compliance with Subpart 227-2 NO_x RACT limits by calculating the 24-hour average emission rate from CEMS readings and comparing the value to the emission limit. During the remainder of the year, the calculated 30-day rolling average emission rate is used to establish compliance. Owners and operators of boilers not equipped with CEMS must demonstrate compliance with NO_x RACT limits via periodic emissions testing. Following the end of each calendar quarter, facilities with boilers equipped with CEMS must tabulate and summarize applicable emissions, monitoring, and operating parameter measurements recorded during the preceding three months. Measured opacity levels can not exceed 20 percent opacity, except for one six-minute period per hour of not more than 27 percent opacity.

Because past emissions testing and CEMS results when No. 6 oil was burned have shown that all four CSF boilers cannot meet the new lower NO_x RACT standards, BNL is using an approved system averaging plan to demonstrate compliance in quarterly reports submitted to NYSDEC. This is accomplished with a NO_x ledger, where NO_x rate credits accumulated during quarterly periods when natural gas is burned at levels below the NO_x RACT limits

offset ledger debits that occur when any of the four boilers burn oil. The ledger must show that the actual NO_x weighted average emission rate of operating boilers is less than the Subpart 227-2 permissible NO_x weighted average rate for the quarter. The actual weighted average emission rates for operating boilers in the first, second, third, and fourth quarters, respectively, were 0.104, 0.102, 0.077, and 0.101 lbs/MMBtu, while the corresponding permissible weighted average emissions rates each quarter were 0.152, 0.150, 0.150, and 0.150 lbs/MMBtu.

In 2017, there were two Boiler 7 excess opacity measurements from unknown causes, five excess opacity readings due to a temporary failure of the Boiler 7 transmissometer blower, and a single excess opacity reading that occurred during scheduled quality assurance calibration error tests of the Boiler 7 opacity monitor. While there are no regulatory requirements to continuously monitor opacity for Boilers 1A and 5, surveillance monitoring of visible stack emissions is a condition of BNL's Title V operating permit. Daily observations of stack gases recorded by CSF personnel throughout the year showed no visible emissions on days when the boilers were operated.

To satisfy quality assurance requirements for the continuous emissions monitoring system

Table 4-4. Ambient Airborne Tritium Measurements in 2017.

Sample Station	Wind Sector	Validated Samples	Maximum ———— (pCi/m ³) ————	Average
P2	NNW	26	3.7 ± 3.3	0.3 ± 4.4
P4	WSW	26	6.9 ± 3.8	0.9 ± 3.8
P7	ESE	26	7.2 ± 7.2	0.2 ± 4.0
P9	NE	22	9.2 ± 14.7	0.2 ± 5.4
Grand Average				0.4 ± 4.4

Notes:

See Figure 4-2 for station locations.

Wind sector is the downwind direction of the sample station from the High Flux Beam Reactor (HFBR) stack.

All values reported with a 95% confidence interval.

Typical minimum detection limit for tritium is between 4.0 and 12.6 pCi/m³.

of the Laboratory's Title V operating permit, a relative accuracy test audit (RATA) of the Boilers 6 and 7 continuous emissions monitoring systems for NO_x and CO₂ was conducted in December 2017. The results of the RATA demonstrated that the Boiler 6 and 7 NO_x and CO₂ continuous emissions monitoring systems met RATA acceptance criteria, which are defined in 40 CFR 60, Appendix B, Specifications 2 and 3.

In 2017, residual fuel prices exceeded those of natural gas for most of the year. As a result, natural gas was used to supply 98.3 percent of the heating and cooling needs of BNL's major facilities. By comparison, in 2009, residual fuel satisfied 42.6 percent of the major facility heating and cooling needs. Consequently, 2017 emissions of particulates, NO_x, and sulfur dioxide (SO₂) were 6.7, 25.2, and 43.2 tons less than the respective totals for 2009, when No. 6 oil was used to supply a much higher percent of site heating and cooling needs. Table 4-5 shows fuel use and emissions since 2008.

4.5 GREENHOUSE GAS EMISSIONS

One of the overarching goals of Executive Order (EO) 13693, *Planning for Federal Sustainability in the Next Decade*, is for federal agencies to establish agency-wide greenhouse gas (GHG) reduction targets for their combined Scope 1 and 2 greenhouse gas emissions and for their Scope 3 greenhouse gas emissions (see Appendix A for definitions). DOE has set the following GHG emission reduction goals for fiscal year (FY) 2025: reduce Scope 1 and 2

GHG emissions by 50 percent relative to their FY 2008 baseline and reduce Scope 3 GHG emissions by 25 percent relative to their FY 2008 baseline. BNL includes these same goals in its annual Site Sustainability Plan (SSP), which is submitted to DOE in December of each year (BNL 2017). BNL's SSP identifies several actions that have or will be taken to help the Laboratory progress towards meeting the Scope 1 and 2 GHG emissions reduction goal.

In November 2011, the Long Island Solar Farm (LISF), a large array of more than 164,000 solar photovoltaic panels constructed on the BNL site began producing solar power. The LISF is expected to deliver an annual average of 44 million kilowatt-hours (kWh) per year of solar energy into the local utility grid over a 20-year period. In 2017, the LISF provided 49.6 million kilowatt-hours of solar energy to Long Island. This equates to a 32,109 metric tons CO₂ equivalents (MtCO₂e) GHG offset or reduction. Even though the power from the LISF is purchased by the local utility, the Laboratory receives GHG reduction credits by purchasing an equivalent amount of Renewable Energy Credits (RECs) each year. In March 2011, BNL began receiving 15 megawatts per hour of hydropower from the New York Power Authority. In 2017, BNL consumed 119,486 megawatts of hydropower, providing a net combined GHG reduction of 94,918 MtCO₂e from the LISF and hydropower. Furthermore, in 2016 BNL completed an expansion of the Northeast Solar Energy Research Center (NSERC). The NSERC is a solar photovoltaic facility that now has a capacity of 816 kW. In 2017, it provided 968,485 kWh and offset 544 MtCO₂e.

In October 2013, DOE awarded BNL a Utility Energy Service Contract (UESC). This project called for the implementation of energy savings measures to reduce Scope 1 and 2 GHG levels by approximately 7,000 MtCO₂e. In May of 2015, the Laboratory completed Phase I energy conservation measures that included:

- The installation of a 1,250-ton high-efficiency chiller to increase the efficiency of supplied chilled water;
- Upgraded lighting systems in 18 buildings;
- Enhanced building control upgrades, and additions to provide for heating, ventilation,

Table 4-5. Central Steam Facility Fuel Use and Emissions (2008–2017).

Annual Fuel Use and Fuel Heating Values							Emissions			
Year	No. 6 Oil (10 ³ gals)	Heating Value (MMBtu)	No. 2 Oil (10 ³ gals)	Heating Value (MMBtu)	Natural Gas (10 ⁶ ft ³)	Heating Value (MMBtu)	TSP (tons)	NO _x (tons)	SO ₂ (tons)	VOCs (tons)
2008	1,007.49	148,939	0.10	14	496.48	506,406	5.7	46.7	23.0	1.9
2009	1,904.32	283,734	0.00	0	375.03	382,529	9.0	53.4	44.9	2.1
2010	447.47	66,591	0.00	0	561.42	568,939	3.4	41.5	10.0	1.8
2011	31.49	4,726	0.01	2	657.06	668,564	2.6	30.4	0.9	1.8
2012	43.44	6,519	0.00	0	613.44	630,616	2.5	29.1	1.2	1.7
2013	117.21	17,590	0.00	0	631.95	649,645	2.9	30.7	2.9	1.8
2014	34.03	5,107	0.00	0	673.80	690,584	2.6	30.9	1.0	1.9
2015	9.66	1,449	0.00	0	619.98	638,209	2.4	30.3	0.4	1.7
2016	804.38	120,712	0.00	0	441.98	453,348	3.7	33.6	19.0	1.7
2017	65.07	9,765	0.00	0	564.96	579,559	2.3	28.2	1.7	1.6
Permit Limit (in tons)							113.3	159.0	445.0	39.7

Notes:

NO_x = oxides of nitrogenSO₂ = sulfur dioxide

TSP = total suspended particulates

VOCs = volatile organic compounds

and air conditioning temperature setbacks in nine buildings.

The UESC project has been a success, with annual energy savings within 3% of the original estimates for each of the three full years since completion. Other planned energy savings initiatives from Phase II UESC projects set to begin in FY 2018 will include additional lighting and building control upgrades, and chilled water storage improvements. BNL will periodically evaluate the potential to install a combined heat and power plant and will recommend going forward if a business case develops to make installation a viable alternative.

To meet the 2025 Scope 3 GHG emissions reduction goal, Scope 3 emissions must be lowered by 5,034 MtCO₂e from the FY 2008 baseline of 20,136 MtCO₂e. Overall, Scope 3 GHG emissions dropped by 6,323 MtCO₂e, down 27 percent from FY 2016, and 15.2 percent less than the FY 2008 baseline value of 20,136 MtCO₂e. GHG emissions from electrical transmission and distribution losses decreased 6,696 MtCO₂e, accounting for most of the drop. The reduction in GHG emissions from transmission and distribution losses was primarily due to a 42.7% drop in the e-Grid Distribution Loss Adjustment Factor, which declined from 9.09% in FY 2016 to 5.21% in FY 2017.

Unless projected drops in purchased electricity and transmission and distribution loss GHG emissions from the implementation of planned UESC Phase II energy conservation measures and construction of a combined heat and power plant are significant, BNL will need to focus its efforts on reducing GHG emissions from employee business air travel and employee commuting. Actions taken in 2017 that will help BNL to reduce GHG emissions from air travel and employee commuting and move forward in achieving the Scope 3 GHG reduction goal included:

- Efforts taken by the Information Technology Division to emphasize how video conferencing utilizing the Blue Jeans cloud base tool can be used for internal meetings and to collaborate with external associates; enabling employees to boost their productivity while also helping to reduce their travel time and costs to attend meetings and conferences.
- BNL's submission of a proposed alternative methodology to the DOE Sustainability Performance Office for estimating our commuting GHG emissions for their consideration and approval. The key to the alternative methodology is the use of a combination of emission factors to more accurately estimate GHG emissions from passenger cars and

light duty trucks that our employees are actually driving.

CH₄ and N₂O emission factors to be used are those established by ICF International on the basis of vehicle emissions tests to certify 2009 model year and later passenger cars and light duty trucks to meet EPA Tier 2 emission standards. The CO₂ emission factors to be used are based on fleet-wide emission targets for Model Years 2012-2016 and for Model Years 2017-2025 cars and light duty trucks established in joint rules to improve fuel economy and reduce greenhouse gas emissions passed by EPA and the National Highway Traffic Safety Administration on May 7, 2010 and October 15, 2012.

- BNL's participation in the Annual Car Free Day Long Island (LI) on September 22, 2017. In an effort to increase employee awareness and appreciation of the environmental, health, and economic benefits of sustainable means of transportation, employees were encouraged to make a pledge on the Car Free Day LI website to be car-free or car-lite on September 22 and commit to drive less by carpooling, biking, walking, or telecommuting. Sixty-three employees participated by making pledges to carpool, bike, walk, and telecommute to reduce their driving for one day.

REFERENCES AND BIBLIOGRAPHY

- 40 CFR 60 Subpart Db. Standards of Performance for Industrial-Commercial-Institutional Steam Boilers, 72 FR 32742, Jun. 13, 2007, as amended by 79 FR11249, February 27, 2014.
- 40 CFR 61 Subpart H. National Emission Standards for Emissions of Radionuclides Other Than Radon from Department of Energy Facilities. 54 FR 51695, Dec. 15, 1989, as amended by 67 FR 57166, September 9, 2002.
- BNL 2013, Long-Term Surveillance and Maintenance Manual for the High Flux Beam Facility, Brookhaven National Laboratory, Upton, NY. (Rev. 4) September 2013.
- BNL, 2017. FY18 Site Sustainability Plan Brookhaven National Laboratory, December 13, 2017.
- DOE 2011. DOE Order 458.1. Radiation Protection of the Public and the Environment. U.S. Department of Energy, Washington, DC. Admin Chg. 3, January 15, 2013.
- NYCRR Subpart 227-2, Title 6. Reasonably Available Control Technology for Oxides of Nitrogen. New York State Department of Environmental Conservation, Albany, NY., Amended September 24, 2014.
- Executive Order 13693, 2015. Planning for Federal Sustainability in the Next Decade. US Federal Register, March 25, 2015.
- Shlein, Bernard, et al., (eds). 1998. Handbook of Health Physics and Radiological Health, Third Edition. Williams and Wilkins, Baltimore, MD.
- USC Title 42, Chapter 85. Air Pollution Prevention and Control (Clean Air Act), 1990.