


Figure 3.2.1-8
Cumulative Carbon Tetrachloride Mass Removed
OU III Carbon Tetrachloride Groundwater Remediation System
2002 BNL Groundwater Status Report

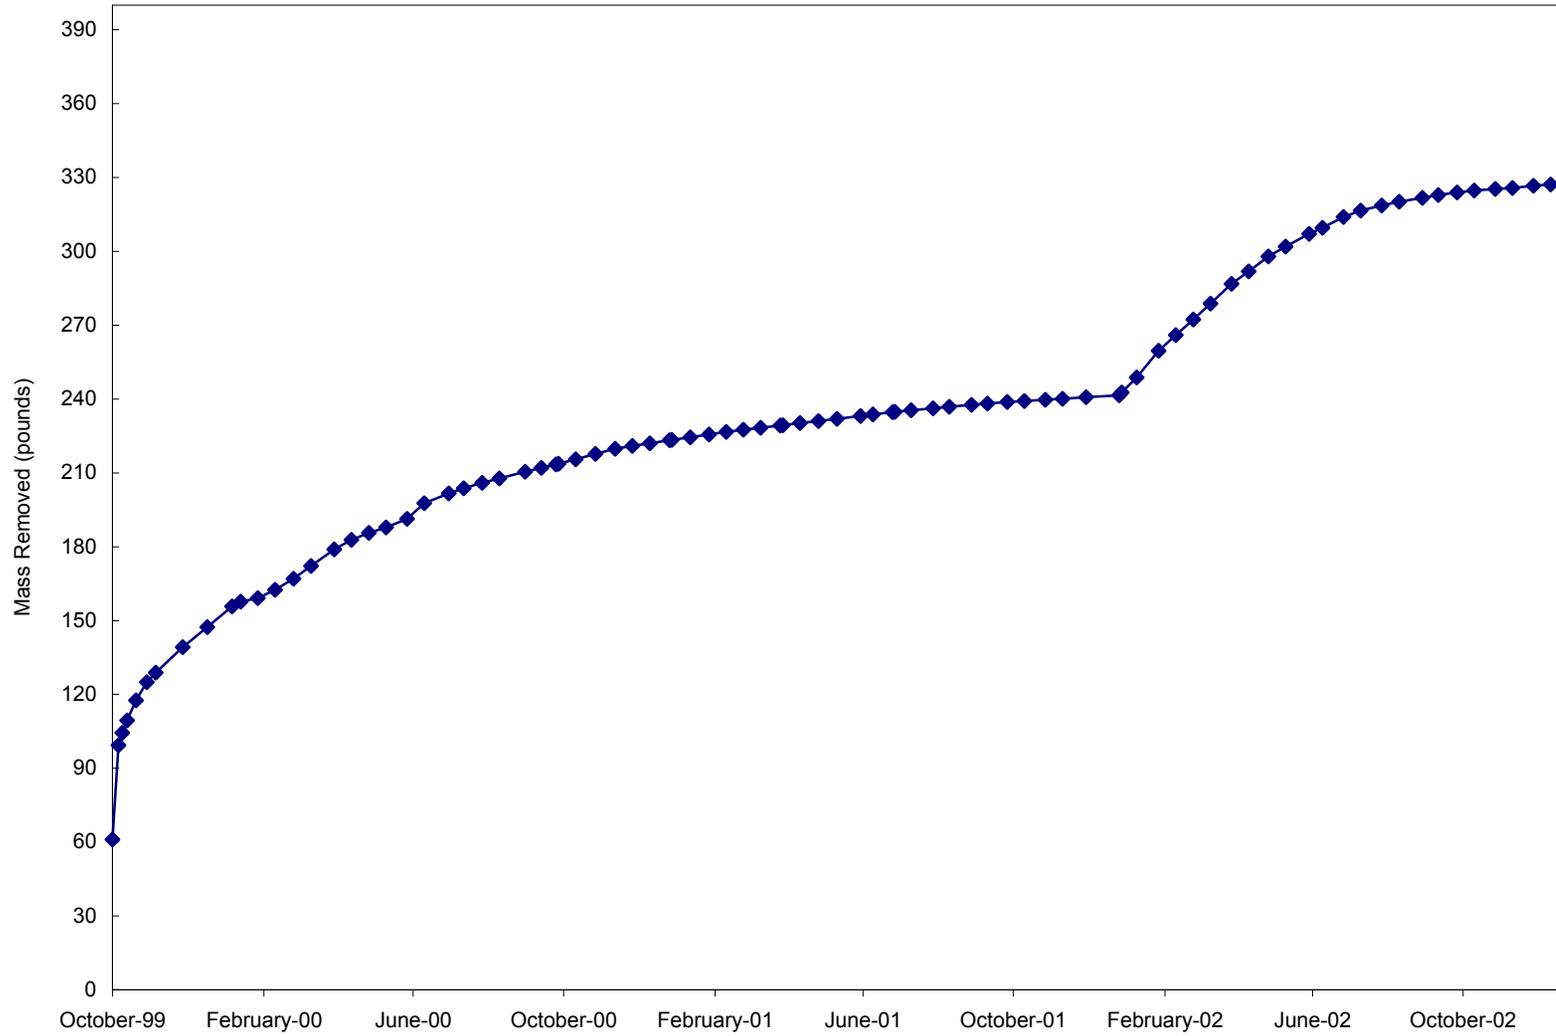

Note: Approximately 60 pounds of carbon tetrachloride were removed from the pump out of well 085-98 in January 1999. The treatment system began operation in October 1999.