

Groundwater Remediation Systems Quarterly Operations Report

January 1, 2022 through March 31, 2022

Brookhaven National Laboratory Upton, Long Island, New York

Prepared by:

Brookhaven National Laboratory Environmental Protection Division

Upton, N.Y. 11973

Prepared for:

U.S. Department of Energy Brookhaven Site Office

August 2022



ALTERATION OF THIS DOCUMENT EXCEPT BY A LICENSED PROFESSIONAL IS PROHIBITED



Groundwater Remediation Systems Quarterly Operations Report

January 1, 2022 through March 31, 2022

Brookhaven National Laboratory Upton, Long Island, New York

Prepared by:

Brookhaven National Laboratory Environmental Protection Division

Upton, N.Y. 11973

Prepared for:

U.S. Department of Energy Brookhaven Site Office

August 2022

1st Quarter Groundwater Remediation System Operations Report January 1, 2022 through March 31, 2022 Brookhaven National Laboratory Upton, Long Island, New York

Table of Contents

1.	Overview 1-1
2.	OU I South Boundary Pump and Treat System (System Closed)2-1
3.	OU III South Boundary Pump and Treat System
4.	OU III Middle Road Pump and Treat System4-1
5.	OU III Industrial Park In-Well Air Stripping, and Pump and Treat Systems 5-1
6.	OU III Carbon Tetrachloride Pump and Treat System (System Closed)6-1
7.	OU III Building 96 Groundwater Remediation System
8.	OU IV Air Sparge / Soil Vapor Extraction System (System Closed) 8-1
9.	OU VI Ethylene Dibromide Pump and Treat System9-1
10.	OU III HFBR Tritium Pump and Recharge System (System Closed) 10-1
11.	OU III Western South Boundary Pump and Treat System
12.	OU III Chemical Holes Strontium-90 Pump and Treat System
13.	OU III Industrial Park East Pump and Treat System (System Closed)
14.	OU III North Street Pump and Treat System (System Closed)
15.	OU III North Street East Pump and Treat System
16.	OU III LIPA/Airport Pump and Treat System
17.	OU III BGRR/WCF Strontium-90 Pump and Treat System
18.	g-2 Tritium Plume and Source Area
19.	BLIP Source Area
20.	OU III Building 452 Freon-11 Pump and Treat System (System Closed) 20-1

Section 1

System Operations Overview 1st Quarter 2022

		<i>Table 1 − S</i>	ummary of C	<i>perations</i>		
Operable Unit System	Type	Target Contaminant	Number of Wells	Years of Operation	Run Time For Quarter (%)	Pounds VOCS Removed (Quarter/Cum)
			Operable	Unit I	•	
South Boundary	Pump and Treat (AS)	VOC	2	Operate- 16 Standby- 9	Closure Approved 9/19	0 369
			Operable U	J nit III		
South Boundary	Pump and Treat (AS)	VOC	8	25	92%PP	1.2 3,071
HFBR Pump and Recharge	Pump and Recirculate	Tritium	4	Operate- 9 Standby- 16	Closure Approved 3/19	NA 180
Industrial Park	Recirculation/ In-Well (AS/Carbon)/ Pump and Treat	VOC	7	Operate- 16 Standby- 7	Standby	0 1066 0
	(Carbon)	VOC	2	Operate- 4 Standby-3	Standby	10
Building 96	Recirculation Well (AS/Carbon)	VOC	4	Operate- 18 Standby- 3	100%	0.2 146
Middle Road	Pump and Treat (AS)	VOC	7	21	98%	6.9 1338
Western South Boundary	Pump and Treat (AS)	VOC	6	20	98%	4.9 186
North Street	Pump and Treat (Carbon)	VOC	2	Operate – 11 Standby - 7	Closure Approved 3/20	NA 342
North Street East	Pump and Treat (Carbon)	VOC/EDB	4	Operate – 12 Standby - 6	99%	0.5 47
LIPA/Airport	Pump and Treat (Carbon)	VOC	10	18	100%	1.6 497
Industrial Park East	Pump and Treat (Carbon)	VOC	2	Operate- 5 Standby- 4	Dismantled 2013	NA 38
Chemical Holes	Pump and Treat (IE)	Sr-90	3	Operate - 15 Standby- 4	Standby	NA
BGRR/WCF	Pump and Treat (IE)	Sr-90	9	17	100% PP	NA
Freon	Pump and Treat (AS)	Freon-11	1	Operate – 4 Standby – 4	Closure Approved 9/19	0 106
			Operable l			
EDB	Pump and Treat (Carbon)	EDB	2	18	100%	NA*
$\Lambda S = air$	stripping			NA = not applic	able	

AS = air stripping

IE = ion exchange

EDB = ethylene dibromide

NA = not applicable

PP = system is pulse pumping

^{*} EDB has only been detected in the influent at trace levels, just above standard, therefore no removal is reported.

Section 2

Q1-2022 Operations Summary OU I/RA V South Boundary Pump & Treat System (System Closed)

Process: Groundwater extraction and air stripping treatment, with discharge to the

RA V recharge basin

Goal: Reach Maximum Contaminant Levels (MCLs) in core monitoring wells

within 30 years for the Upper Glacial aquifer (by 2030). The Petition for Closure of the OU I South Boundary Groundwater Treatment System was

approved by the regulators in September 2019.

Note: Current Landfill monitoring well data is included in the attached data tables since this is one of the sources of the OU I/RA V plume.

Start Date: January 1997



Table 2-1
OU I South Boundary Pump & Treat System
Pumping Rates (gpm)

Extraction Well	EW-1*	EW-2*			
Site ID #	115-27	115-43			
Screen Interval (ft bls)	150-190	104-124/134-154			
Desired Rate (GPM)	0	0			
January	Off	Off			
February	Off	Off			
March	Off	Off			
Actual (Avg. over Qtr.)	Off	Off			

^{*} The system was shut down and approved for closure in September 2019.

Figure 2-1 OU I South Boundary Pump & Treat System Cumulative Mass Removal VOCs vs. Time

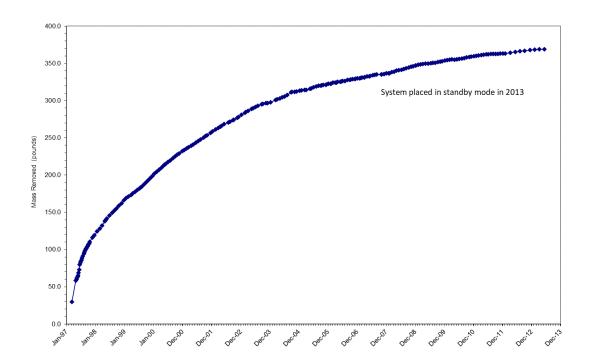


Figure 2-2
OU I South Boundary Pump & Treat System
Influent TVOC Concentrations vs. Time

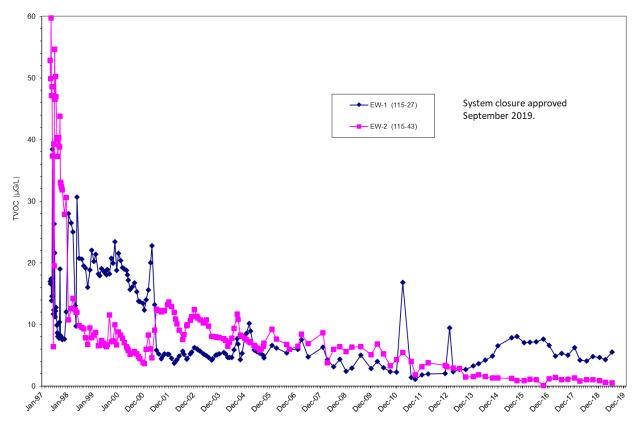


Table 2-2
Effluent Water Quality
SPDES Equivalency Permit Concentrations January 1 through March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	Monitor	NA ¹	GPD	Continuous
pH (range)	6.0- 9.0	NA ¹	SU	Weekly
Benzene	0.8	NA ¹	ug/L	Monthly
Chloroform	7.0	NA ¹	ug/L	Monthly
Chloroethane	5.0	NA ¹	ug/L	Monthly
1,2-Dichloroethane	5.0	NA ¹	ug/L	Monthly
1,1-Dichloroethene	5.0	NA ¹	ug/L	Monthly
1,1,1-Trichloroethane	5.0	NA ¹	ug/L	Monthly
Carbon Tetrachloride	5.0	NA ¹	ug/L	Quarterly
1,2-Dichloropropane	5.0	NA ¹	ug/L	Quarterly
Methylene Chloride	5.0	NA ¹	ug/L	Quarterly
Trichloroethylene	5.0	NA ¹	ug/L	Quarterly
Vinyl Chloride	2.0	NA ¹	ug/L	Quarterly
1,2-Xylene	5.0	NA 1	ug/L	Quarterly
Sum of 1,3 and 1,4-Xylenes	10.0	NA ¹	ug/L	Quarterly

¹ The system is closed.

System Operations


January through March 2022:

The system remained closed.

As a follow-up to temporary wells installed in 2018, four additional temporary wells were installed in the first quarter of 2022 as part of an effort to track the migration of Sr-90 from the former HWMF. The maximum Sr-90 concentration in the four temporary wells was 95 pCi/L in GP-71. The temporary well locations are shown on **Figure 2-4** and the data is presented and discussed in greater detail in the 2021 Groundwater Status Report.

Planned Operational Changes

• Maintain the VOC post-closure groundwater monitoring program of an annual sample collection from post-closure wells: 107-40, 107-41, 115-13, 115-16, and 115-51. Maintain quarterly sampling of Current Landfill well 088-109 and sentinel well 098-99.

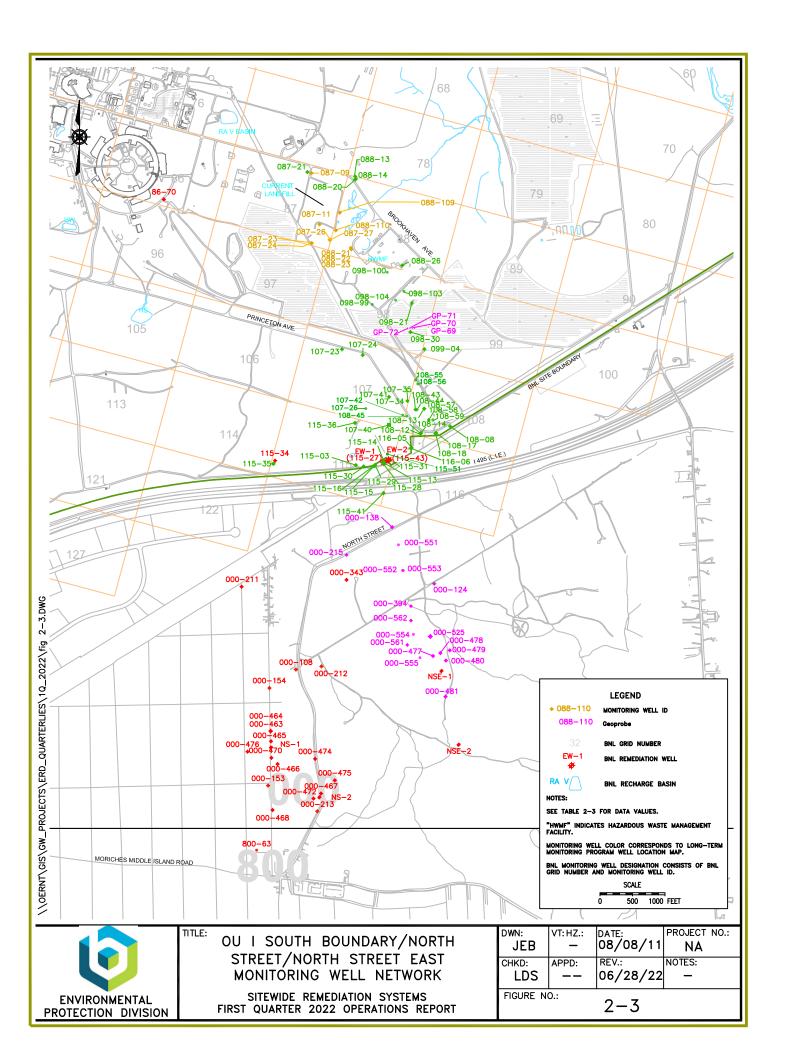

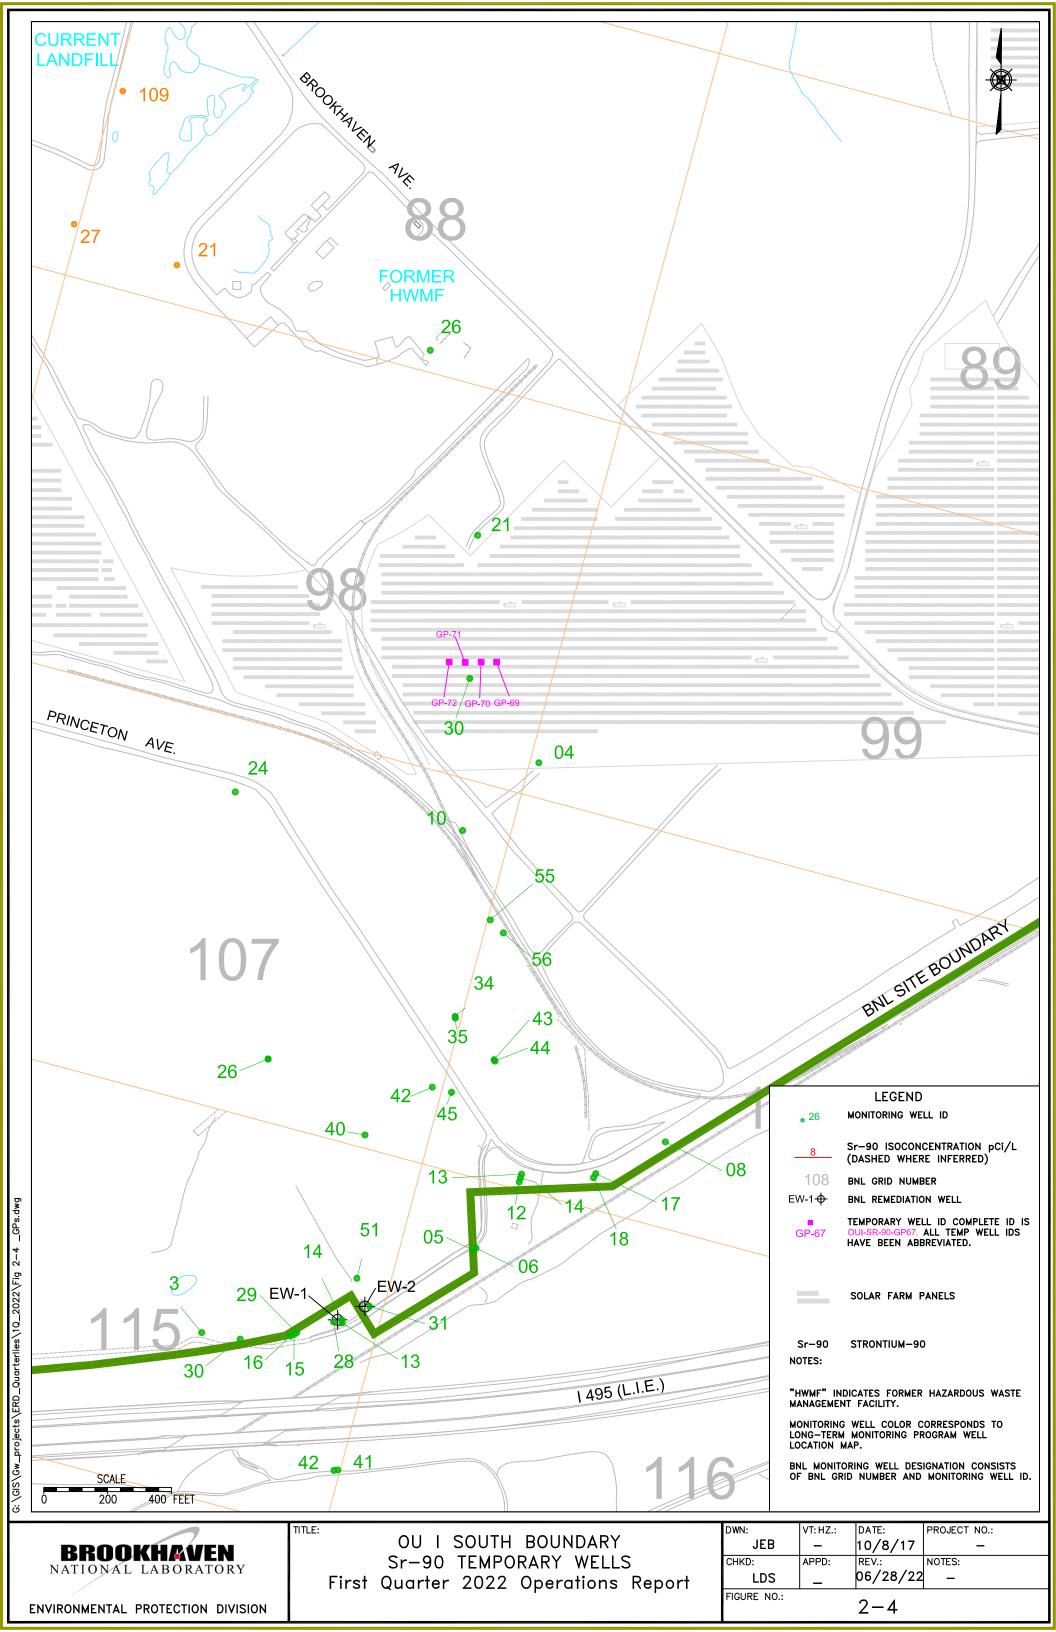


Table 2-3
OU I RA V South Boundary - Current Landfill Monitoring Well Data - Current Landfill
'Hits Only' January through March 2022

Site ID: 088-109

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/20/2022	6.31			UG/L	13.50	35	66
1,1-Dichloroethane	01/20/2022	1.6	0.5		UG/L	13.50		S.
Chloroethane	01/20/2022	3.97	0.5		UG/L	13.50		
Methylene chloride	01/20/2022	0.74	0.5		UG/L	13.50	J	

Site ID: 098-99

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/20/2022	3.54			UG/L	44.50	20	
1,1-Dichloroethane	01/20/2022	2.72	0.5		UG/L	44.50		
Methylene chloride	01/20/2022	0.82	0.5		UG/L	44.50	J	

Table 2-3 OU I RA V South Boundary Monitoring Well Data 'Hits Only' January through March 2022

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/20/2022	6.31			UG/L	13.50		
1,1-Dichloroethane	01/20/2022	1.6	0.5		UG/L	13.50	100	
Chloroethane	01/20/2022	3.97	0.5		UG/L	13.50		.5
Methylene chloride	01/20/2022	0.74	0.5		UG/L	13.50	J	3
Site ID: 088-26								
Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	03/11/2022	2.77	0.932	0.604	PCI/L	25.00	Quai	Quai
Site ID: 098-100		200 1000 1000 100						25
C.D	190 15110.00	U.S.	e a statiant				Lab	Review
Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Qual	Qual
Strontium-90	03/11/2022	59.7	0.929	1.43	PCI/L	17.50		No.
Site ID: 098-103	900	gy 0		200		100	<u></u>	
Chemical	Sample Date	Value	Det. Limit	Error	Units	Danth	Lab Qual	Review Qual
Strontium-90	03/11/2022	28.9	0.667	0.933	PCI/L	20.00	Quai	Quai
Site ID: 098-104	,,		,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,				ı	
Site ID : 098-104							Lab	Review
Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Qual	Qual
Strontium-90	03/11/2022	290	0.647	2.59	PCI/L	20.00		- K
Site ID: 098-99	1000			-				
Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/20/2022	3.54			UG/L	44.50		
1,1-Dichloroethane	01/20/2022	2.72	0.5		UG/L	44.50		8
Methylene chloride	01/20/2022	0.82	0.5		UG/L	44.50	J	
Site ID: 107-34								
Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	03/09/2022	1.83	0.463	0.338	PCI/L	55.00	Quui	quui
Site ID: 107-42	•		VIII 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1					
9975000		73,144					Lab	Review
Chemical Strontium-90	03/09/2022	Value 1.07	Det. Limit 0.775	Error 0.479	Units PCI/L	Depth 68.00	Qual	Qual
	03/03/2022	1.07	0.775	0.479	PCI/L	00.00	L	
Site ID: 108-43							Lab	Review
Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Qual	Qual
Strontium-90	03/07/2022	3.82	1.07	0.724	PCI/L	65.00		
Site ID: 108-45								
							Lab	Review
Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Qual	Qual

03/07/2022

Strontium-90

0.736

1.55

0.481

PCI/L

69.50

Table 2-3 OU I RA V South Boundary Monitoring Well Data

'Hits Only' January through March 2022

Site ID: 115-51

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	03/09/2022	2.57	0.519	0.386	PCI/L	140.00	,	N.

Qualifiers:

J = Estimated value.

D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 3

Q1-2022 Operations Summary OU III South Boundary Pump and Treat System

Process: Groundwater extraction and air stripping treatment, with discharge to both the OU III

and RAV recharge basins.

Goal: Reach Maximum Contaminant Levels (MCLs) in core monitoring wells in OU III

within 30 years for the Upper Glacial aquifer (by 2030).

Start Date: June 1997



Table 3-1
OU III South Boundary
Pumping Rates (gpm)

			1 0	(OI	,			
Extraction Well	EW-3	EW-4	EW-5	EW-6	EW-7	EW-8	EW-12	EW-17
Site ID	121-17	121-16	121-15	122-14	122-13	122-12	122-30	121-46
Screen Interval (ft bls)	150- 190	160-180 &190-200	160-200	160-200	170- 210	190-210 & 230-250	180-220	207-237
Desired Flow Rate (gpm)	0*	0*	0*	0*	0*	0*	0*	150
January (Avg monthly gpm)	0	0	0	0	0	0	0	105
February " "	0	0	0	0	0	0	0	108
March " "	0	0	0	0	0	0	0	130
Actual (Avg. over Qtr)	0	0	0	0	0	0	0	114

^{*} Extraction wells placed in standby mode: EW-12 (2003), EW-8 (2006), EW-6 (2007), EW-7 (2007), EW-3, EW-5 (2015) and EW-4 (2021).

Figure 3-1
OU III South Boundary
Cumulative Mass Removal of VOC's vs. Time


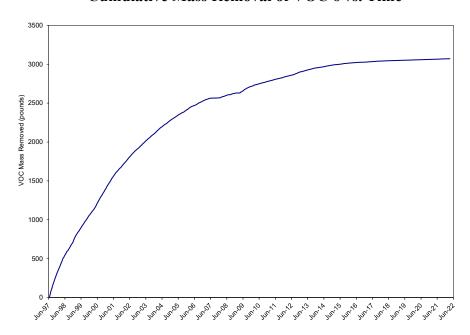


Figure 3-2
OU III South Boundary
Influent TVOC Concentration vs. Time

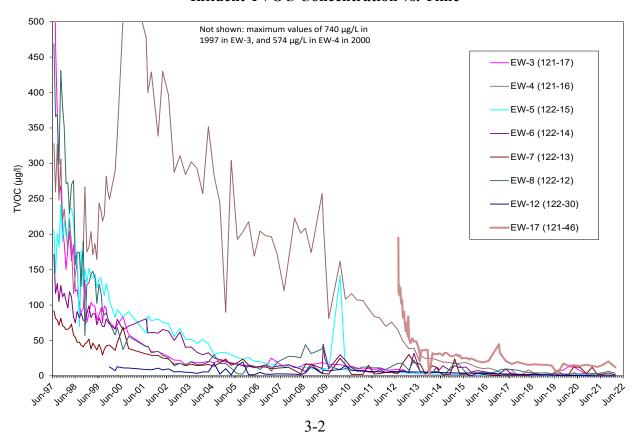

X:\GW Quarterly Report\2022 Reports\1st Quarter\3 OU III South Bound Milligan\1st Q OUIII SB 2022.doc

Table 3-2
OU III South Boundary Effluent Water Quality
SPDES Equivalency Permit Concentrations January 1 through March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	Monitor	1,471,256 ¹	GPD	Continuous
pH (range)	6.5 - 8.5	6.7- 7.2 ²	SU	Monthly ³
Carbon Tetrachloride	5	<0.50	ug/L	Monthly ³
Chloroform	7	<0.50	ug/L	Monthly ³
Dichlorodifluoromethane	5	<0.50	ug/L	Monthly ³
1,1-Dichloroethane	5	<0.50	ug/L	Monthly ³
1,1-Dichloroethylene	5	<0.50	ug/L	Monthly ³
Methyl Chloride	5	<0.50	ug/L	Monthly ³
Tetrachloroethylene	5	<0.50	ug/L	Monthly ³
Toluene	5	<0.50	ug/L	Monthly ³
1,1,1-Trichloroethane	5	<0.50	ug/L	Monthly ³
1,1,2 Trichloroethane	5	<0.50	ug/L	Monthly ³
Trichloroethylene	10	<0.50	ug/L	Monthly ³

¹ = The maximum monthly average flow rate for both the OU III South Boundary, Middle Road, and Western South Boundary Systems, during the operational period.

System Operations

January 2022:

The system operated normally for the month. Extraction well EW-17 was in full-time operation. Wells EW-3, EW-4, EW-5, EW-6, EW-7, EW-8 and EW-12 remained in standby mode. The effluent sample was taken from OU III Middle Road air stripping tower. The system treated approximately 4.7 million gallons of water.

February 2022:

The system operated normally for the month apart from the wet well transfer pumps being turned

² = The minimum and maximum pH values during the operational period.

³ = Beginning in April 2003, a SPDES modification was approved revising the pH and volatile organic sampling to once a month.

off for the relocation of the transfer pipe around newly constructed Building 557. Extraction well EW-17 was in full-time operation. Wells EW-3, EW-4, EW-5, EW-6, EW-7, EW-8 and EW-12 remained in standby mode. The effluent sample was taken from OU III Middle Road air stripping tower. The system treated approximately 4.8 million gallons of water.

March 2022:

The system operated normally for the month. Extraction well EW-17 was in full time operation. Wells EW-3, EW-4, EW-5, EW-6, EW-7, EW-8 and EW-12 remained in standby mode. The effluent sample was taken from OU III Middle Road air stripping tower. The system treated approximately 5.8 million gallons of water.

The system treated approximately 15.3 million gallons of water during the first quarter of 2022.

Planned Operational Changes

- Maintain wells EW-3, EW-4, EW-5, EW-6, EW-7, EW-8, and EW-12 in standby mode. The system's extraction wells will continue to be sampled on a quarterly basis. The wells will be restarted if extraction or monitoring well data indicate TVOC concentrations exceed the 50 μg/L capture goal. During the first quarter, TVOC concentrations in extraction wells EW-3, EW-4 EW-5, EW-6, EW-7, and EW-8 and adjacent monitoring wells were less than 50 μg/L.
- Continue to operate well EW-17 on a full-time basis. During the first quarter, TVOC concentrations in extraction well EW-17 were less than 50 μg/L. TVOC concentrations in monitoring well 121-49, located upgradient of and at the same depth as EW-17, have remained below 50 μg/L for the last two quarters with a maximum concentration of 19 μg/L in the first quarter 2022.
- Perform groundwater modeling simulations to help evaluate the best location, extraction rates, and number of extraction wells to optimize the system and achieve cleanup goals.

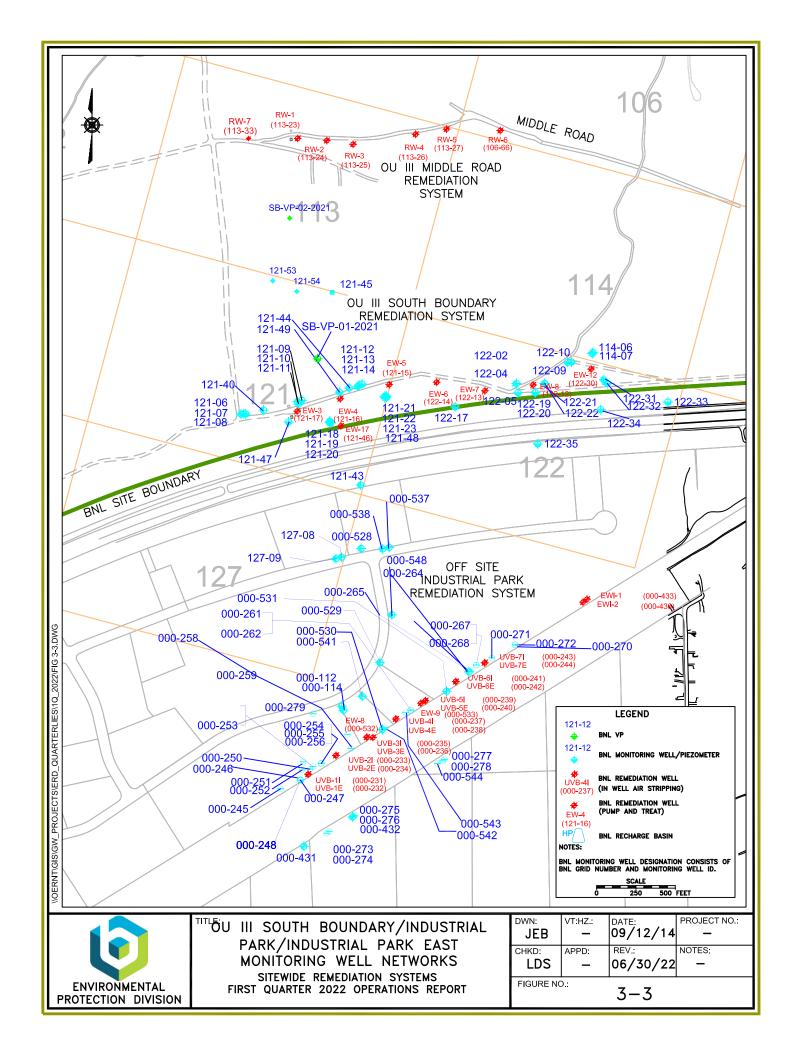


Table 3-3 OU III South Boundary Monitoring Well Data 'Hits Only' January through March 2022

Site ID: 121-49

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	18.68	(72-0)		UG/L	215.00		
Carbon tetrachloride	01/26/2022	0.68	0.5	7 <u>-4</u>	UG/L	215.00		
Tetrachloroethylene	01/26/2022	18	0.5		UG/L	215.00		

Site ID: 121-53

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	145.61			UG/L	229.00		
1,1,1-Trichloroethane	01/26/2022	2.1	0.5		UG/L	229.00		
1,1-Dichloroethane	01/26/2022	0.24	0.5		UG/L	229.00	J	
1,1-Dichloroethylene	01/26/2022	2.2	0.5		UG/L	229.00		
Carbon tetrachloride	01/26/2022	16	0.5		UG/L	229.00		
Chloroform	01/26/2022	1.8	0.5		UG/L	229.00		
Dichlorodifluoromethane	01/26/2022	0.87	2	127	UG/L	229.00	J D	
Tetrachloroethylene	01/26/2022	120	2		UG/L	229.00	D	
Trichloroethylene	01/26/2022	2.4	0.5		UG/L	229.00		8

Site ID: 121-54

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	90.28	10550	177	UG/L	220.00		
1,1,1-Trichloroethane	01/26/2022	0.28	0.5		UG/L	220.00	J	
Carbon tetrachloride	01/26/2022	18	0.5		UG/L	220.00		
Chloroform	01/26/2022	0.34	0.5		UG/L	220.00	J	9
Tetrachloroethylene	01/26/2022	71	2	.77	UG/L	220.00	D	
Trichloroethylene	01/26/2022	0.66	0.5		UG/L	220.00		

Table 3-4 OU III South Boundary Extraction Well Data 'Hits Only' January through March 2022

Site ID: 121-16 (EW-4)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	0.55	-	-	UG/L	0.00	36	
Tetrachloroethylene	01/25/2022	0.55	0.5		UG/L	0.00	50	

Site ID: 121-46 (EW-17)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	12.19	-		UG/L	0.00	100	
Carbon tetrachloride	01/25/2022	1.9	0.5		UG/L	0.00	. 10	
Chloroform	01/25/2022	0.29	0.5		UG/L	0.00	J	8
Tetrachloroethylene	01/25/2022	10	0.5	776	UG/L	0.00		2.

Site ID: 122-12 (EW-8)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	3.73			UG/L	0.00		
Methylene chloride	01/25/2022	0.43	0.5		UG/L	0.00	J	99
Tetrachloroethylene	01/25/2022	3.3	0.5		UG/L	0.00	1	

Site ID: 122-13 (EW-7)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	1.34	/		UG/L	0.00		3
Dichlorodifluoromethane	01/25/2022	0.35	0.5		UG/L	0.00	J	96
Tetrachloroethylene	01/25/2022	0.99	0.5	-	UG/L	0.00		

Table 3-5 OU III South Boundary Influent Data 'Hits Only' January through March 2022

Site ID: 121-41 (System Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	3.83			UG/L	0.00		
Carbon tetrachloride	01/25/2022	0.33	0.5		UG/L	0.00	J	20
Tetrachloroethylene	01/25/2022	3.5	0.5		UG/L	0.00		
8260 TVOC	02/09/2022	12.27			UG/L	0.00		
Carbon tetrachloride	02/09/2022	2	0.5		UG/L	0.00		Sec.
Chloroform	02/09/2022	0.27	0.5		UG/L	0.00	J	88
Tetrachloroethylene	02/09/2022	10	0.5		UG/L	0.00	5.5	
8260 TVOC	03/12/2022	13.76			UG/L	0.00		
1,1,1-Trichloroethane	03/12/2022	0.38	0.5		UG/L	0.00	J	20
1,1-Dichloroethylene	03/12/2022	0.42	0.5		UG/L	0.00	J	
Carbon tetrachloride	03/12/2022	2	0.5		UG/L	0.00	53	3
Chloroform	03/12/2022	0.62	0.5		UG/L	0.00		**
Tetrachloroethylene	03/12/2022	10	0.5		UG/L	0.00		20
Trichloroethylene	03/12/2022	0.34	0.5		UG/L	0.00	J	

Qualifiers:

- J = Estimated value.
- D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 4

Q1-2022 Operations Summary OU III Middle Road Pump and Treat System

Process: Groundwater extraction and air stripping treatment, with discharge to both

the OU III and RAV recharge basins.

Goal: Reach Maximum Contaminant Levels (MCLs) in core monitoring wells in

OU III within 30 years for the Upper Glacial aquifer (by 2030).

Start Date: October 23, 2001



Table 4-1 OU III Middle Road Pumping Rates (gpm)

Extraction Well	RW-1	RW-2	RW-3	RW-4	RW-5	RW-6	RW-7
Site ID#	113-23	113-24	113-25	113-26	113-27	106-66	113-33
Screen Interval (ft bls)	90-130	170-200	228-268	150-180	150-180	188-218	202-222
Desired Flow Rate (gpm)	0*	150	125	0*	0*	0*	125
January (Avg monthly gpm)	0	108	102	0	0	0	99
February " " "	0	116	109	0	0	0	114
March " " "	0	126	128	0	0	0	131
Actual (Avg. over Qtr.)	0	117	113	0	0	0	115

^{*} Extraction wells placed in standby mode: RW-4 and RW-5 (2003), RW-6 (2006), and RW-1 (2015).

Figure 4-1
OU III Middle Road
Cumulative Mass Removal of VOC's vs. Time

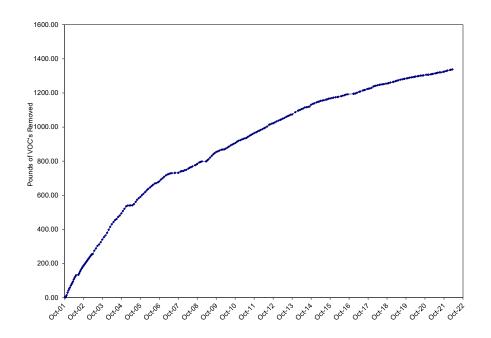


Figure 4-2 OU III Middle Road Influent TVOC Concentrations vs. Time

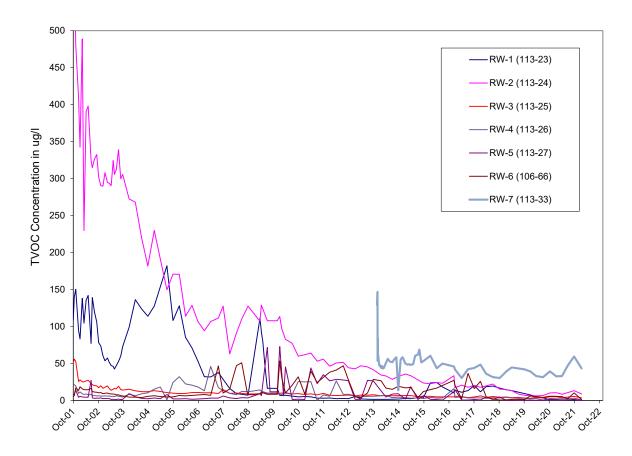


Table 4-2
OU III Middle Road Effluent Water Quality
SPDES Equivalency Permit Concentrations January 1, 2022 – March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	Monitor	1,471,2561	GPD	Continuous
pH (range)	6.5 - 8.5	6.7-7.2 ²	SU	Monthly ³
Carbon Tetrachloride	5	<0.05	ug/L	Monthly ³
Chloroform	7	<0.05	ug/L	Monthly ³
Dichlorodifluoromethane	5	<0.66	ug/L	Monthly ³
1,1-Dichloroethane	5	<0.05	ug/L	Monthly ³
1,1-Dichloroethylene	5	<0.05	ug/L	Monthly ³
Methyl Chloride	5	<0.05	ug/L	Monthly ³
Tetrachloroethylene	5	<0.05	ug/L	Monthly ³
Toluene	5	<0.05	ug/L	Monthly ³
1,1,1-Trichloroethane	5	<0.05	ug/L	Monthly ³
1,1,2 Trichloroethane	5	<0.05	ug/L	Monthly ³
Trichloroethylene	10	<0.05	ug/L	Monthly ³

¹ The maximum monthly average flow for the OU III Middle Road, South Boundary, and Western South Boundary Systems during the operational period.

System Operations

January 2022:

The system operated normally for the month. Extraction wells RW-2, RW-3, and RW-7 were in full-time operation. Wells RW-1, RW-4, RW-5 and RW-6 remained in standby mode. The effluent sample was taken from OU III Middle Road air stripping tower. The system treated approximately 14 million gallons of water.

² The minimum and maximum pH values during the operational period.

³ Beginning in April 2003, a SPDES modification was approved revising the pH and volatile organic sampling to once a month.

February 2022:

The system operated normally for the month. Extraction wells RW-2, RW-3, and RW-7 were in full-time operation. Wells RW-1, RW-4, RW-5 and RW-6 remained in standby mode. The effluent sample was taken from OU III Middle Road air stripping tower. The system treated approximately 15 million gallons of water.


March 2022:

The system operated normally for the month. Extraction wells RW-2, RW-3, and RW-7 were in full-time operation. Wells RW-1, RW-4, RW-5 and RW-6 remained in standby mode. The effluent sample was taken from OU III Middle Road air stripping tower. The system treated approximately 17 million gallons of water.

The system treated approximately 46 million gallons of water during the first quarter of 2022.

Planned Operational Changes

- Continue operation of extraction wells RW-2, RW-3 and RW-7, and maintain RW-1, RW-4, RW-5 and RW-6 in standby mode. Restart the well(s) if extraction or monitoring well data indicate that TVOC concentrations exceed the 50 μg/L capture goal. TVOC concentrations in extraction wells RW-1, RW-4, RW-5 and RW-6 and adjacent monitoring wells were below 50 μg/L in the first quarter.
- Perform groundwater modeling simulations to help evaluate the best location, extraction rates, and number of extraction wells to optimize the system and achieve cleanup goals.

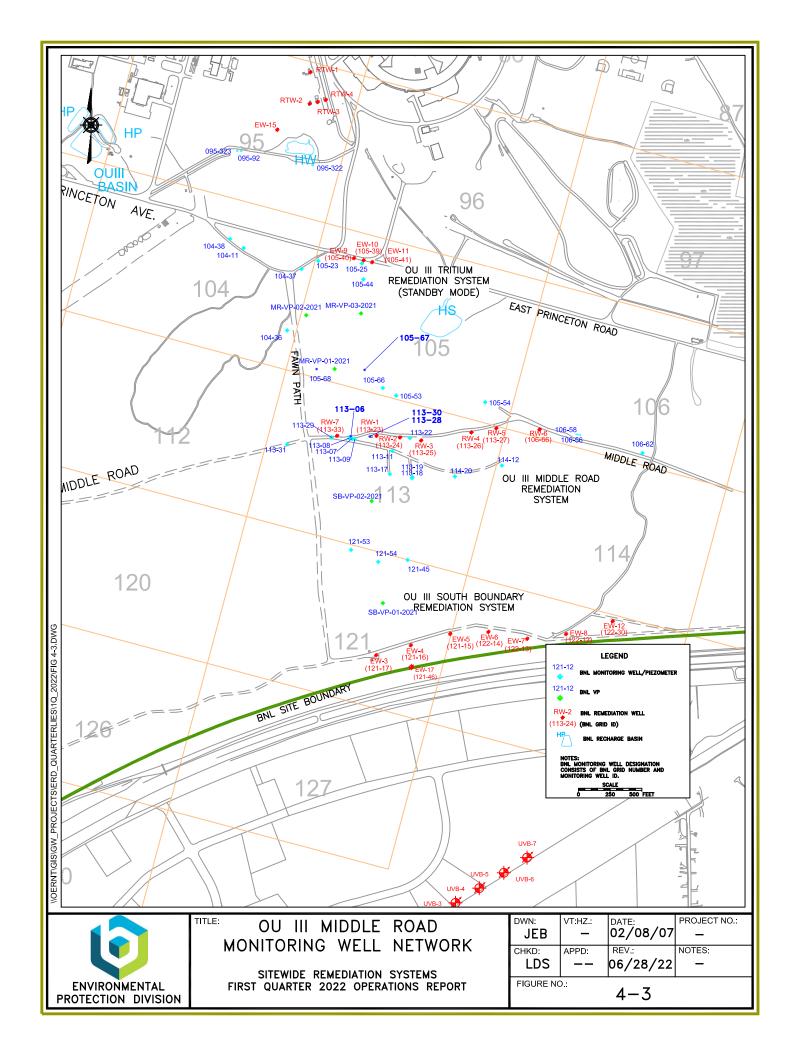

Site ID: 095-322

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	39.13	y <u></u> 0		UG/L	180.00	11.11	20
1,1,1-Trichloroethane	01/26/2022	3.7	0.5	7 <u>52</u>	UG/L	180.00		
1,1-Dichloroethane	01/26/2022	0.23	0.5		UG/L	180.00	J	
1,1-Dichloroethylene	01/26/2022	6.8	0.5		UG/L	180.00		
Chloroform	01/26/2022	0.3	0.5		UG/L	180.00	J	
Tetrachloroethylene	01/26/2022	19	0.5	222	UG/L	180.00		
Trichloroethylene	01/26/2022	9.1	0.5		UG/L	180.00		

Site ID: 095-323

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	19.42	7		UG/L	205.00		
1,1,1-Trichloroethane	01/26/2022	2	0.5		UG/L	205.00		
1,1,2,2-Tetrachloroethane	01/26/2022	1	0.5		UG/L	205.00		
1,1-Dichloroethylene	01/26/2022	0.91	0.5		UG/L	205.00		
Chloroform	01/26/2022	0.21	0.5		UG/L	205.00	J	
Tetrachloroethylene	01/26/2022	11	0.5	2.2	UG/L	205.00		
Trichloroethylene	01/26/2022	4.3	0.5		UG/L	205.00		

Site ID: 104-37

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/21/2022	115.45	0		UG/L	209.00	1 1	
1,1,1-Trichloroethane	01/21/2022	2.1	0.5		UG/L	209.00		
1,1,2,2-Tetrachloroethane	01/21/2022	1	0.5		UG/L	209.00		
1,1-Dichloroethylene	01/21/2022	3.3	0.5		UG/L	209.00		
Carbon tetrachloride	01/21/2022	3.7	0.5		UG/L	209.00		
Chloroform	01/21/2022	0.85	0.5		UG/L	209.00		*
Tetrachloroethylene	01/21/2022	100	2	1,77	UG/L	209.00	D	
Trichloroethylene	01/21/2022	4.5	0.5		UG/L	209.00		

Site ID: 105-23

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/24/2022	18.31	322		UG/L	180.00	60 to 100	
1,1,1-Trichloroethane	01/24/2022	0.37	0.5	177	UG/L	180.00	J	
1,1-Dichloroethylene	01/24/2022	0.47	0.5		UG/L	180.00	J	
Carbon tetrachloride	01/24/2022	0.61	0.5		UG/L	180.00		
Chloroform	01/24/2022	0.42	0.5		UG/L	180.00	J	

Site ID: 105-23

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Tetrachloroethylene	01/24/2022	16	0.5	E	UG/L	180.00		
Trichloroethylene	01/24/2022	0.44	0.5	1	UG/L	180.00	J	

Site ID: 105-66

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	195.81			UG/L	184.00		
1,1,1-Trichloroethane	01/25/2022	1.2	0.5	N73	UG/L	184.00		
1,1-Dichloroethylene	01/25/2022	0.98	0.5		UG/L	184.00		
Carbon tetrachloride	01/25/2022	7.4	0.5		UG/L	184.00		
Chloroform	01/25/2022	0.54	0.5		UG/L	184.00		
Dichlorodifluoromethane	01/25/2022	0.19	0.5	177	UG/L	184.00	J	
Tetrachloroethylene	01/25/2022	180	5		UG/L	184.00	D	
Trichloroethylene	01/25/2022	5.5	0.5		UG/L	184.00		

Site ID: 105-67

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	120.13	10.7722	1777	UG/L	185.00		
1,1,1-Trichloroethane	01/25/2022	4	0.5		UG/L	185.00		
1,1,2,2-Tetrachloroethane	01/25/2022	0.48	0.5		UG/L	185.00	J	
1,1-Dichloroethylene	01/25/2022	3.5	0.5		UG/L	185.00		
Carbon tetrachloride	01/25/2022	0.19	0.5	177	UG/L	185.00	J	
Chloroform	01/25/2022	0.46	0.5		UG/L	185.00	J	
Tetrachloroethylene	01/25/2022	110	2.5		UG/L	185.00	D	
Trichloroethylene	01/25/2022	1.5	0.5		UG/L	185.00		

Site ID: 105-68

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/24/2022	195.85			UG/L	205.00		
1,1,1-Trichloroethane	01/24/2022	0.7	0.5		UG/L	205.00		
1,1,2,2-Tetrachloroethane	01/24/2022	2.3	0.5		UG/L	205.00		80
1,1,2-Trichloroethane	01/24/2022	1.3	0.5	22	UG/L	205.00		
1,1-Dichloroethylene	01/24/2022	0.65	0.5		UG/L	205.00		
Carbon tetrachloride	01/24/2022	8.8	0.5		UG/L	205.00		
Chloroform	01/24/2022	1.1	0.5		UG/L	205.00		
Tetrachloroethylene	01/24/2022	170	5	2,22	UG/L	205.00	D	
Trichloroethylene	01/24/2022	11	0.5		UG/L	205.00		

Site ID: 113-17

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	19.2	-	7-2-2	UG/L	177.00		
Chloroform	01/25/2022	1.2	0.5		UG/L	177.00		
Tetrachloroethylene	01/25/2022	18	0.5	177	UG/L	177.00		

Site ID: 113-19

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	30.76	-		UG/L	230.00		
1,1,1-Trichloroethane	01/25/2022	11	0.5		UG/L	230.00		3
1,1-Dichloroethane	01/25/2022	0.72	0.5	177	UG/L	230.00		
1,1-Dichloroethylene	01/25/2022	6	0.5		UG/L	230.00		
Carbon tetrachloride	01/25/2022	7.2	0.5		UG/L	230.00		
Chloroform	01/25/2022	0.64	0.5		UG/L	230.00		
Trichloroethylene	01/25/2022	5.2	0.5	-	UG/L	230.00		

Site ID: 113-30

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	10.8	-		UG/L	190.00		
Carbon tetrachloride	01/25/2022	2.1	0.5		UG/L	190.00		
Chloroform	01/25/2022	0.5	0.5		UG/L	190.00		
Tetrachloroethylene	01/25/2022	8.2	0.5	-	UG/L	190.00		

Site ID: 113-31

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	2	77-40		UG/L	190.00		
1,1,1-Trichloroethane	01/25/2022	1.4	0.5	122	UG/L	190.00		
1,1-Dichloroethylene	01/25/2022	0.3	0.5	-	UG/L	190.00	J	
Trichloroethylene	01/25/2022	0.3	0.5	-	UG/L	190.00	J	

Site ID: 114-12

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	0.2			UG/L	155.00	100 to 100	
Chloroform	01/25/2022	0.2	0.5		UG/L	155.00	J	

Site ID: 121-53

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	145.61			UG/L	229.00		
1,1,1-Trichloroethane	01/26/2022	2.1	0.5	-	UG/L	229.00		
1,1-Dichloroethane	01/26/2022	0.24	0.5	(77)	UG/L	229.00	J	

Site ID: 121-53

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
1,1-Dichloroethylene	01/26/2022	2.2	0.5		UG/L	229.00		
Carbon tetrachloride	01/26/2022	16	0.5		UG/L	229.00	55	
Chloroform	01/26/2022	1.8	0.5	/123	UG/L	229.00	53	38
Dichlorodifluoromethane	01/26/2022	0.87	2		UG/L	229.00	JD	
Tetrachloroethylene	01/26/2022	120	2		UG/L	229.00	D	
Trichloroethylene	01/26/2022	2.4	0.5		UG/L	229.00	- 1	

Site ID: 106-66 (RW-6

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	1.3	-	770	UG/L	0.00		
Tetrachloroethylene	01/25/2022	1.3	0.5		UG/L	0.00		

Site ID: 113-23 (RW-1)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	0.43			UG/L	0.00		100
Chloroform	01/25/2022	0.43	0.5	224	UG/L	0.00	J	

Site ID: 113-24 (RW-2)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	8.82	-		UG/L	0.00	100	
Carbon tetrachloride	01/25/2022	0.55	0.5		UG/L	0.00	35	68
Tetrachloroethylene	01/25/2022	8.1	0.5	22	UG/L	0.00		
Trichloroethylene	01/25/2022	0.17	0.5	===	UG/L	0.00	J	

Site ID: 113-25 (RW-3)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	3.5	(UG/L	0.00		
1,1,1-Trichloroethane	01/25/2022	1.7	0.5	-27	UG/L	0.00	95	86 8
1,1-Dichloroethane	01/25/2022	0.37	0.5		UG/L	0.00	J	
1,1-Dichloroethylene	01/25/2022	0.72	0.5	-	UG/L	0.00		
Tetrachloroethylene	01/25/2022	0.19	0.5		UG/L	0.00	J	3
Trichloroethylene	01/25/2022	0.52	0.5	- 22	UG/L	0.00	35	16

Site ID: 113-26 (RW-4)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	0.99	-		UG/L	0.00		
Chloroform	01/25/2022	0.27	0.5		UG/L	0.00	J	2
Tetrachloroethylene	01/25/2022	0.38	0.5		UG/L	0.00	J	96
Trichloroethylene	01/25/2022	0.34	0.5	77.0	UG/L	0.00	J	

Site ID: 113-33 (RW-7)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	43.24	-		UG/L	0.00		
1,1,1-Trichloroethane	01/25/2022	0.65	0.5		UG/L	0.00	36	48
1,1-Dichloroethylene	01/25/2022	0.18	0.5		UG/L	0.00	J	
Carbon tetrachloride	01/25/2022	5.6	0.5		UG/L	0.00		
Chloroform	01/25/2022	0.22	0.5		UG/L	0.00	J	

Site ID: 113-33 (RW-7)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Tetrachloroethylene	01/25/2022	36	0.5	1	UG/L	0.00	35	(A)
Trichloroethylene	01/25/2022	0.59	0.5	-	UG/L	0.00	5	

Table 4-5 OU III Middle Road Influent Data 'Hits Only' January through March 2022

Site ID: 113-34 (Combo Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	16.16	1-		UG/L	0.00		20
1,1,1-Trichloroethane	01/25/2022	0.46	0.5		UG/L	0.00	J	60
Carbon tetrachloride	01/25/2022	1.7	0.5		UG/L	0.00	50	38
Tetrachloroethylene	01/25/2022	14	0.5	770	UG/L	0.00	30	
8260 TVOC	02/09/2022	17.65	1		UG/L	0.00		to.
1,1,1-Trichloroethane	02/09/2022	0.47	0.5		UG/L	0.00	J	
Carbon tetrachloride	02/09/2022	1.9	0.5		UG/L	0.00	5	3
Tetrachloroethylene	02/09/2022	15	0.5		UG/L	0.00		
Trichloroethylene	02/09/2022	0.28	0.5		UG/L	0.00	J	
524.2 TVOC	03/12/2022	18.41			UG/L	0.00	35	20
1,1,1-Trichloroethane	03/12/2022	0.84	0.5		UG/L	0.00		8
1,1-Dichloroethylene	03/12/2022	0.38	0.5	770	UG/L	0.00	J	
Carbon tetrachloride	03/12/2022	2.2	0.5		UG/L	0.00		
Chloroform	03/12/2022	0.45	0.5	, ===	UG/L	0.00	J	
Tetrachloroethylene	03/12/2022	14	0.5	220	UG/L	0.00	53	3
Trichloroethylene	03/12/2022	0.54	0.5		UG/L	0.00		

Table 4-6 OU III Middle Road Effluent Data 'Hits Only' January through March 2022

Site ID: 095-270 (System Effluent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	0	1441	1	UG/L	0.00		
8260 TVOC	02/09/2022	0	122		UG/L	0.00	95	95
524.2 TVOC	03/12/2022	0	(77)	-	UG/L	0.00	- 1	

Qualifiers:

J = Estimated value.

D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 5

Q1-2022 Operations Summary OU III Industrial Park In-Well Air Stripping System

Process: Groundwater extraction and in-well air stripping treatment, with

discharge in same well (recirculating well technology) for wells UVB-1 through UVB-7, and groundwater extraction and liquid phase granular activated carbon treatment, with discharge to injection wells for wells

EW-8 and EW-9.

Goal: Reach Maximum Contaminant Levels (MCLs) in core monitoring wells

within 30 years for the Upper Glacial aquifer (by 2030), and 65 years for

the Magothy aquifer (by 2065).

Start Date: September 1999





Table 5-1 OU III Industrial Park Pumping Rates (gpm)

Recirculation Treatment Well	UVB-1	UVB-2	UVB-3	UVB-4	UVB-5	UVB-6	UVB-7	EW-8	EW-9
Site Id#	000-231	000-233	000-235	000-237	000-239	000-241	000-243	000-532	000-533
Screened Interval (feet below grade)	220-240	195-215	194-214	170-190	180-200	190-210	205-225	230-250	220-240
Desired Flow Rate (GPM)	*0	*0	*0	*0	*0	*0	*0	**0	**0
January	*0	*0	*0	*0	*0	*0	*0	**0	**0
February	*0	*0	*0	*0	*0	*0	*0	**0	**0
March	*0	*0	*0	*0	*0	*0	*0	**0	**0
Actual (Avg.over Qtr.)	*0	*0	*0	*0	*0	*0	*0	**0	**0

Note:

Wells EW-8 and EW-9 started full-time operation January 2015.

^{*}Wells UVB-1 to UVB-7 were placed in stand-by mode February 2017.

^{**}Wells EW-8 and EW-9 started one month on and one month off pulsed pumping February 2018 and were placed in stand-by mode July 2019.

Figure 5-1 OU III Industrial Park Cumulative Mass Removal of VOCs vs. Time


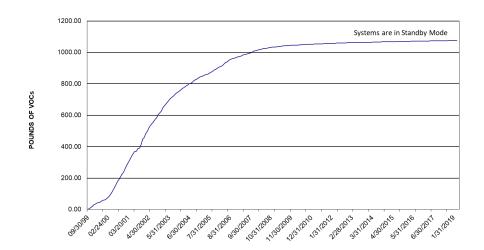


Figure 5-2
OU III Industrial Park
Influent TVOC Concentrations vs. Time

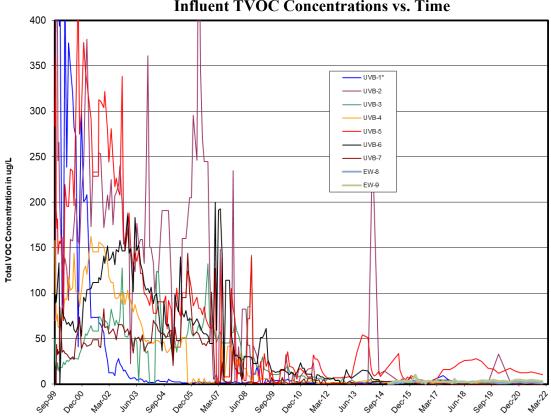

*Startup concentrations for UVB-1 are not illustrated on this graph. TVOC concentration of 1,900 μ g/L in September 1999, and 1,485 μ g/L in October 1999.

Table 5-2 OU III Industrial Park Effluent Water Quality for EW-8 and EW-9 SPDES Equivalency Permit Concentrations January 1 – March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	Monitor	N/A	GPM	Continuous
pH (range)	5.0 - 8.5	N/A	SU	Weekly
Carbon Tetrachloride	5	N/A	ug/L	Monthly ¹
Chloroform	7	N/A	ug/L	Monthly ¹
1,2-Dichloroethane	0.6	N/A	ug/L	Monthly ¹
1,1-Dichloroethylene	5	N/A	ug/L	Monthly ¹
Tetrachloroethylene	5	N/A	ug/L	Monthly ¹
Trichloroethene	5	N/A	ug/L	Monthly ¹
1,1,1-Trichloroethane	5	N/A	ug/L	Monthly ¹

¹ The minimum measurement frequency shall be monthly following a period of 24 consecutive weekly sampling events showing no exceedances of the stated discharge limitations. Monthly sampling was initiated in August 2015.

NA = Not applicable since the system was placed in standby mode in July 2019.


System Operation

January through March 2022:

Extraction wells UVB-1 through UVB-7, EW-8 and EW-9 remained in stand-by mode.

Planned Operational Changes

Maintain the seven UVB wells, and EW-8 and EW-9 in standby. If TVOC concentrations exceed the 50 μg/L capture goal adjacent to any of the wells they may be restarted. During the first quarter, TVOC concentrations in treatment wells UVB-1 through UVB-7, extraction wells EW-8 and EW-9, and adjacent core monitoring wells were below 50 μg/L.

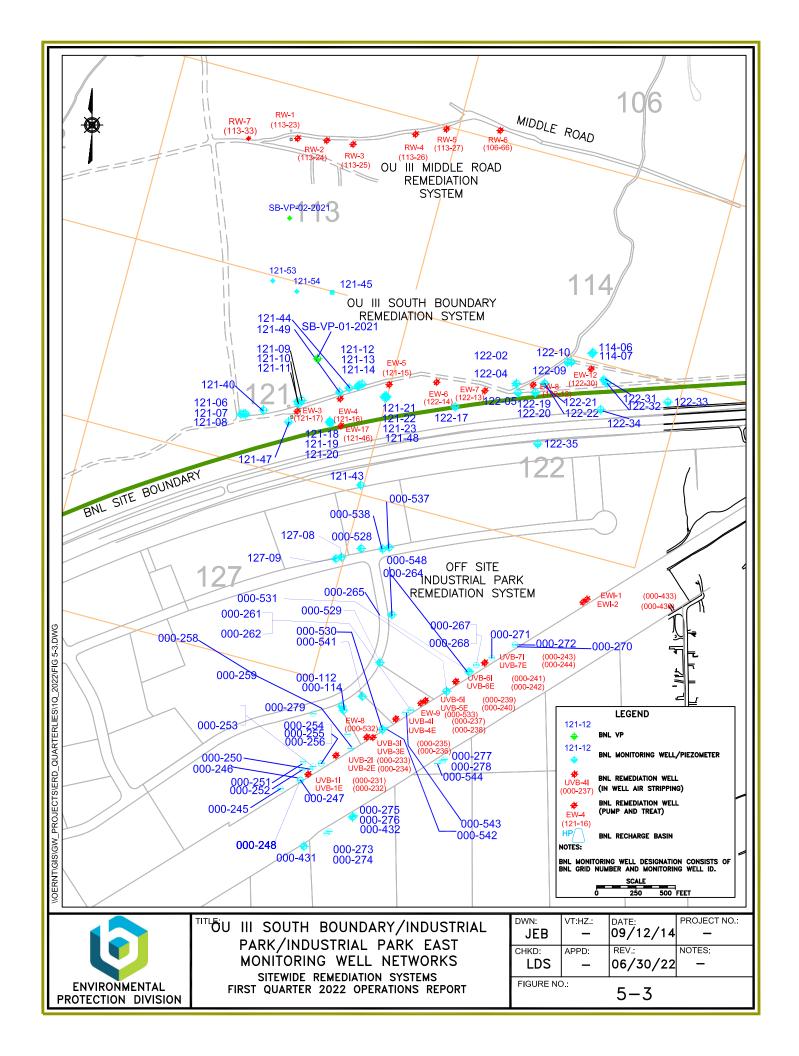

Site ID: 000-112

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/08/2022	0.67	1	1	UG/L	180.00	25	
Chloroform	03/08/2022	0.67	0.5	-	UG/L	180.00		

Site ID: 000-249

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/02/2022	2.89	-	-	UG/L	264.00	100	10
Carbon tetrachloride	03/02/2022	1.2	0.5		UG/L	264.00	35	46
Chloroform	03/02/2022	0.71	0.5		UG/L	264.00	53	8
Tetrachloroethylene	03/02/2022	0.71	0.5		UG/L	264.00		
Trichloroethylene	03/02/2022	0.27	0.5		UG/L	264.00	J	

Site ID: 000-253

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/02/2022	2.29	3	3	UG/L	225.50	56	86 3
Chloroform	03/02/2022	1.4	0.5		UG/L	225.50		
Tetrachloroethylene	03/02/2022	0.89	0.5	-	UG/L	225.50	75	

Site ID: 000-256

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/01/2022	2.2	-		UG/L	222.50	350	36
Chloroform	03/01/2022	1.2	0.5		UG/L	222.50		
Tetrachloroethylene	03/01/2022	1	0.5	00	UG/L	222.50		

Site ID: 000-259

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/01/2022	9.23	-		UG/L	202.50	88	
1,1,1-Trichloroethane	03/01/2022	0.65	0.5		UG/L	202.50		
Carbon tetrachloride	03/01/2022	1.1	0.5	10 77 0	UG/L	202.50	88	
Chloroform	03/01/2022	0.59	0.5	S31	UG/L	202.50		
Tetrachloroethylene	03/01/2022	6.3	0.5		UG/L	202.50		
Trichloroethylene	03/01/2022	0.59	0.5	05_23	UG/L	202.50	5.	

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/28/2022	7.29		13 -1 31	UG/L	182.50	100	
1,1,1-Trichloroethane	02/28/2022	0.78	0.5	-	UG/L	182.50	30	88
1,1-Dichloroethylene	02/28/2022	0.34	0.5	7000	UG/L	182.50	J	8
Carbon tetrachloride	02/28/2022	0.99	0.5		UG/L	182.50		

Site ID: 000-262

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Chloroform	02/28/2022	0.52	0.5	-	UG/L	182.50		3
cis-1,2-Dichloroethylene	02/28/2022	1.1	0.5	-	UG/L	182.50	98	00
Tetrachloroethylene	02/28/2022	2.6	0.5		UG/L	182.50		
Trichloroethylene	02/28/2022	0.96	0.5	0-0	UG/L	182.50		-3

Site ID: 000-268

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/28/2022	1.34		37-23	UG/L	215.50	33	
1,1,1-Trichloroethane	02/28/2022	0.21	0.5		UG/L	215.50	J	
Chloroform	02/28/2022	0.19	0.5	-	UG/L	215.50	J	
Tetrachloroethylene	02/28/2022	0.63	0.5		UG/L	215.50		St.
Trichloroethylene	02/28/2022	0.31	0.5		UG/L	215.50	J	atri

Site ID: 000-271

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/28/2022	0.55		10770	UG/L	215.50		
Chloroform	02/28/2022	0.29	0.5		UG/L	215.50	J	
Dichlorodifluoromethane	02/28/2022	0.26	0.5		UG/L	215.50	J	80

Site ID: 000-279

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/08/2022	2.11			UG/L	193.00		
Carbon tetrachloride	03/08/2022	0.45	0.5	-	UG/L	193.00	J	
Chloroform	03/08/2022	1	0.5		UG/L	193.00		
Tetrachloroethylene	03/08/2022	0.66	0.5		UG/L	193.00	33	99

Site ID: 000-528

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/25/2022	3.59		00	UG/L	220.00	20	56
Chloroform	02/25/2022	0.29	0.5		UG/L	220.00	J	
cis-1,2-Dichloroethylene	02/25/2022	0.23	0.5	322	UG/L	220.00	J	
Dichlorodifluoromethane	02/25/2022	0.37	0.5		UG/L	220.00	J	2
Tetrachloroethylene	02/25/2022	2.5	0.5		UG/L	220.00	20	56
Trichloroethylene	02/25/2022	0.2	0.5		UG/L	220.00	J	

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/16/2022	18.84	-	1	UG/L	219.00	21	8

Site ID: 000-529

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
1,1,1-Trichloroethane	03/16/2022	5.2	0.5	3	UG/L	219.00		
1,1-Dichloroethane	03/16/2022	0.23	0.5		UG/L	219.00	J	3
1,1-Dichloroethylene	03/16/2022	2.9	0.5		UG/L	219.00	55	96
Carbon tetrachloride	03/16/2022	1.5	0.5		UG/L	219.00	100	
Chloroform	03/16/2022	0.61	0.5		UG/L	219.00		
Tetrachloroethylene	03/16/2022	6.6	0.5		UG/L	219.00		8
Trichloroethylene	03/16/2022	1.8	0.5	8221	UG/L	219.00	95	98

Site ID: 000-530

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/01/2022	24.77	-	15-51	UG/L	210.00	20	46
1,1,1-Trichloroethane	03/01/2022	14	0.5		UG/L	210.00		3
1,1-Dichloroethane	03/01/2022	0.72	0.5		UG/L	210.00	95	96
1,1-Dichloroethylene	03/01/2022	7.9	0.5		UG/L	210.00		
Chloroform	03/01/2022	0.43	0.5	12-50	UG/L	210.00	J	
cis-1,2-Dichloroethylene	03/01/2022	0.22	0.5		UG/L	210.00	J	2
Trichloroethylene	03/01/2022	1.5	0.5	-	UG/L	210.00	98-	

Site ID: 000-531

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/28/2022	26.09			UG/L	205.00		
1,1,1-Trichloroethane	02/28/2022	1.8	0.5		UG/L	205.00		to the second
1,1-Dichloroethylene	02/28/2022	1.9	0.5		UG/L	205.00		88
Carbon tetrachloride	02/28/2022	12	0.5	723	UG/L	205.00	53	
Chloroform	02/28/2022	1.4	0.5		UG/L	205.00		
cis-1,2-Dichloroethylene	02/28/2022	0.29	0.5		UG/L	205.00	J	in the second
Tetrachloroethylene	02/28/2022	1	0.5		UG/L	205.00		88
Trichloroethylene	02/28/2022	7.7	0.5		UG/L	205.00	- 2	

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/16/2022	49.42	-		UG/L	245.00		Pa.
1,1,1-Trichloroethane	03/16/2022	7	0.5		UG/L	245.00	30	
1,1-Dichloroethylene	03/16/2022	2.8	0.5		UG/L	245.00	5.	3
Carbon tetrachloride	03/16/2022	1.2	0.5		UG/L	245.00		
Chloroform	03/16/2022	0.71	0.5		UG/L	245.00		No.

Site ID: 000-537

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
cis-1,2-Dichloroethylene	03/16/2022	0.71	0.5	322	UG/L	245.00	50	96
Tetrachloroethylene	03/16/2022	30	0.5		UG/L	245.00		
Trichloroethylene	03/16/2022	7	0.5	-	UG/L	245.00		

Site ID: 000-538

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/16/2022	20.1		-	UG/L	215.00		
1,1,1-Trichloroethane	03/16/2022	3.4	0.5	/ <u></u>	UG/L	215.00	53	8
1,1-Dichloroethylene	03/16/2022	1.8	0.5		UG/L	215.00		
Carbon tetrachloride	03/16/2022	0.68	0.5		UG/L	215.00		
Chloroform	03/16/2022	0.48	0.5		UG/L	215.00	J	
cis-1,2-Dichloroethylene	03/16/2022	0.64	0.5	/2 <u>1</u> 2	UG/L	215.00	53	3
Tetrachloroethylene	03/16/2022	8.6	0.5		UG/L	215.00		
Trichloroethylene	03/16/2022	4.5	0.5		UG/L	215.00		

Site ID: 000-541

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/25/2022	40.97	22	/ <u>-</u> _	UG/L	235.00	20	88
1,1,1-Trichloroethane	02/25/2022	2.3	0.5		UG/L	235.00	98	
1,1-Dichloroethane	02/25/2022	0.32	0.5		UG/L	235.00	J	
1,1-Dichloroethylene	02/25/2022	1.7	0.5		UG/L	235.00		
Carbon tetrachloride	02/25/2022	14	0.5		UG/L	235.00	2.	
Chloroform	02/25/2022	4.9	0.5		UG/L	235.00	98	
cis-1,2-Dichloroethylene	02/25/2022	0.25	0.5		UG/L	235.00	J	
Tetrachloroethylene	02/25/2022	7.5	0.5		UG/L	235.00	20	36
Trichloroethylene	02/25/2022	10	0.5		UG/L	235.00	2.0	

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/08/2022	33.06		225-22	UG/L	230.00		
1,1,1-Trichloroethane	03/08/2022	15	0.5		UG/L	230.00		
1,1-Dichloroethylene	03/08/2022	9.5	0.5	8228	UG/L	230.00	30	
1,2-Dichloroethane	03/08/2022	0.2	0.5		UG/L	230.00	J	
Carbon tetrachloride	03/08/2022	6.5	0.5		UG/L	230.00	20	
Chloroform	03/08/2022	0.94	0.5		UG/L	230.00		
cis-1,2-Dichloroethylene	03/08/2022	0.29	0.5		UG/L	230.00	J	34

Site ID: 000-544

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Trichloroethylene	03/08/2022	0.63	0.5	-	UG/L	230.00		

Site ID: 127-08

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/24/2022	27.23			UG/L	240.00	,	
1,1,1-Trichloroethane	02/24/2022	0.68	0.5		UG/L	240.00		S.
1,1-Dichloroethylene	02/24/2022	0.42	0.5		UG/L	240.00	J	
Carbon tetrachloride	02/24/2022	5.3	0.5		UG/L	240.00		No.
Chloroform	02/24/2022	1	0.5	-	UG/L	240.00		186
Dichlorodifluoromethane	02/24/2022	0.23	0.5		UG/L	240.00	J	3
Tetrachloroethylene	02/24/2022	18	0.5		UG/L	240.00		8
Trichloroethylene	02/24/2022	1.6	0.5		UG/L	240.00		No.

Site ID: 127-09

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/24/2022	5			UG/L	225.00	90	96 J. T. W. L. L.
Carbon tetrachloride	02/24/2022	1.1	0.5	107700	UG/L	225.00		
Chloroform	02/24/2022	1.5	0.5	00==0	UG/L	225.00		
Tetrachloroethylene	02/24/2022	2.4	0.5		UG/L	225.00	9	12

Site ID: 000-532 (EW-8)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	0.86		/	UG/L	253.00	2	
1,1,1-Trichloroethane	01/27/2022	0.21	0.5		UG/L	253.00	J	
Tetrachloroethylene	01/27/2022	0.65	0.5		UG/L	253.00	25	23

Site ID: 000-533 (EW-9)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	2.9	2.5	/	UG/L	243.00	4376.0.01%	8 1000
1,1,1-Trichloroethane	01/27/2022	0.64	0.5		UG/L	243.00		
1,1-Dichloroethane	01/27/2022	0.66	0.5		UG/L	243.00		Pro en
1,1-Dichloroethylene	01/27/2022	1.6	0.5		UG/L	243.00		66

Table 5-5

OU III Industrial Park Influent Data 'Hits Only' January through March 2022

Site ID: 000-231 (UVB-1 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	0	-	-	UG/L	230.00		

Site ID: 000-233 (UVB-2 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	0.28		-	UG/L	205.00	200	
Tetrachloroethylene	01/27/2022	0.28	0.5		UG/L	205.00	J	400

Site ID: 000-235 (UVB-3 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	0			UG/L	204.00		21

Site ID: 000-237 (UVB-4 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	0			UG/L	180.00		

Site ID: 000-239 (UVB-5 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	10.28	553	10770	UG/L	190.00	V.	
1,1,1-Trichloroethane	01/27/2022	0.82	0.5		UG/L	190.00		25
1,1-Dichloroethylene	01/27/2022	0.37	0.5	-	UG/L	190.00	J	
Carbon tetrachloride	01/27/2022	3.5	0.5		UG/L	190.00		96
Chloroform	01/27/2022	0.26	0.5		UG/L	190.00	J	
cis-1,2-Dichloroethylene	01/27/2022	0.23	0.5	-	UG/L	190.00	J	
Tetrachloroethylene	01/27/2022	1.5	0.5		UG/L	190.00		
Trichloroethylene	01/27/2022	3.6	0.5	-	UG/L	190.00	300	00

Site ID: 000-241 (UVB-6 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	0			UG/L	200.00		

Site ID: 000-243 (UVB-7 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	0			UG/L	215.00	86	400

Qualifiers:

J = Estimated value.

D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 6

OU III Former Carbon Tetrachloride Pump & Treat System (System Closed)

The Draft Petition for Closure for the OU III Carbon Tetrachloride Groundwater Removal Action was submitted to the regulators for review in August 2009. Following the incorporation of EPA comments, in October 2009 the Final Petition for Closure for the OU III Carbon Tetrachloride Groundwater Removal Action was issued to the regulators. EPA and NYSDEC provided approval in October 2009. Since that time, activities have been concluded with decommissioning and dismantling of the Carbon Tetrachloride treatment system. A decommissioning report was submitted to the regulators in March 2011.

Section 7 Q1-2022 Operations Summary OU III Building 96 Pump and Treat System

Process: Three (3) re-circulation wells each connected to an individual shallow tray air-

stripping unit and one (1) well with a shallow tray air-stripping unit, with discharge

to a drainage culvert and Recharge Basin HS.

Goal: Remediation of the volatile organic compounds (VOCs) in the source area and reach

Maximum Contaminant Levels (MCLs) in core monitoring wells within 30 years for

the Upper Glacial aquifer (by 2030).

Start Date: January 2001



Table 7-1 OU III Building 96 Pumping Rates (gpm)

Recirculation Treatment Well	RTW-1	RTW-2	RTW-3	RTW-4
Site Id #	095-151	095-153	095-155	095-157
Screen Interval (feet bls)	48-58	48-58	48-58	48-58
Desired Flow Rate (gpm)	60	0	0	0
January	58	0	0	0
February	58	0	0	0
March	58	0	0	0
Actual (Avg. over Qtr.)	58	0	0	0

Note: RTW-1 was restarted in 2008 with discharge to Basin HS. RTW-2 and RTW-3 were placed in standby mode in January 2016. RTW-4 was placed in standby mode in 2012. RTW-2 was restarted November 2018 and placed back in standby June 2020. In June 2019, RTW-1 pumping rate was increased from 30 gpm to 60 gpm.

Figure 7-1
OU III Building 96
Cumulative Mass Removal of VOC's vs. Time

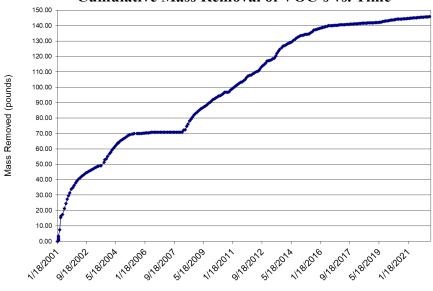


Figure 7-2 OU III Building 96 Influent TVOC Concentrations vs. Time

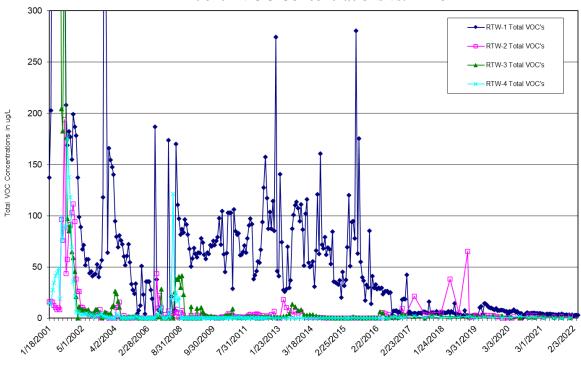


Table 7-2
Effluent Water Quality for RTW-1
SPDES Equivalency Permit Concentrations January 1, 2022– March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency*
Flow	120	58	GPM	Continuous
pH (range)	5.0 - 8.5	5.5 – 7.9	SU	Weekly
Tetrachloroethylene	5.0	<0.5	ug/L	Monthly
1,1,1-Trichloroethane	5.0	<0.5	ug/L	Monthly
Thallium	Monitor	<2.0	ug/L	Monthly
Trichlorofluoromethane	5.0	<0.5	ug/L	Monthly
Methyl Bromide	5.0	<0.5	ug/L	Monthly
Methyl Chloride	5.0	<0.5	ug/L	Monthly
Methylene Chloride	5.0	<0.5	ug/L	Monthly

ND = Not detected.

Note: Starting in June 2019, the flow from Bldg. 96 RTW-1 was increased to 60 gallons per minute and the water is being treated at the Building 452 Freon-11 treatment system due to the larger capacity of that system. Beginning with the July 2019 Discharge Monitoring Report (DMR), the RTW-1 discharge is formally reported under the Freon-11 Equivalency Permit. The data are also provided here for informational purposes.

System Operations

January 2022:

Extraction well RTW-1 ran normally for the month. The system treated approximately 2.5 million gallons of water. In January 2022, a request for renewal of the Building 96 RTW-1 Groundwater Treatment System Equivalency Permit was submitted to NYSDEC for approval.

^{*} The required effluent sampling frequency is monthly following a period of 24 consecutive weekly with no exceedances. Weekly for pH.

February 2022:

Extraction well RTW-1 ran normally for the month. The system treated approximately 2.5 million gallons of water.

March 2022:

Extraction well RTW-1 ran normally for the month. The system treated approximately 2.5 million gallons of water.

The system treated approximately 7.5 million gallons of water during the first quarter of 2022.

During the first quarter of 2022, the highest PCE concentration in the Building 96 monitoring wells was 62 μ g/L in well 085-379. The maximum PCE detection in extraction well RTW-1 in the third quarter was 2.7 μ g/L. Trichlorofluoromethane (Freon-11) was not detected in the first quarter in RTW-1.

Planned Operational Changes

- RTW-1 TVOC concentrations have remained below the 50 μg/L system capture goal since 2015 and PCE remained below the standard of 5.0 μg/L since June of 2020. This well will be placed in a pulsed pumping mode in May 2022 and operated every other month. RTW-1 and area wells will be monitored for any rebound of concentrations over the system capture goal.
- As per a recommendation in the 2021 CERCLA Five-Year Review Report, continue to closely monitor TVOC concentrations in the plume source area and evaluate/implement a liquid carbon with zero-valent iron in-situ treatment for the immediate source area.
- Maintain treatment wells RTW-2, RTW-3, and RTW-4 in standby mode, and restart the wells if extraction or monitoring well data indicate that TVOC concentrations exceed 50 μg/L. During the first quarter of 2022, the maximum TVOC concentration was 2.0 μg/L in extraction well RTW-2. Extraction wells RTW-2, RTW-3 or RTW-4 did not exceed a TVOC concentration of 50 μg/L.

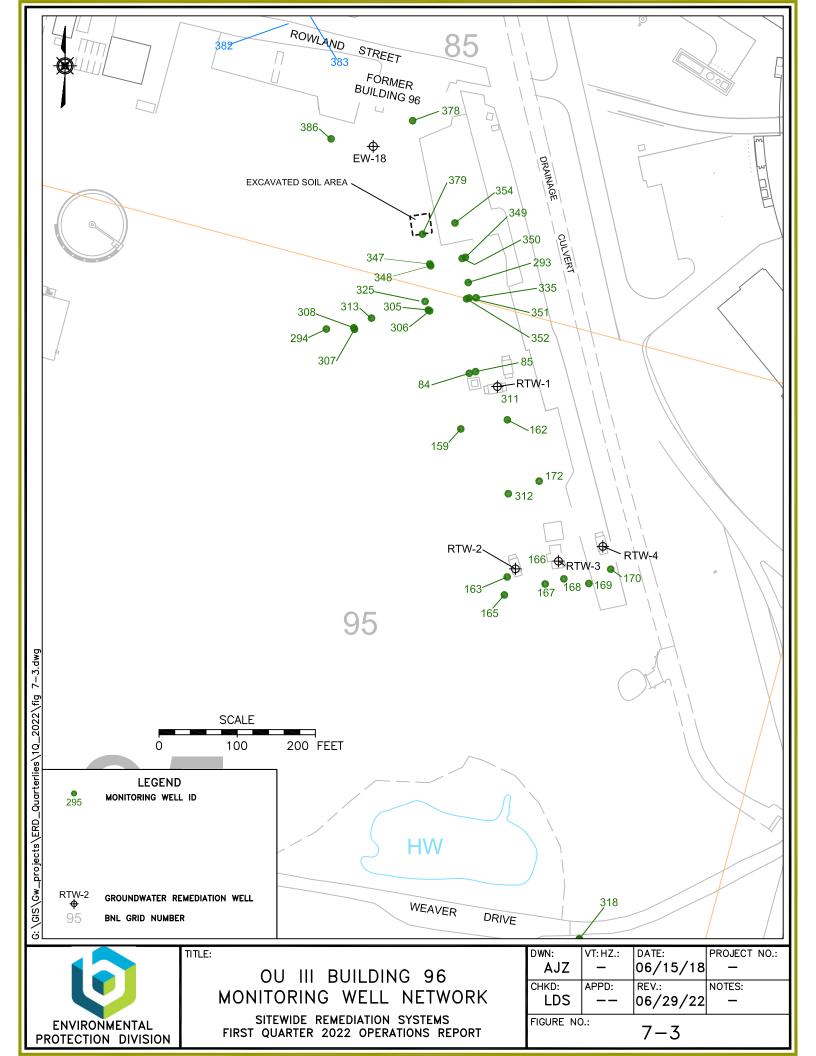


Table 7-3 OU III Building 96 Monitoring Well Data 'Hits Only' January through March 2022

Site			

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/17/2022	24	1221	449	UG/L	35.00	. 13	50
Tetrachloroethylene	01/17/2022	24	0.5	223	UG/L	35.00		

Site ID: 085-348

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/18/2022	10.73	1881	-	UG/L	34.50		414
Chloroform	01/18/2022	0.44	0.5	423	UG/L	34.50	J	50
cis-1,2-Dichloroethylene	01/18/2022	0.29	0.5	522	UG/L	34.50	J	\$1
Tetrachloroethylene	01/18/2022	10	0.5	550	UG/L	34.50		2).

Site ID: 085-349

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/31/2022	6.17		***	UG/L	24.50	. 18	
1,1,1-Trichloroethane	03/31/2022	0.17	0.5	<u>44</u> 6	UG/L	24.50	J	20-
Tetrachloroethylene	03/31/2022	6	0.5		UG/L	24.50	100	

Site ID: 085-350

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/17/2022	3.2	-		UG/L	34.50	18	26
Tetrachloroethylene	01/17/2022	3.2	0.5	220	UG/L	34.50	- 43	20

Site ID: 085-351

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/31/2022	3.2		550	UG/L	24.50		
Tetrachloroethylene	03/31/2022	3.2	0.5		UG/L	24.50		

Site ID: 085-352

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/17/2022	28.24	22	<u> 100</u> 5	UG/L	34.50	12	81
1,1,1-Trichloroethane	01/17/2022	0.24	0.5	558	UG/L	34.50	J	
Tetrachloroethylene	01/17/2022	28	0.5		UG/L	34.50		254

Site ID: 085-354

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/31/2022	10.27	223	220	UG/L	25.00	0)	£6
Benzene	03/31/2022	0.65	0.5	975 E	UG/L	25.00		612
Tetrachloroethylene	03/31/2022	8.7	0.5		UG/L	25.00		
Toluene	03/31/2022	0.92	0.5	240	UG/L	25.00	18	27

Site ID: 085-379

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/17/2022	62	3	77	UG/L	17.00		90

Table 7-3 OU III Building 96 Monitoring Well Data 'Hits Only' January through March 2022

Site ID: 085-379

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Tetrachloroethylene	01/17/2022	62	2	***	UG/L	17.00	D	11/

Site ID: 095-159

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/14/2022	6.6	120	223	UG/L	50.00	())	(0
Tetrachloroethylene	01/14/2022	6.6	0.5	2750	UG/L	50.00		717

Site ID: 095-162

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/14/2022	1.32	(48)	***	UG/L	50.00		
Benzene	01/14/2022	0.19	0.5	<u> 22</u>):	UG/L	50.00	J	Ç6
Chloroform	01/14/2022	0.79	0.5	200	UG/L	50.00		
Toluene	01/14/2022	0.34	0.5	673	UG/L	50.00	J	

Site ID: 095-172

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/14/2022	0.64	(44)	440	UG/L	50.00	- 0	<u>(</u> 6
Chloroform	01/14/2022	0.64	0.5	223	UG/L	50.00		7/2

Site ID: 095-305

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/19/2022	2.9	(##)	-	UG/L	22.50	9 /8	NV
Tetrachloroethylene	01/19/2022	2.9	0.5	4.5	UG/L	22.50		50

Site ID: 095-306

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/18/2022	26.56		200	UG/L	34.50		en en
cis-1,2-Dichloroethylene	01/18/2022	0.56	0.5		UG/L	34.50		
Tetrachloroethylene	01/18/2022	26	0.5		UG/L	34.50		

Site ID: 095-312

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/13/2022	0.58	175	251	UG/L	50.00	100	
Chloroform	01/13/2022	0.58	0.5	- 653	UG/L	50.00		

Site ID: 095-318

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/19/2022	1.58	(22)	923	UG/L	65.00		<u>(</u> 6
Chloroform	01/19/2022	0.78	0.5	923	UG/L	65.00		
Tetrachloroethylene	01/19/2022	0.8	0.5	555	UG/L	65.00		

Table 7-3 OU III Building 96 Monitoring Well Data 'Hits Only' January through March 2022

Site ID: 095-325

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/18/2022	16.8	(10)	***	UG/L	45.00		2%
Chloroform	01/18/2022	0.48	0.5	2529	UG/L	45.00	J	(6
cis-1,2-Dichloroethylene	01/18/2022	0.32	0.5	253	UG/L	45.00	J	
Tetrachloroethylene	01/18/2022	16	0.5	(11 8)	UG/L	45.00		

Site ID: 095-84

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/17/2022	28		227	UG/L	25.00	()	(6
Tetrachloroethylene	01/17/2022	28	0.5	274	UG/L	25.00		

Site ID: 095-85

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/14/2022	0.93	(++)		UG/L	95.00	0 /8	213
Chloroform	01/14/2022	0.93	0.5	620	UG/L	95.00		(6

Table 7-5 OU III Building 96 Influent Data 'Hits Only' January through March 2022

Site ID: 095-151 (RTW-1 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/06/2022	2.67		-	UG/L	0.00		
Chloroform	01/06/2022	0.47	0.5	-	UG/L	0.00	J	
Tetrachloroethylene	01/06/2022	2.2	0.5		UG/L	0.00		2:
8260 TVOC	01/20/2022	3.3		227	UG/L	0.00	- 33	(6
Chloroform	01/20/2022	0.6	0.5		UG/L	0.00		
Tetrachloroethylene	01/20/2022	2.7	0.5		UG/L	0.00		
8260 TVOC	02/03/2022	2.2	(++)		UG/L	0.00		25
Tetrachloroethylene	02/03/2022	2.2	0.5	227	UG/L	0.00	- 33	(6
8260 TVOC	02/14/2022	3.1	-77	275d	UG/L	0.00		
Chloroform	02/14/2022	0.6	0.5	550	UG/L	0.00		
Tetrachloroethylene	02/14/2022	2.5	0.5		UG/L	0.00		2
8260 TVOC	03/04/2022	3.14		227	UG/L	0.00	6 65	(6
Chloroform	03/04/2022	0.54	0.5		UG/L	0.00		
Tetrachloroethylene	03/04/2022	2.6	0.5	-	UG/L	0.00		
8260 TVOC	03/18/2022	3.11	(++)		UG/L	0.00		2:
Chloroform	03/18/2022	0.51	0.5		UG/L	0.00	- 33	£6
Tetrachloroethylene	03/18/2022	2.6	0.5		UG/L	0.00		

Site ID: 095-153 (RTW-2 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/10/2022	2.12	(48)		UG/L	0.00		25
Chloroform	01/10/2022	0.58	0.5	<u>25</u> 3	UG/L	0.00		CO
m/p xylene	01/10/2022	0.41	1	270	UG/L	0.00	J	
Toluene	01/10/2022	0.72	0.5		UG/L	0.00		
Xylene (total)	01/10/2022	0.41	1.5		UG/L	0.00	J	25

Site ID: 095-155 (RTW-3 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/10/2022	0.65	-22	223	UG/L	0.00		8
Chloroform	01/10/2022	0.65	0.5	533	UG/L	0.00		

Site ID: 095-157 (RTW-4 Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/10/2022	0	122	949	UG/L	0.00		£6

Table 7-6

OU III Building 96 Effluent Data 'Hits Only' January through March 2022

Site ID: 095-152 (RTW-1 Effluent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/06/2022	0	5251	255	UG/L	0.00		en.
8260 TVOC	01/20/2022	0	(55)		UG/L	0.00		
8260 TVOC	02/03/2022	0	(48)	441	UG/L	0.00		
8260 TVOC	02/14/2022	0	545	22)	UG/L	0.00	- 103	Ç6
8260 TVOC	03/04/2022	0	1276	2002	UG/L	0.00		
8260 TVOC	03/18/2022	0	(**)		UG/L	0.00		

Qualifiers:

J = Estimated value.

D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 8

OU IV Former Air Sparge/Soil Vapor Extraction System (System Closed)

A petition was submitted in June 2002 for closure of this project. The EPA and DEC provided their approval for system closure in July 2003. The system was decommissioned in the fall of 2003. Per the 2010 Groundwater Status Report, groundwater monitoring related to the OU I Air Sparge/Soil Vapor Extraction System is concluded.

Section 9

Q1-2022 Operations Summary OU VI Ethylene Dibromide Pump & Treat System

Process: Groundwater extraction and liquid phase granular activated carbon

treatment, with discharge to injection wells.

Goal: Reach the ethylene dibromide Maximum Contaminant Level (MCL) in

core monitoring wells within 30 years for the Upper Glacial aquifer (by

2030).

Start Date: October 2004



Table 9-1
OU VI Ethylene Dibromide Pump and Treat System
Pumping Rates (gpm)

Extraction Well	EW-1E	EW-2E
Site Id#	000-503	000-504
Screened Interval (feet below grade)	115-135	115-135
Desired Flow Rate (GPM)	160	190
January	145	164
February	164	185
March	131	201
Actual (Avg. over Qtr.)	147	183

Figure 9-1 OU VI Cumulative Mass Removal of EDB vs. Time

Note: Due to the low concentrations of ethylene dibromide in the extraction wells, presentation of a mass removal graph is not appropriate.

Figure 9-2
OU VI Ethylene Dibromide
Influent EDB Concentration vs. Time

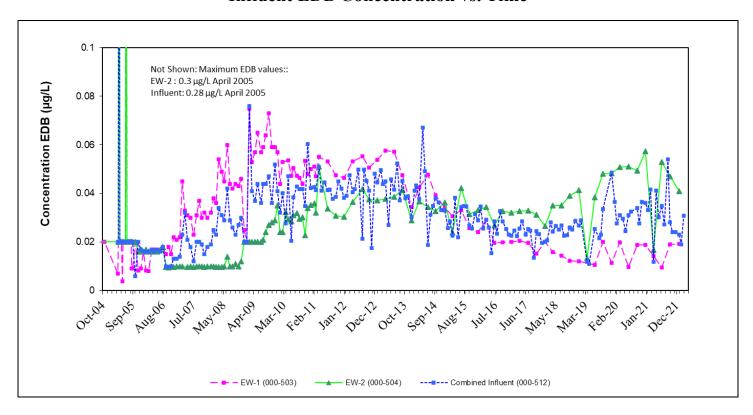


Table 9-2
OU VI Ethylene Dibromide Effluent Water Quality
SPDES Equivalency Permit Concentrations January 1, 2022 – March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	450	349	GPM	Continuous
рН	5.0 - 8.5	5.7-6.1	SU	Weekly
Ethylene Dibromide	.03	<0.02	ug/L	Monthly**
Chloroform	7.0	0.95	ug/L	Monthly**
1,1-Dichloroethene	5.0	<0.5	ug/L	Monthly**
1,1,1-Trichloroethane	5.0	<0.5	ug/L	Monthly**
Methyl Chloride	5.0	<0.5	ug/L	Monthly**
Methylene Chloride	5.0	0.57	ug/L	Monthly**

^{*}Minimum to maximum value for pH during this operational period.

System Operations Summary

January 2022:

The system was off from January 12th to January 20th for repairs to replace a broken pipe valve on one of the carbon tanks. The system treated approximately 13 million gallons of water.

February 2022:

The system ran normally for the month. The system treated approximately 15 million gallons of water.

March 2022:

Well EW-1 was off the last six days of the month for a faulty flow meter. The system treated approximately 14 million gallons of water.

The system treated approximately 42 million gallons of water during the first quarter of 2022.

Planned Operational Changes

 Maintain full time operation of the treatment system and continue quarterly sampling of the extraction wells.

^{**} The minimum measurement frequency shall be monthly following a period of 24 consecutive weekly sampling events showing no exceedances of the stated discharge limitations.

- Based on the data collected from the deeper vertical profile wells, the new monitoring wells and the capture and cleanup timeframe assessment, the following is recommended:
 - Update the Regional Groundwater Flow Model to reflect the current hydrogeologic conditions, then evaluate extraction/recharge scenarios to modify the current treatment system so that capture and cleanup timeframe objectives of meeting DWS by 2030 are achieved.
 - o Following the modeling, prepare a system design modification for submittal to the regulators.

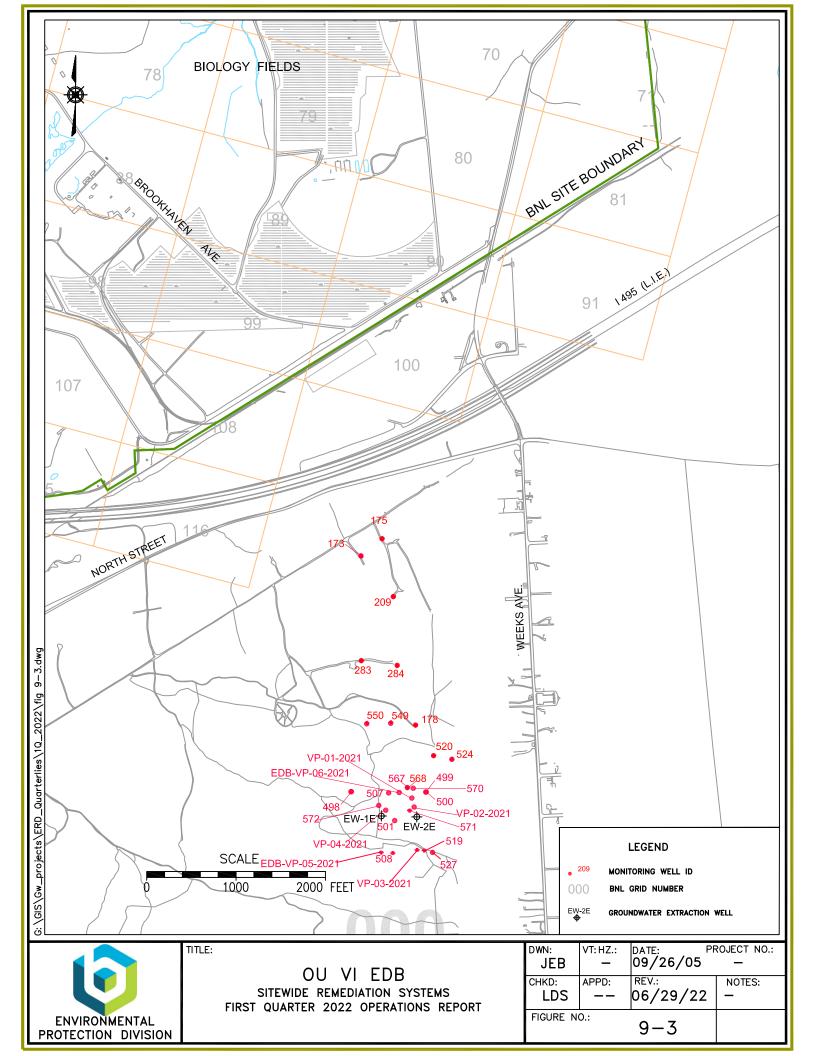


Table 9-3 OU VI Ethylene Dibromide Monitoring Well Data 'Hits Only' January through March 2022

Site ID: 000-209

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
EDB	01/14/2022	0.0142	0.0193	122	UG/L	99.00	J	F

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
EDB	03/16/2022	0.107	0.019	175	UG/L	135.00		

Table 9-4
OU VI Ethylene Dibromide Extraction Well Data
'Hits Only' January through March 2022

Site ID: 000-503 (EW-1)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/10/2022	1.6	(44)	220	UG/L	0.00		24
Chloroform	01/10/2022	0.98	0.5	10E9:	UG/L	0.00	J	(6
Methylene chloride	01/10/2022	0.62	0.5		UG/L	0.00	J	317

Site ID: 000-504 (EW-2)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/10/2022	1.52	1999		UG/L	0.00		115
Chloroform	01/10/2022	0.88	0.5	440	UG/L	0.00	J	50
EDB	01/10/2022	0.041	0.0188	923	UG/L	0.00		200
Methylene chloride	01/10/2022	0.64	0.5	==0	UG/L	0.00	J	3.

Table 9-5 OU VI Ethylene Dibromide Influent Data 'Hits Only' January through March 2022

Site ID: 000-512 (Combined Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/10/2022	1.59	20 3		UG/L	0.00		
Chloroform	01/10/2022	0.94	0.5	144	UG/L	0.00	J	
EDB	01/10/2022	0.0229	0.019	N.T.	UG/L	0.00		
Methylene chloride	01/10/2022	0.65	0.5	1990	UG/L	0.00	J	
8260 TVOC	02/03/2022	0.92			UG/L	0.00		
Chloroform	02/03/2022	0.92	0.5	122	UG/L	0.00	J	
8260 TVOC	03/03/2022	1.39	752	1975	UG/L	0.00		
Chloroform	03/03/2022	0.86	0.5	1500	UG/L	0.00	J	
EDB	03/03/2022	0.0308	0.0188		UG/L	0.00		
Methylene chloride	03/03/2022	0.53	0.5		UG/L	0.00	J	07-

Table 9-6 OU VI Ethylene Dibromide Effluent Data 'Hits Only' January through March 2022

Site ID: 000-510 (System Effluent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/10/2022	1.51	77,6	1.55	UG/L	0.00		
Chloroform	01/10/2022	0.95	0.5		UG/L	0.00	J	
EDB	01/10/2022	0.0189	0.0189	1922	UG/L	0.00	U	(3)
EDB	01/10/2022	0.5	0.5	722	UG/L	0.00	U	
Methylene chloride	01/10/2022	0.56	0.5	177	UG/L	0.00	J	
8260 TVOC	02/03/2022	0	- HE		UG/L	0.00		
EDB	02/03/2022	0.0188	0.0188	222	UG/L	0.00	U	GL:
EDB	02/03/2022	0.5	0.5	722	UG/L	0.00	U	
8260 TVOC	03/03/2022	0.57	756	135	UG/L	0.00		
EDB	03/03/2022	0.0192	0.0192		UG/L	0.00	U	
EDB	03/03/2022	0.5	0.5	722	UG/L	0.00	U	01
Methylene chloride	03/03/2022	0.57	0.5	722	UG/L	0.00	J	

Qualifiers:

J = Estimated value.

D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 10

Q-1 2022 Quarterly Operations Summary OU III HFBR Tritium Pump and Recharge System (System Closed)

Process: Pump and recharge (to the RAV basin) with monitored natural attenuation

for tritium. Carbon filtration was also included in the pump and recharge system to remove VOCs that were also present in the groundwater.

Goal: Reach Maximum Contaminant Levels (MCLs) in core monitoring wells

within 30 years for the Upper Glacial aquifer (by 2030). NYSDEC and EPA approved of the Petition for Closure in August 2018 and March

2019, respectively.

Start Date: May 1997



Table 10-1 OU III HFBR Pump and Recharge System Pumping Rates (gpm)

Extraction Well	EW-9	EW-10	EW-11	EW-16
Site ID #	105-40	105-39	105-41	096-119
Screen Interval (ft bls)	130-150	130-150	130-150	80-120
Desired Flow Rate (gpm)	0 *	0 *	0 *	0 *
January (Avg monthly gpm)	0	0	0	0
February " "	0	0	0	0
March " "	0	0	0	0
Actual (Avg. over Qtr.)	0	0	0	0

^{*} The system was approved for closure in March 2019.

Figure 10-1
OU III HFBR Pump & Treat System
Extraction Wells Tritium Concentrations vs. Time

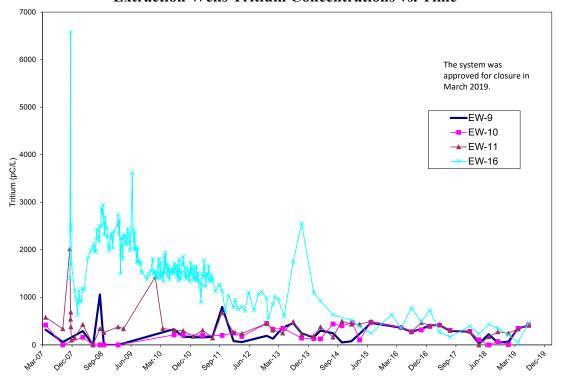


Table 10-2 Effluent Water Quality SPDES Equivalency Permit Concentrations January 1, 2022 – March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	Monitor	NA	GPD	Continuous
pH (range)	5.6 - 8.5	NA	SU	Weekly
Carbon Tetrachloride	5.0	NA	ug/L	2/Month
Chloroform	7.0	NA	ug/L	2/Month
1,1-Dichloroethane	5.0	NA	ug/L	2/Month

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
1,2-Dichloroethane	0.6	NA	ug/L	2/Month
1,1-Dichloroethene	5.0	NA	ug/L	2/Month
Cis-1,2-Dichloroethylene	5.0	NA	ug/L	2/Month
trans-1,2-Dichloroethylene	5.0	NA	ug/L	2/Month
Methyl Chloride	5.0	NA	ug/L	2/Month
Methylene Chloride	5.0	NA	ug/L	2/Month
Methyl Bromide	5.0	NA	ug/L	2/Month
Tetrachloroethylene	5.0	NA	ug/L	2/Month
1,1,1-Trichloroethane	5.0	NA	ug/L	2/Month
Trichloroethylene	5.0	NA	ug/L	2/Month

NA = Not applicable. The system is closed.

Monitoring Activities

The current monitoring well network is depicted on **Figure 10-1**. The first quarter monitoring well analytical results are shown on **Table 10-3**. The highest tritium concentration immediately downgradient of the HFBR in the first quarter of 2022 was 1,300 pCi/L in well 075-806. Sampling of the extraction wells for this system was discontinued in July 2019.


System Operations

January through March 2022:

The system remained closed.

Planned Operational Changes

- Continue to monitor the source area with the ten wells located immediately downgradient of the HFBR. Maintain the quarterly sampling frequency.
- Maintain the downgradient monitoring wells and extraction wells until a determination is made on their utilization related to PFAS and 1,4-dioxane
- The carbon vessels and related equipment is being repurposed for the operation of the new groundwater treatment system that will treat Per- and Poly fluoroalkyl Substances downgradient of the Former Firehouse.

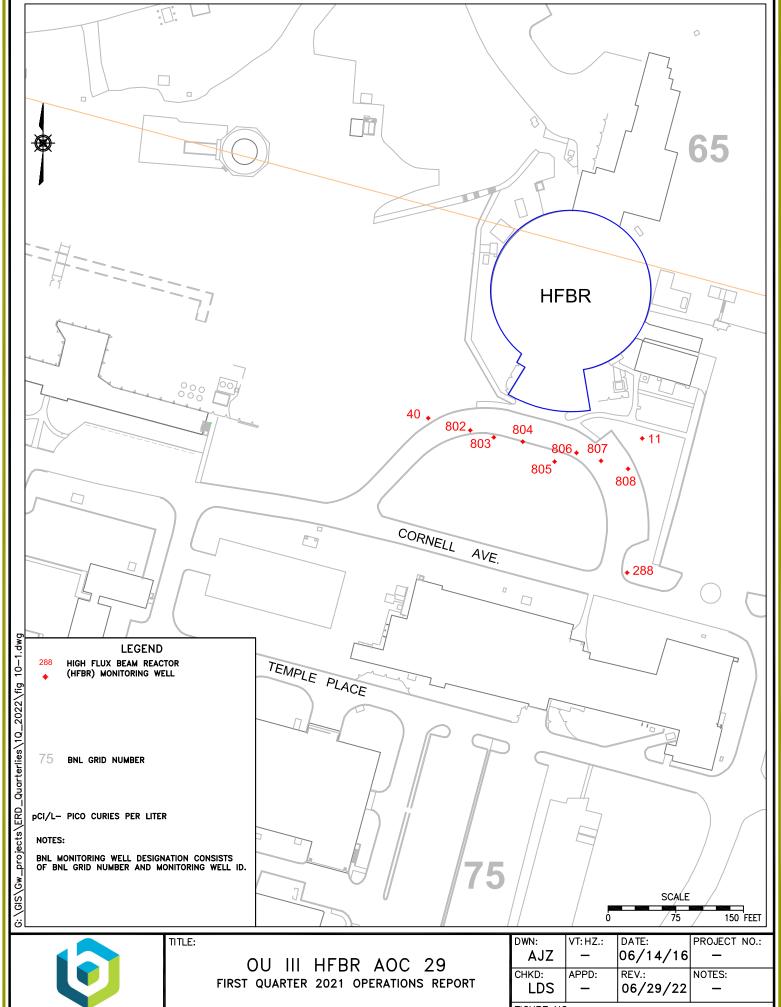

ENVIRONMENTAL PROTECTION DIVISION FIGURE NO.: 10 - 1

Table 10-3

OU III HFBR Tritium Plume Monitoring Well Data 'Hits Only' January through March 2022

Site ID: 075-11

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Tritium	01/10/2022	131.514	395.177	233.379	PCI/L	61.50		

Site ID: 075-802

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	0.00	Review Qual
Tritium	01/11/2022	1299.309	396.079	262.28	PCI/L	50.90		

Site ID: 075-805

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Tritium	01/10/2022	634.454	392.5	244.438	PCI/L	51.70		

Site ID: 075-806

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Tritium	01/10/2022	1300.933	396.574	262.608	PCI/L	51.30		***************************************

Site ID: 075-807

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Tritium	01/10/2022	319.187	394.925	238.02	PCI/L	50.40		

Site ID: 075-808

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Tritium	01/10/2022	-186.953	393.233	223.891	PCI/L	49.00		

Qualifiers:

J = Estimated value.

D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 11

Q1-2022 Operations Summary OU III Western South Boundary Pump & Treat System

Process: Groundwater extraction and air stripping treatment. As of March 2019, the

water is treated at the OU III South Boundary/Middle Road air stripper towers and discharged to both the OU III and RA V recharge basins.

Goal: Reach Maximum Contaminant Levels (MCLs) in core monitoring wells in

OU III within 30 years for the Upper Glacial aquifer (by 2030).

Start Date: September 2002



Table 11-1 OU III Western South Boundary Pump & Treat System Pumping Rates (gpm)

Extraction Well	WSB-1	WSB-2	WSB-3	WSB-4	WSB-5	WSB-6
Site ID #	126-12	127-05	111-17	119-13	130-12	130-13
Screen Interval (ft bls)	140-160	150-170	168-188	170-190	160-190	196-216
Desired Flow Rate (GPM)	100	0*	75	75	75	75
January (Avg monthly gpm)	62**	0	80	85	70	72
February " "	77	0	90	103	84	84
March " "	93	0	100	113	91	93
Actual (Avg. over Qtr.)	77	0	90	100	82	83

^{*} Extraction well WSB-2 is in standby mode. Extraction wells WSB-3 through WSB-6 became operational in March 2019.

^{**} Stuck flow totalizer. Value lower than actual.

Figure 11-1
OU III Western South Boundary Pump & Treat System
Cumulative Mass Removal of VOCs vs. Time

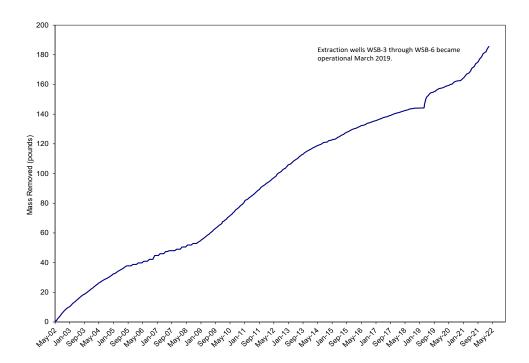


Figure 11-2 OU III Western South Boundary Pump & Treat System Influent TVOC Concentrations vs. Time

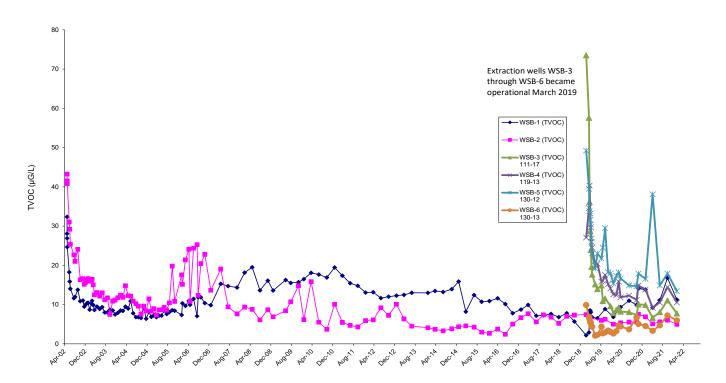


Table 11-2
OUIII Western South Boundary Effluent Water Quality
SPDES Equivalency Permit Concentrations January 1, 2022 – March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	Monitor	1,471,2561	GPD	Continuous
pH (range)	6.5 - 8.5	6.7-7.2 ²	SU	Monthly ³
Carbon Tetrachloride	5	<0.05	ug/L	Monthly ³
Chloroform	7	<0.05	ug/L	Monthly ³
Dichlorodifluoromethane	5	<0.66	ug/L	Monthly ³
1,1-Dichloroethane	5	<0.05	ug/L	Monthly ³
1,1-Dichloroethylene	5	<0.05	ug/L	Monthly ³
Methyl Chloride	5	<0.05	ug/L	Monthly ³
Tetrachloroethylene	5	<0.05	ug/L	Monthly ³
Toluene	5	<0.05	ug/L	Monthly ³
1,1,1-Trichloroethane	5	<0.05	ug/L	Monthly ³
1,1,2 Trichloroethane	5	<0.05	ug/L	Monthly ³
Trichloroethylene	10	<0.05	ug/L	Monthly ³

¹ The maximum monthly average flow for the Middle Road and South Boundary, and Western South Boundary Systems during the operational period.

Note: As of March 2019, the water from the Western South Boundary is treated at the OU III South Boundary/Middle Road air stripper towers and discharged under that equivalency permit. This change in discharge location was reflected starting with the April 2019 DMR.

System Operations

January 2022:

Extraction wells WSB-1, WSB-3, WSB-4, WSB-5 and WSB-6 ran normally. Extraction well WSB-2 was in standby mode. The system treated approximately 17 million gallons of water.

² The minimum and maximum pH values during the operational period.

³ Beginning in April 2003, a SPDES modification was approved revising the pH and volatile organic sampling to once a month.

February 2022:

Extraction well WSB-1, WSB-3, WSB-4, WSB-5 and WSB-6 ran normally. Extraction well WSB-2 was in standby mode. The system treated approximately 18 million gallons of water.


March 2022:

Extraction well WSB-1, WSB-3, WSB-4, WSB-5 and WSB-6 ran normally. Extraction well WSB-2 was in standby mode. The system treated approximately 21 million gallons of water.

The system treated approximately 56 million gallons of water during the first quarter of 2022.

Planned Operational Changes

- Continue full-time operation of extraction well WSB-1 based on elevated concentrations persisting in well 126-14. If TVOC concentrations drop below 20 μg/L in this monitoring well, begin pulsed pumping well of WSB-1. In the first quarter of 2022, the TVOC concentration in this well was 21 μg/L.
- Continue full time operation of extraction wells WSB-3 through WSB-6.
- Based on the TVOC concentrations below the capture goal of 20 μg/L, maintain extraction well WSB-2 in standby mode. If TVOC concentrations greater than 20 μg/L are observed in WSB-2 or the adjacent core monitoring wells, extraction well WSB-2 may be put into full time operation. During the first quarter, WSB-2 and adjacent monitoring wells were below the TVOC capture goal of 20 μg/L.

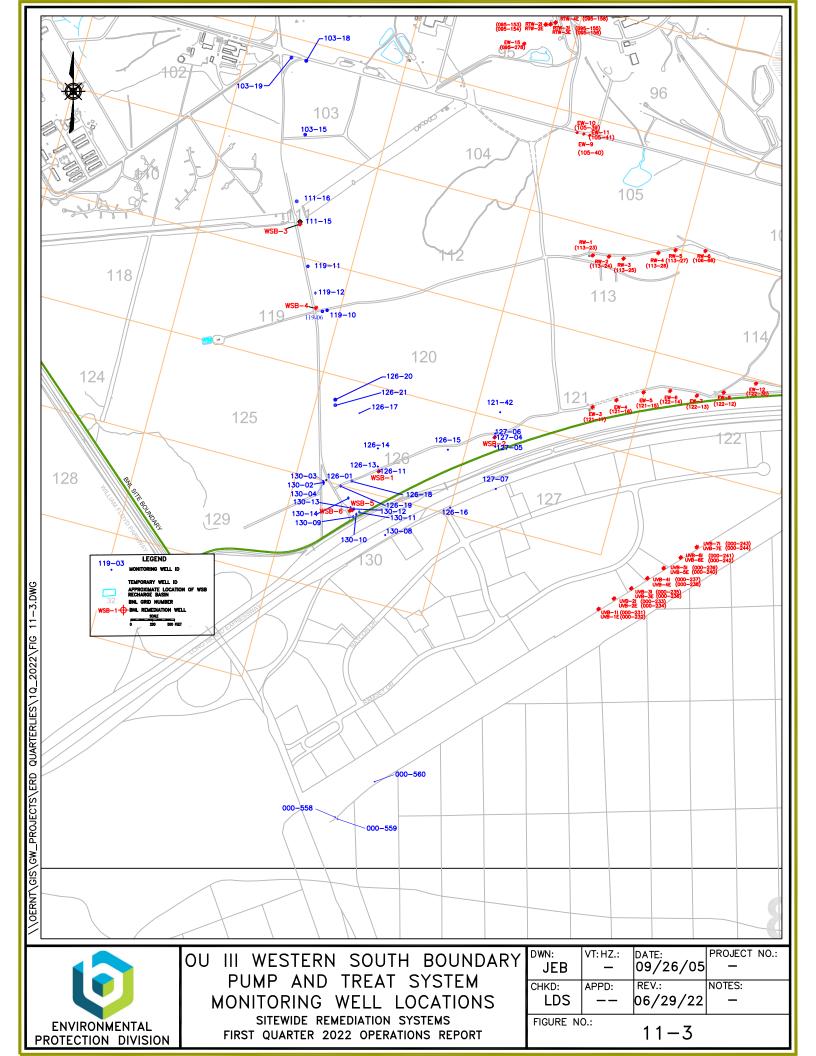

Site ID: 000-558

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/17/2022	21.5	-		UG/L	165.00	33	68
1,1,1-Trichloroethane	02/17/2022	3.2	0.5	722	UG/L	165.00	2	
1,1-Dichloroethane	02/17/2022	1.1	0.5	19773	UG/L	165.00	9.7	**
1,1-Dichloroethylene	02/17/2022	4.8	0.5		UG/L	165.00	7	
Chloroform	02/17/2022	4.9	0.5		UG/L	165.00	80	46
Dichlorodifluoromethane	02/17/2022	3.3	0.5	-	UG/L	165.00	2	-8
Trichloroethylene	02/17/2022	4.2	0.5		UG/L	165.00		

Site ID: 000-559

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/17/2022	2.6			UG/L	215.00	35	200
1,1-Dichloroethylene	02/17/2022	0.18	0.5		UG/L	215.00	J	
Chloroform	02/17/2022	0.22	0.5	10-50	UG/L	215.00	J	
Dichlorodifluoromethane	02/17/2022	2.2	0.5		UG/L	215.00		te e

Site ID: 000-560

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/24/2022	9.11		32_25	UG/L	159.50	55	46
1,1,1-Trichloroethane	02/24/2022	1.2	0.5		UG/L	159.50		
1,1-Dichloroethane	02/24/2022	0.41	0.5	33	UG/L	159.50	J	26
1,1-Dichloroethylene	02/24/2022	1.5	0.5		UG/L	159.50		3
Chloroform	02/24/2022	1.3	0.5	1221	UG/L	159.50	95	96
Dichlorodifluoromethane	02/24/2022	3.3	0.5	1077	UG/L	159.50		
Trichloroethylene	02/24/2022	1.4	0.5		UG/L	159.50	70	-04

Site ID: 103-15

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/02/2022	29	22		UG/L	200.00	- 50	36
1,1-Dichloroethane	02/02/2022	4.4	0.5	-	UG/L	200.00	3.	33
1,1-Dichloroethylene	02/02/2022	6	0.5		UG/L	200.00	20	200
Dichlorodifluoromethane	02/02/2022	13	0.5		UG/L	200.00		
Trichloroethylene	02/02/2022	5.6	0.5	-	UG/L	200.00	93	

Site ID: 103-18

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/24/2022	10.2	-	1	UG/L	170.00		
1,1-Dichloroethane	02/24/2022	1.2	0.5		UG/L	170.00		

Site ID: 103-18

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
1,1-Dichloroethylene	02/24/2022	1.9	0.5		UG/L	170.00	500	86
Dichlorodifluoromethane	02/24/2022	4.3	0.5		UG/L	170.00	5.	
Trichloroethylene	02/24/2022	2.8	0.5	-	UG/L	170.00		

Site ID: 103-19

	72						Lab	Review
Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Qual	Qual
8260 TVOC	02/02/2022	5.74			UG/L	170.00	95	90
1,1-Dichloroethane	02/02/2022	0.71	0.5	-	UG/L	170.00	5.	8
1,1-Dichloroethylene	02/02/2022	0.93	0.5	10-01	UG/L	170.00		
Dichlorodifluoromethane	02/02/2022	1.8	0.5	-	UG/L	170.00		
Trichloroethylene	02/02/2022	2.3	0.5	-	UG/L	170.00	56	96

Site ID: 111-15

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	5.56	-	10.770	UG/L	175.00		
Benzene	01/27/2022	2.2	0.5	00	UG/L	175.00	72	
m/p xylene	01/27/2022	0.33	1		UG/L	175.00	J	
Toluene	01/27/2022	2.7	0.5	/2 <u>1</u> 3	UG/L	175.00	2	
Xylene (total)	01/27/2022	0.33	1.5		UG/L	175.00	J	

Site ID: 111-16

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/27/2022	3.33	-		UG/L	173.00	36	
1,1,1-Trichloroethane	01/27/2022	0.34	0.5		UG/L	173.00	J	3
1,1-Dichloroethane	01/27/2022	0.36	0.5	10-5	UG/L	173.00	J	
1,1-Dichloroethylene	01/27/2022	1.8	0.5		UG/L	173.00		Pa.
Chloroform	01/27/2022	0.34	0.5		UG/L	173.00	J	
Trichloroethylene	01/27/2022	0.49	0.5		UG/L	173.00	J	8

Site ID: 119-10

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	8.5			UG/L	200.00		
1,1-Dichloroethane	01/26/2022	2.2	0.5		UG/L	200.00		3
1,1-Dichloroethylene	01/26/2022	1.9	0.5		UG/L	200.00	35	90
Dichlorodifluoromethane	01/26/2022	3.4	0.5		UG/L	200.00		20
Trichloroethylene	01/26/2022	1	0.5		UG/L	200.00	20	

Site ID: 119-11

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/02/2022	76.5		8228	UG/L	180.00	93	96

Site ID: 119-11

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
1,1,1-Trichloroethane	02/02/2022	12	0.5	10770	UG/L	180.00		
1,1-Dichloroethane	02/02/2022	7.8	0.5	-	UG/L	180.00		10
1,1-Dichloroethylene	02/02/2022	52	2		UG/L	180.00	D	
Dichlorodifluoromethane	02/02/2022	1.6	0.5		UG/L	180.00	2.	3
Trichloroethylene	02/02/2022	3.1	0.5		UG/L	180.00	30	· 8

Site ID: 119-12

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/02/2022	7.3		-	UG/L	179.00		8
1,1,1-Trichloroethane	02/02/2022	3.3	0.5		UG/L	179.00	33	46
1,1-Dichloroethylene	02/02/2022	2.2	0.5		UG/L	179.00	- 1	
Trichloroethylene	02/02/2022	1.8	0.5	00	UG/L	179.00		

Site ID: 126-14

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/11/2022	20.53		3-2	UG/L	155.00	99	
1,1,1-Trichloroethane	02/11/2022	9	0.5		UG/L	155.00	8.	
1,1-Dichloroethylene	02/11/2022	7.6	0.5		UG/L	155.00	20	
1,2-Dichloroethane	02/11/2022	0.27	0.5		UG/L	155.00	J	
Benzene	02/11/2022	0.49	0.5	8221	UG/L	155.00	J	36
m/p xylene	02/11/2022	0.2	1		UG/L	155.00	J	
Toluene	02/11/2022	0.87	0.5	111	UG/L	155.00		
Trichloroethylene	02/11/2022	1.9	0.5		UG/L	155.00		
Xylene (total)	02/11/2022	0.2	1.5	3223	UG/L	155.00	J	36

Site ID: 126-16

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/10/2022	16.2	-	-	UG/L	135.00		
1,1,1-Trichloroethane	02/10/2022	2.2	0.5		UG/L	135.00		
1,1-Dichloroethane	02/10/2022	0.6	0.5		UG/L	135.00		
1,1-Dichloroethylene	02/10/2022	3.6	0.5		UG/L	135.00	5	
Chloroform	02/10/2022	3.2	0.5		UG/L	135.00		
Dichlorodifluoromethane	02/10/2022	3.8	0.5		UG/L	135.00		
Trichloroethylene	02/10/2022	2.8	0.5		UG/L	135.00		200

Site ID: 126-17

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/11/2022	0.5	-	10770	UG/L	140.00		

Site ID: 126-17

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
1,1,1-Trichloroethane	02/11/2022	0.23	0.5		UG/L	140.00	J	3
1,1-Dichloroethylene	02/11/2022	0.27	0.5		UG/L	140.00	J	90

Site ID: 126-18

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/01/2022	0.65	=	10-70	UG/L	165.00		
1,1,1-Trichloroethane	02/01/2022	0.29	0.5		UG/L	165.00	J	
1,1-Dichloroethylene	02/01/2022	0.36	0.5		UG/L	165.00	J	38

Site ID: 126-19

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/01/2022	16.19	-	10.7710	UG/L	195.00		
1,1,1-Trichloroethane	02/01/2022	1.6	0.5		UG/L	195.00		
1,1-Dichloroethane	02/01/2022	1.6	0.5	-	UG/L	195.00	100	
1,1-Dichloroethylene	02/01/2022	3.9	0.5	70_23	UG/L	195.00	2	8
Chloroform	02/01/2022	0.69	0.5		UG/L	195.00	88	
Dichlorodifluoromethane	02/01/2022	8.4	0.5	-	UG/L	195.00	-	

Site ID: 126-20

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/11/2022	11.95	22	8228	UG/L	140.00	33	W.
1,1,1-Trichloroethane	02/11/2022	4.8	0.5	-	UG/L	140.00	1.0	
1,1-Dichloroethylene	02/11/2022	5.6	0.5	11	UG/L	140.00	2	-6
1,2-Dichloroethane	02/11/2022	0.28	0.5		UG/L	140.00	J	3
Chloroform	02/11/2022	0.25	0.5		UG/L	140.00	J	46
Tetrachloroethylene	02/11/2022	0.42	0.5		UG/L	140.00	J	
Trichloroethylene	02/11/2022	0.6	0.5	1	UG/L	140.00	20	

Site ID: 126-21

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/11/2022	1.15			UG/L	204.00	95	96 (************************************
1,1-Dichloroethylene	02/11/2022	0.28	0.5		UG/L	204.00	J	
Chloroform	02/11/2022	0.28	0.5	15-50	UG/L	204.00	J	40
Dichlorodifluoromethane	02/11/2022	0.59	0.5		UG/L	204.00		2

Site ID: 127-07

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/10/2022	2.6	1	1	UG/L	151.00	2	

Site ID: 127-07

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
1,1,1-Trichloroethane	02/10/2022	0.2	0.5	15==0	UG/L	151.00	J	5%
1,1-Dichloroethylene	02/10/2022	0.55	0.5		UG/L	151.00		3
Chloroform	02/10/2022	0.25	0.5		UG/L	151.00	J	96
Dichlorodifluoromethane	02/10/2022	1.6	0.5		UG/L	151.00	3.	

Site ID: 130-08

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/10/2022	1.89			UG/L	150.00	3	
Chloroform	02/10/2022	1.6	0.5		UG/L	150.00	33	96
Tetrachloroethylene	02/10/2022	0.29	0.5	10.550	UG/L	150.00	J	

Site ID: 130-09

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/24/2022	1.6			UG/L	140.00		
Chloroform	02/24/2022	1.6	0.5		UG/L	140.00	35	

Site ID: 130-10

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/07/2022	0.85	-	1	UG/L	155.00		
Chloroform	02/07/2022	0.85	0.5		UG/L	155.00		to o

Site ID: 130-11

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/07/2022	1.5			UG/L	200.00	30	40
Chloroform	02/07/2022	1.3	0.5		UG/L	200.00		20
Dichlorodifluoromethane	02/07/2022	0.2	0.5	00	UG/L	200.00	J	

Site ID: 130-14

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	02/11/2022	23.2			UG/L	208.00	93	46
1,1-Dichloroethane	02/11/2022	1.1	0.5		UG/L	208.00		3
1,1-Dichloroethylene	02/11/2022	1.1	0.5	1311	UG/L	208.00	10	46
Dichlorodifluoromethane	02/11/2022	21	0.5		UG/L	208.00	8	

Site ID: 111-17 (WSB-3)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	7.76			UG/L	0.00		
1,1,1-Trichloroethane	01/25/2022	0.87	0.5		UG/L	0.00		
1,1-Dichloroethane	01/25/2022	0.7	0.5		UG/L	0.00		ng.
1,1-Dichloroethylene	01/25/2022	4.4	0.5		UG/L	0.00		
Chloroform	01/25/2022	0.99	0.5		UG/L	0.00	5	3
Dichlorodifluoromethane	01/25/2022	0.17	0.5		UG/L	0.00	J	8
Tetrachloroethylene	01/25/2022	0.17	0.5		UG/L	0.00	J	100 Miles
Trichloroethylene	01/25/2022	0.46	0.5		UG/L	0.00	J	46

Site ID: 119-13 (WSB-4)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	10.56	(57)	770	UG/L	0.00		
1,1,1-Trichloroethane	01/25/2022	2.7	0.5	-	UG/L	0.00		-6
1,1-Dichloroethane	01/25/2022	0.51	0.5		UG/L	0.00	-	3
1,1-Dichloroethylene	01/25/2022	5.8	0.5		UG/L	0.00	35	- C
Chloroform	01/25/2022	0.28	0.5	770	UG/L	0.00	J	
Dichlorodifluoromethane	01/25/2022	0.6	0.5		UG/L	0.00		.6
Trichloroethylene	01/25/2022	0.67	0.5		UG/L	0.00	3	8

Site ID: 126-12 (WSB-1)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	11.26	1955)	77.4	UG/L	0.00		
1,1,1-Trichloroethane	01/25/2022	3.7	0.5		UG/L	0.00		10
1,1-Dichloroethylene	01/25/2022	5.8	0.5		UG/L	0.00		
Chloroform	01/25/2022	0.86	0.5	- 12	UG/L	0.00	35	94
Dichlorodifluoromethane	01/25/2022	0.17	0.5		UG/L	0.00	J	
Trichloroethylene	01/25/2022	0.73	0.5		UG/L	0.00	70	-W

Site ID: 127-05 (WSB-2)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	4.97			UG/L	0.00	. 30	48
1,1,1-Trichloroethane	01/25/2022	0.8	0.5		UG/L	0.00	5	
1,1-Dichloroethane	01/25/2022	0.26	0.5	-	UG/L	0.00	J	
1,1-Dichloroethylene	01/25/2022	1	0.5		UG/L	0.00		20
Chloroform	01/25/2022	0.69	0.5		UG/L	0.00	. 30	
Dichlorodifluoromethane	01/25/2022	0.22	0.5		UG/L	0.00	J	

Site ID: 127-05 (WSB-2)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Trichloroethylene	01/25/2022	2	0.5	1	UG/L	0.00	70	, e (a)

Site ID: 130-12 (WSB-5)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	13.42			UG/L	0.00		
1,1,1-Trichloroethane	01/25/2022	4.5	0.5		UG/L	0.00		
1,1-Dichloroethane	01/25/2022	0.32	0.5		UG/L	0.00	J	
1,1-Dichloroethylene	01/25/2022	4.8	0.5		UG/L	0.00		
Chloroform	01/25/2022	1.5	0.5	220	UG/L	0.00		80 8
Dichlorodifluoromethane	01/25/2022	1.2	0.5	777.0	UG/L	0.00		
Trichloroethylene	01/25/2022	1.1	0.5		UG/L	0.00	y,	

Site ID: 130-13 (WSB-6)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	5.98		-	UG/L	0.00		46
1,1,1-Trichloroethane	01/25/2022	0.36	0.5		UG/L	0.00	J	
1,1-Dichloroethane	01/25/2022	0.57	0.5		UG/L	0.00		
1,1-Dichloroethylene	01/25/2022	0.95	0.5		UG/L	0.00		Ng.
Dichlorodifluoromethane	01/25/2022	4.1	0.5		UG/L	0.00		66

Table 11-5 OU III Western South Boundary Influent Data 'Hits Only' January through March 2022

Site ID: 121-55 (System Influent)

							Lab	Review
Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Qual	Qual
8260 TVOC	01/25/2022	10.69	(577)	77.4	UG/L	0.00		
1,1,1-Trichloroethane	01/25/2022	3.6	0.5		UG/L	0.00		
1,1-Dichloroethylene	01/25/2022	5.3	0.5		UG/L	0.00		3
Chloroform	01/25/2022	0.83	0.5		UG/L	0.00	35	99
Dichlorodifluoromethane	01/25/2022	0.22	0.5		UG/L	0.00	J	
Trichloroethylene	01/25/2022	0.74	0.5		UG/L	0.00		
8260 TVOC	02/09/2022	10.22			UG/L	0.00		
1,1,1-Trichloroethane	02/09/2022	2.9	0.5		UG/L	0.00	38	99
1,1-Dichloroethylene	02/09/2022	5	0.5		UG/L	0.00		
Chloroform	02/09/2022	0.48	0.5		UG/L	0.00	J	
Dichlorodifluoromethane	02/09/2022	1.4	0.5		UG/L	0.00	3	
Trichloroethylene	02/09/2022	0.44	0.5		UG/L	0.00	J	96
8260 TVOC	03/12/2022	10.2			UG/L	0.00		
1,1,1-Trichloroethane	03/12/2022	2.7	0.5		UG/L	0.00		
1,1-Dichloroethane	03/12/2022	0.4	0.5		UG/L	0.00	J	
1,1-Dichloroethylene	03/12/2022	4.9	0.5		UG/L	0.00	93	96
Chloroform	03/12/2022	0.71	0.5		UG/L	0.00	5.0	
Dichlorodifluoromethane	03/12/2022	0.85	0.5		UG/L	0.00		
Trichloroethylene	03/12/2022	0.64	0.5		UG/L	0.00		

Table 11-6 OU III Western South Boundary Effluent Data 'Hits Only' January through March 2022

Site ID: 095-270 (System Effluent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/25/2022	0			UG/L	0.00		
8260 TVOC	02/09/2022	0	15-	-	UG/L	0.00		
524.2 TVOC	03/12/2022	0	1	-	UG/L	0.00	-	

Qualifiers:

J = Estimated value.

D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 12 Q1-2022 Operations Summary OU III Strontium-90 Chemical Holes Treatment System

Process: Groundwater extraction and treatment via zeolite resin (Clinoptilolite) for the

removal of Sr-90, with discharge to dry wells.

Goal: Reach Maximum Contaminant Levels (MCLs) in core monitoring wells within 40

years for the Upper Glacial aquifer (by 2040).

Start Date: February 2003



Table 12-1 OU III Sr-90 Chemical Holes Pumping Rates (gpm)

Extraction Well	EW-1 *	EW-2*	EW-3*
Site Id #	106-92	106-123	106-124
Screen Interval (ft bls)	23.5-38.5	35-45	35-45
Desired Flow Rate (gpm)	0.0	0.0	0.0
January (Avg monthly gpm)	0.0	0.0	0.0
February	0.0	0.0	0.0
March	0.0	0.0	0.0
Actual (Avg. over Qtr. when on)	0.0	0.0	0.0

^{*} All three extraction wells began pulse pumping (one month on and two months off) in October 2014. In October 2015, EW-1 resumed full time operation. In April 2016, EW-1 was placed into pulsed pumping mode (one month on and one month off). In October 2016, EW-2 and EW-3 were placed in stand-by mode while EW-1 continued in pulsed pumping mode. EW-1 was placed in stand-by mode in July 2018.

Figure 12-1 Chemical Holes Strontium-90 Cumulative Millicuries Removed


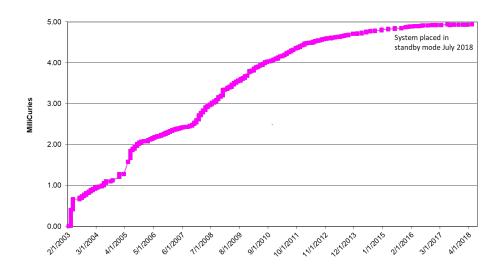


Figure 12-2 Chemical Holes Influent Strontium-90 Concentrations

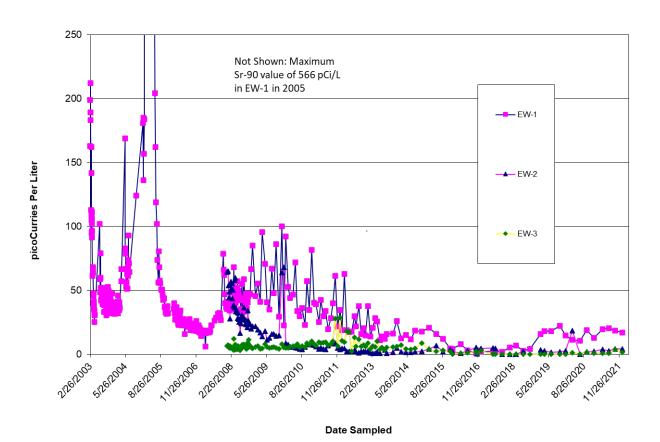

12-2

Table 12-2
OU III Sr-90 Chemical Holes Treatment System Effluent Water Quality
SPDES Equivalency Permit Concentrations January 1 – March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	Monitor	NA	GPM	Continuous
pH (range)	5.0 - 8.5	NA	SU	Monthly
Sr-90	8	NA	pCi/L	Monthly

NA = Not Applicable. The system was shut down in July 2018.

ND = Not Detected.

Systems Operations

January through March 2022:

The system was in stand-by mode.

Planned Operational Changes

- Maintain the system in stand-by mode. If significant rebound is identified, the extraction wells may be restarted. During the first quarter, Sr-90 concentrations in extraction well EW-2 and EW-3 were 4.25 pCi/L and 1.67 pCi/L, respectively. Extraction well EW-1 had Sr-90 concentration of 17 pCi/L. The maximum Sr-90 concentration in the monitoring wells during the first quarter was 36 pCi/L in well 097-314, which is located upgradient of EW-1. The third quarter 2021 Sr-90 result for this well was 72 pCi/L.
- If Sr-90 concentrations in the monitoring and extraction wells do not show any significant rebound, then a Petition for Closure of the treatment system may be prepared.

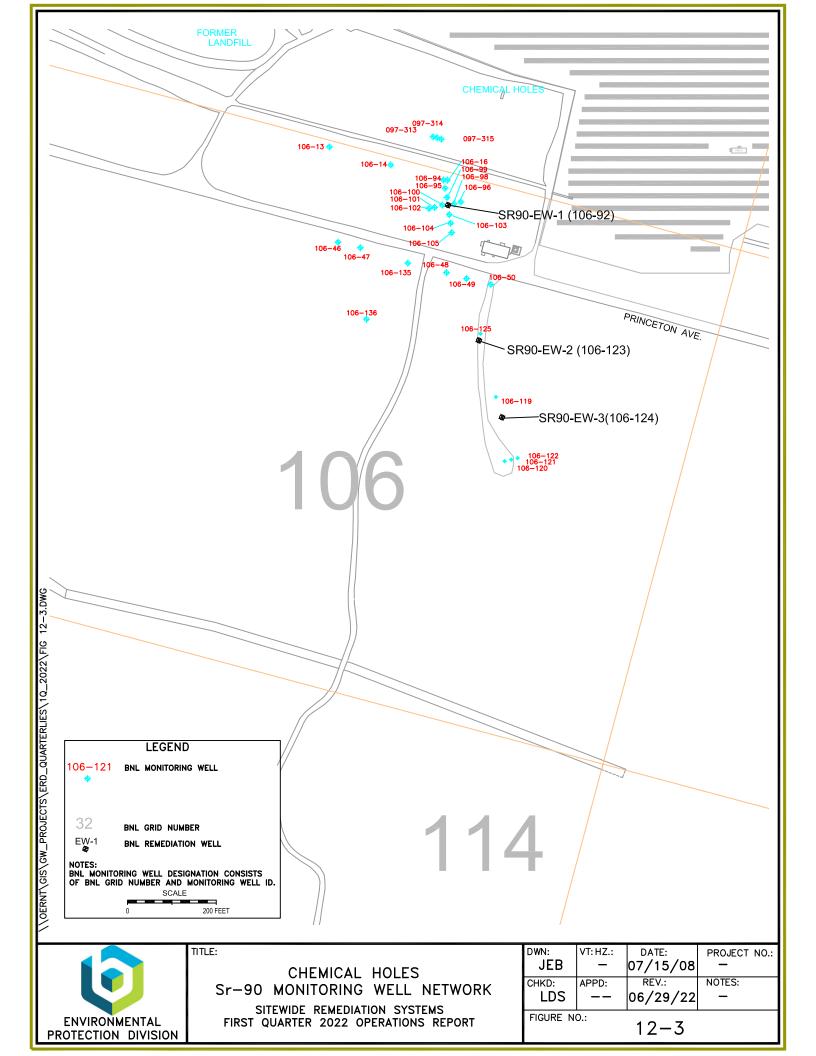


Table 12-3 OU III Strontium-90 Chemical Holes Monitoring Well Data 'Hits Only' January through March 2022

Site ID: 097-313

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/20/2022	8.55	0.771	0.972	PCI/L	38.00	- 0	

Site ID: 097-314

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/19/2022	36.1	1.03	1.24	PCI/L	39.00		

Table 12-4

OU III Strontium-90 Chemical Holes Extraction Well Data 'Hits Only' January through March 2022

Site ID: 106-123 (EW-2)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/10/2022	4.25	0.931	0.778	PCI/L	0.00		25

Site ID: 106-124 (EW-3)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/10/2022	1.67	1.14	0.743	PCI/L	0.00		1

Site ID: 106-92 (EW-1)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/10/2022	17	3.67	3.03	PCI/L	0.00	711	11

Qualifiers:

J = Estimated value.

D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 13

Q1-2022 Operations Summary OU III Former Industrial Park East Pump & Treat System (System Closed)

The Petition for Closure for the OU III Industrial Park East Groundwater Treatment System was submitted to the regulators for review in May 2013. Approval was received from the regulators in June and July 2013 that the system met its treatment goals and can now be dismantled. Any remaining contaminants in the downgradient portion of the plume beyond the capture zone of the extraction wells will attenuate to below MCLs in the Upper Glacial and Magothy aquifers before the required 2030 and 2065 cleanup timeframes, respectively.

Dismantlement activities have been initiated including the abandonment of four groundwater monitoring wells (000-489, 000-493, 000-513, 000-514) and the two groundwater extraction wells (EWI-1 and EWI-2) in September 2013. Final decommissioning of the treatment system will be performed following the completion of remediation of the deep VOC contamination in the Industrial Park.

The building, carbon units, and the two recharge wells are being used with the two new extraction wells for remediation of the deep VOC contamination in the Industrial Park.

The post closure monitoring network consists of four wells. In accordance with the recommendation in the 2015 Groundwater Status Report, VOC monitoring for seven wells was discontinued in the fourth quarter of 2016 since the wells have been below the AWQS for a minimum of four consecutive sampling events. The data from the four wells are also evaluated as part of the North Street and Magothy monitoring programs. Monitoring will continue until MCLs are achieved for a minimum of four consecutive sampling events. The monitoring schedule is described in the BNL Environmental Monitoring Plan (EMP).

Section 14

Q1-2022 Operations Summary OU III North Street Pump & Treat System (System Closed)

Process: Groundwater extraction and liquid phase granular activated carbon

treatment, with discharge to injection wells

Goal: Reach Maximum Contaminant Levels (MCLs) or asymptotic conditions in

core monitoring wells within 30 years for the Upper Glacial aquifer and within 65 years for the Magothy aquifer (by 2030 and 2065, respectively).

Start Date: June 2004



Table 14-1 OU III North Street Pump & Treat System Pumping Rates (gpm)

Extraction Well	NS-1	NS-2
Site ID #	000-471	000-473
Screen Interval (ft bls)	165-205	190-220
Design Flow Rate (GPM)	0*	0*
January	0*	0*
February	0*	0*
March	0*	0*
Actual (Avg. over Qtr.)	0*	0*

^{*=}The system is shut down and approved for closure in March 2020.

Figure 14-1
OU III North Street Pump & Treat System
Cumulative Mass Removal of VOCs vs. Time

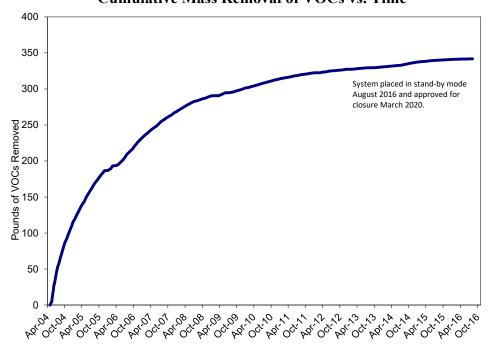


Figure 14-2 OU III North Street Pump & Treat System Influent TVOC Concentrations vs. Time

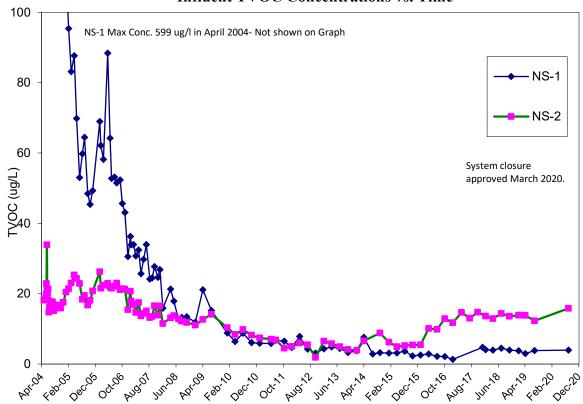


Table 14-2 Effluent Water Quality

SPDES Equivalency Permit Concentrations January 1 – March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	Monitor	NA ¹	GPD	Continuous
pH (range)	5.5 - 8.5	NA ¹	SU	Monthly
Carbon Tetrachloride	5	NA ¹	ug/L	Monthly
Chloroform	5	NA ¹	ug/L	Monthly
1,1-Dichloroethane	5	NA ¹	ug/L	Monthly
1,2-Dichloroethane	0.6	NA ¹	ug/L	Monthly
1,1-Dichloroethylene	5	NA ¹	ug/L	Monthly
Tetrachloroethylene	5	NA ¹	ug/L	Monthly
Toluene	5	NA ¹	ug/L	Monthly
1,1,1-Trichloroethane	5	NA ¹	ug/L	Monthly
Trichloroethylene	5	NA ¹	ug/L	Monthly
Ethylene Dibromide (EDB)	0.03	NA ¹	ug/L	Monthly

¹ The system is closed. NA= Not Applicable.


System Operations

January through March 2022:

The system remained closed.

Planned Operational Changes

• NS-1 and NS-2 will remain shut down until the PFAS and 1,4 dioxane characterization is completed. After the completion of this characterization, a determination of the future use of these wells and treatment system infrastructure will be determined.

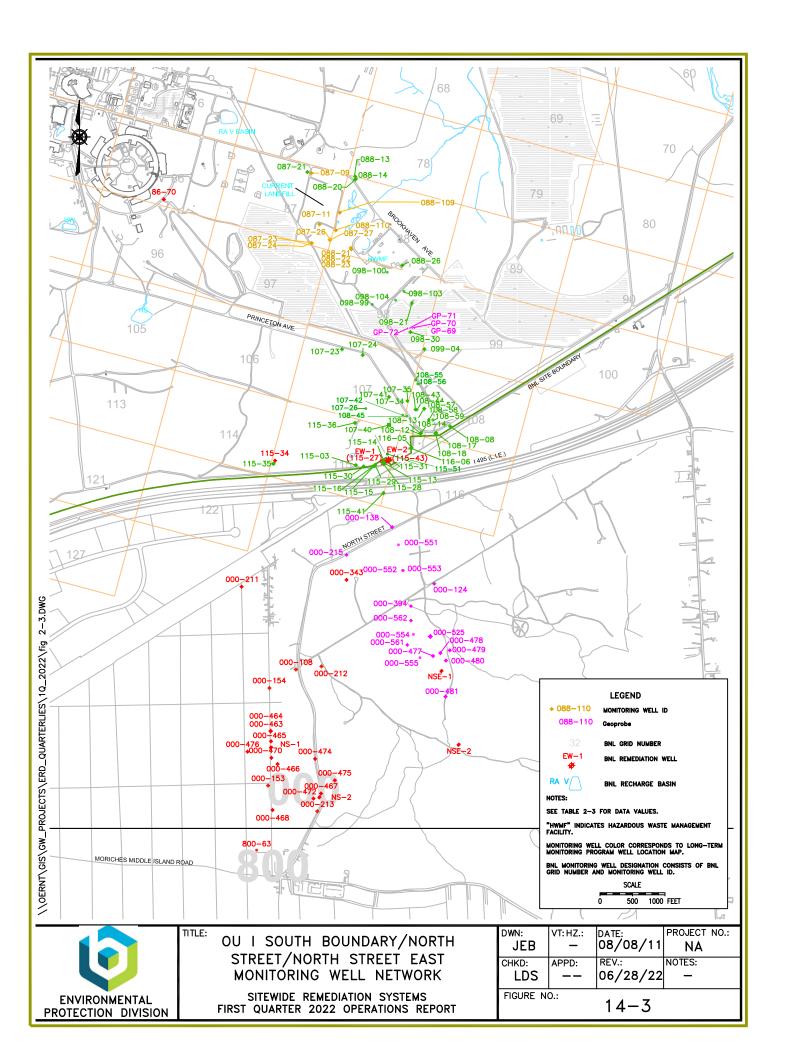

Section 15

Q1-2022 Operations Summary OU III North Street East Pump & Treat System

Process: Groundwater extraction and liquid phase granular activated carbon

treatment, with discharge to injection wells.

Goal: Reach Maximum Contaminant Levels (MCLs) in core monitoring wells

within 30 years for the Upper Glacial aquifer (by 2030).

Start Date: June 2004



Table 15-1
OU III North Street East Pump & Treat System
Pumping Rates (gpm)

Extraction Well	NSE-1	NSE-2	NSE-EDB-3	NSE-EDB-4
Site ID #	000-487	000-488	000-561	000-562
Screen Interval (ft bls)	161-191	152-182	195-215	182-202
Desired Flow Rate (GPM)	0	0	100	100
January	0*	0*	114	115
February	0*	0*	76	70
March	0*	0*	118	105
Actual (Avg. over Qtr.)	0*	0*	103	97

Notes: *As documented in the 2019 Groundwater Status Report, the original VOC system (NSE-1 and NSE-2) is administratively closed for its originally designed purpose. NSE-EDB-3 and NSE-EDB-4 began operation in July 2020.

Figure 15-1
OU III North Street East Pump & Treat System
Cumulative Mass Removal of VOCs vs. Time

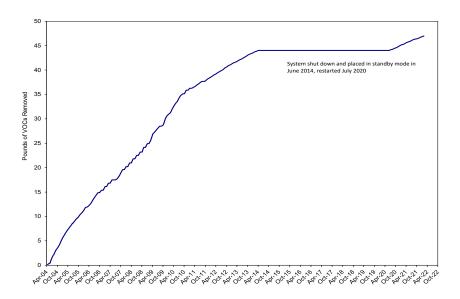


Figure 15-2
OU III North Street East Pump & Treat System
Influent TVOC Concentrations vs. Time

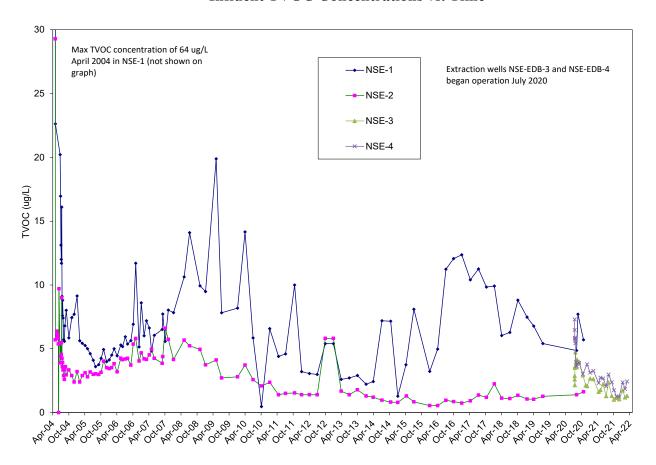


Figure 15-3
OU III North Street East Pump & Treat System
Influent EDB Concentrations vs. Time

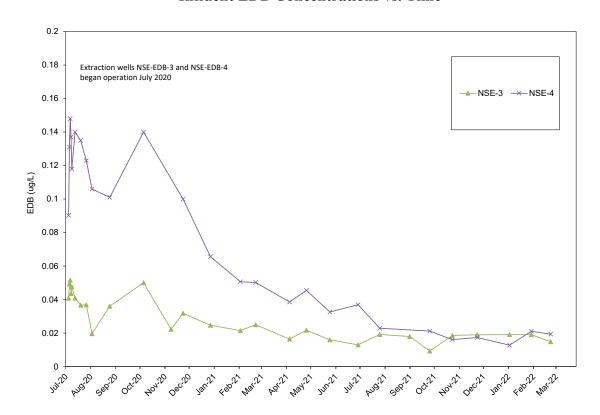


Table 15-2
Effluent Water Quality
SPDES Equivalency Permit Concentrations January 1 – March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	Monitor	329,677	GPD	Continuous
pH (range)	5.5 - 8.5	5.6-5.7	SU	Monthly
Carbon Tetrachloride	5	<0.5	ug/L	Monthly
Chloroform	5	<0.5	ug/L	Monthly
1,1-Dichloroethane	5	<0.5	ug/L	Monthly
1,2-Dichloroethane	0.6	<0.5	ug/L	Monthly

1,1-Dichloroethylene	5	<0.5	ug/L	Monthly
Tetrachloroethylene	5	<0.5	ug/L	Monthly
Toluene	5	<0.5	ug/L	Monthly
1,1,1-Trichloroethane	5	<0.5	ug/L	Monthly
Trichloroethylene	5	<0.5	ug/L	Monthly
Ethylene Dibromide (EDB)	0.03	<0.02	ug/L	Monthly

System Operations

January 2022:

Extraction wells NSE-EDB-3 and NSE-EDB-4 operated normally for the month. The system treated approximately 10 million gallons of water.

February 2023:

Extraction wells NSE-EDB-3 and NSE-EDB-4 were operational. The system sustained a power outage during the last week of the month. The system treated approximately 6 million gallons of water.

March 2022:

Extraction wells NSE-EDB-3 and NSE-EDB-4 operated normally for the month. The system treated approximately 10 million gallons of water.

The system treated approximately 26 million gallons of water during the first quarter of 2022.

Planned Operational Changes

• Continue full time operation of the EDB treatment system and maintain a monthly sampling of extraction wells NSE-EDB-EW-3 and NSE-EDB-EW-4.

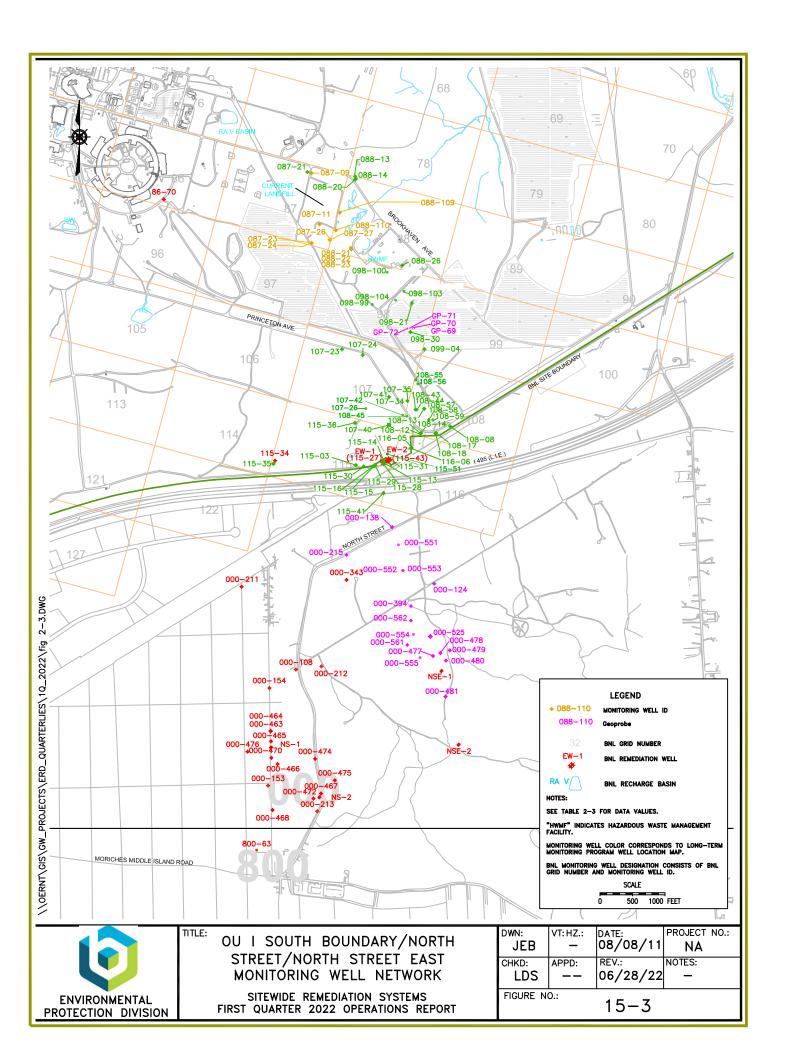


Table 15-3 OU III North Street East Monitoring Well Data 'Hits Only' January through March 2022

Site	ın.	$\alpha \alpha \alpha$	-20/

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
EDB	03/14/2022	0.0391	0.019		UG/L	178.00	10.10	

Site ID: 000-552

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
EDB	03/10/2022	0.124	0.0187	-	UG/L	155.00		

Site ID: 000-553

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
EDB	03/10/2022	0.0237	0.0187		UG/L	175.00		

Site ID: 000-554

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
EDB	03/15/2022	0.287	0.0189	S-2-2	UG/L	195.00		

Site ID: 000-563

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
EDB	03/15/2022	0.0261	0.019		UG/L	197.00		

Site ID: 000-565

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
EDB	03/15/2022	0.0179	0.0189		UG/L	210.00	J	

Site ID: 000-566

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
EDB	03/15/2022	0.0171	0.0188	1	UG/L	210.00	J	

Table 15-4 OU III North Street East Extraction Well Data 'Hits Only' January through March 2022

Site ID: 000-561 (NSE-EDB-3)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/11/2022	1.73	22/		UG/L	0.00		80
Chloroform	01/11/2022	0.74	0.5	122	UG/L	0.00	J	
Methylene chloride	01/11/2022	0.57	0.5		UG/L	0.00	J	
Trichloroethylene	01/11/2022	0.42	0.5		UG/L	0.00	J	
8260 TVOC	02/07/2022	1.19		144	UG/L	0.00		
Chloroform	02/07/2022	0.74	0.5	122	UG/L	0.00	J	
Trichloroethylene	02/07/2022	0.45	0.5		UG/L	0.00	J	
8260 TVOC	03/03/2022	1.32	-		UG/L	0.00		
Chloroform	03/03/2022	0.73	0.5		UG/L	0.00	J	
EDB	03/03/2022	0.0149	0.0194		UG/L	0.00	J	
Methylene chloride	03/03/2022	0.59	0.5		UG/L	0.00	J	

Site ID: 000-562 (NSE-EDB-4)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/11/2022	2.37	22%		UG/L	0.00		
Chloroform	01/11/2022	0.74	0.5		UG/L	0.00	J	
EDB	01/11/2022	0.0128	0.0189		UG/L	0.00	J	
Methylene chloride	01/11/2022	0.56	0.5		UG/L	0.00	J	
Tetrachloroethylene	01/11/2022	0.66	0.5		UG/L	0.00	J	
Trichloroethylene	01/11/2022	0.41	0.5	-22	UG/L	0.00	J	
8260 TVOC	02/07/2022	1.85			UG/L	0.00		
Chloroform	02/07/2022	0.77	0.5		UG/L	0.00	J	
EDB	02/07/2022	0.0211	0.0186		UG/L	0.00		
Tetrachloroethylene	02/07/2022	0.67	0.5		UG/L	0.00	J	
Trichloroethylene	02/07/2022	0.41	0.5		UG/L	0.00	J	
8260 TVOC	03/03/2022	2.44		7	UG/L	0.00		
Chloroform	03/03/2022	0.75	0.5		UG/L	0.00	J	
EDB	03/03/2022	0.0194	0.019	-22	UG/L	0.00		
Methylene chloride	03/03/2022	0.58	0.5		UG/L	0.00	J	
Tetrachloroethylene	03/03/2022	0.74	0.5		UG/L	0.00	J	
Trichloroethylene	03/03/2022	0.37	0.5		UG/L	0.00	J	

Table 15-5 OU III North Street East Influent Data 'Hits Only' January through March 2022

Site ID: 000-441 (Combined Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/11/2022	2.24	Det. Lillin		UG/L	0.00	Quai	Quai
Chloroform	01/11/2022	0.74	0.5		UG/L	0.00	J	
EDB	01/11/2022	0.00999	0.0187		UG/L	0.00	J	
Methylene chloride	01/11/2022	0.54	0.5		UG/L	0.00	J	9
Tetrachloroethylene	01/11/2022	0.51	0.5	773	UG/L	0.00	J	
Trichloroethylene	01/11/2022	0.45	0.5		UG/L	0.00	J	
8260 TVOC	02/07/2022	1.51			UG/L	0.00	3	
Chloroform	02/07/2022	0.72	0.5		UG/L	0.00	J	9
EDB	02/07/2022	0.0172	0.019		UG/L	0.00	J	
Tetrachloroethylene	02/07/2022	0.44	0.5		UG/L	0.00	J	
Trichloroethylene	02/07/2022	0.35	0.5		UG/L	0.00	J	
8260 TVOC	03/03/2022	2.17			UG/L	0.00	44	2
Chloroform	03/03/2022	0.76	0.5		UG/L	0.00	J	
EDB	03/03/2022	0.0161	0.0187		UG/L	0.00	J	
Methylene chloride	03/03/2022	0.54	0.5		UG/L	0.00	J	
Tetrachloroethylene	03/03/2022	0.5	0.5		UG/L	0.00	J	9
Trichloroethylene	03/03/2022	0.37	0.5	(77)	UG/L	0.00	J	

Table 15-6 OU III North Street East Effluent Data 'Hits Only' January through March 2022

Site ID: 000-444 (System Effluent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/11/2022	0.63	-		UG/L	0.00		
EDB	01/11/2022	0.0188	0.0188		UG/L	0.00	U	
EDB	01/11/2022	0.5	0.5		UG/L	0.00	U	
Methylene chloride	01/11/2022	0.63	0.5		UG/L	0.00	J	
8260 TVOC	02/07/2022	1.62			UG/L	0.00		
EDB	02/07/2022	0.0189	0.0189		UG/L	0.00	U	
EDB	02/07/2022	0.5	0.5	-22	UG/L	0.00	U	
Methylene chloride	02/07/2022	1.62	0.5		UG/L	0.00	J	
8260 TVOC	03/03/2022	0.94	-		UG/L	0.00		
Chloroform	03/03/2022	0.38	0.5		UG/L	0.00	J	
EDB	03/03/2022	0.0192	0.0192		UG/L	0.00	U	
EDB	03/03/2022	0.5	0.5		UG/L	0.00	U	
Methylene chloride	03/03/2022	0.56	0.5		UG/L	0.00	J	

Qualifiers:

J = Estimated value.

 $\label{eq:defD} D = Compound \ was \ identified \ in \ an \ analysis \ at \ a \ secondary \ dilution \ factor.$

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 16

Q1-2022 Operations Summary OU III LIPA/Airport Treatment System

Process: Groundwater extraction and liquid phase granular activated carbon

treatment, with discharge to injection wells.

Goal: Reach Maximum Contaminant Levels (MCLs) in core monitoring wells

within 30 years for the Upper Glacial aquifer (by 2030), and within 65

years for the Magothy aquifer (by 2065).

Start Date: August 2004



Table 16-1 OU III LIPA/Airport Treatment System Pumping Rates (gpm)

Extraction Well	EW-1L	EW-2L	EW-3L	EW-4L*	RTW-1A	RTW-2A	RTW-3A	RTW-4A*	RTW-5A	RW-6A
Site ID	000-453	000-455	000-457	000-461	800-109	800-110	800-111	800-112	800-113	800-132
Screen Interval (ft bls)	217-237	224-244	216-236	304-324	188-208	188-208	210-230	268-288	220-240	165-185
Desired Flow Rate (GPM)	0**	0**	0**	0**	100	0	0	100	0***	200
January	0	0	0	0	97	0	0	139	0	145
February	0	0	0	0	104	0	0	140	0	156
March	0	0	0	0	122	0	0	160	0	183
Actual (Avg. over QTR.)	0	0	0	0	108	0	0	146	0	161

^{*} EW-4L and RTW-4A are Magothy aquifer extraction wells.

^{**} EW-1L, EW-2L, EW-3L and EW-4L are in standby mode. EW-4L was put in standby January 2017. RTW-2A and RTW-3A were placed in standby mode in March 2020.

^{***}RTW-5A was placed in standby mode in September 2016.

Figure 16-1 OU III LIPA/ Airport Treatment System Cumulative Mass Removal of VOCs vs. Time

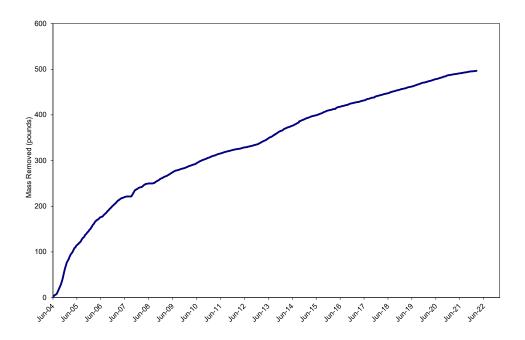


Figure 16-2 OU III LIPA/ Airport Treatment System Influent TVOC Concentrations vs. Time

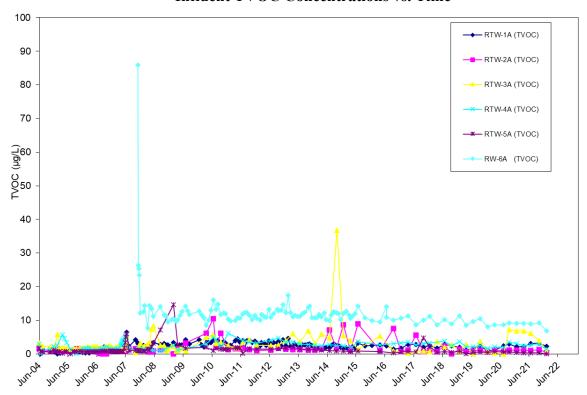


Figure 16-3 OU III LIPA/ Airport Treatment System Influent TVOC Concentrations vs. Time

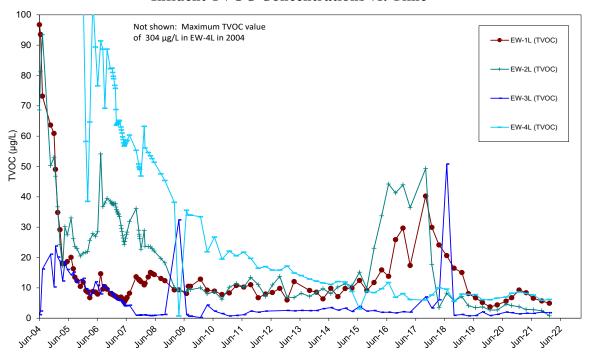


Table 16-2
Effluent Water Quality
SPDES Equivalency Permit Concentrations January 1 – March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	Monitor	671,647 ¹	GPD	Continuous
pH (range)	5.5 – 7.5	5.5-5.9	SU	Monthly
Carbon Tetrachloride	5	<0.50	ug/L	Monthly
Chloroform	7	<0.50	ug/L	Monthly
1,1-Dichloroethane	5	<0.50	ug/L	Monthly
1,1-Dichloroethylene	5	<0.50	ug/L	Monthly
Methylene Chloride	5	<0.50	ug/L	Monthly
1,1,1-Trichloroethane	5	<0.50	ug/L	Monthly
Trichloroethylene	10	<0.50	ug/L	Monthly

¹ The average flow for the operational period at the influent flow meter.

System Operations

January 2022:

Extraction wells RTW-1A, RTW-4A, and RW-6A ran normally for the month except for a carbon change-out on the lead vessel that occurred on January 13th. The four LIPA extraction wells and Airport extraction wells RTW-2A, RTW-3A, and RTW-5A remained in standby mode. The system treated approximately 17 million gallons of water.

February 2022:

Extraction wells RTW-1A, RTW-4A and RW-6A ran normally for the month. The four LIPA extraction wells and Airport extraction wells RTW-2A, RTW-3A, and RTW-5A remained in standby mode. The system treated approximately 16 million gallons of water.


March 2022:

Extraction wells RTW-1A, RTW-4A and RW-6A ran normally for the month. The four LIPA extraction wells and Airport extraction wells RTW-2A, RTW-3A, and RTW-5A remained in standby mode. The system treated approximately 20 million gallons of water.

The system treated approximately 53 million gallons of water during the first quarter of 2022.

Planned Operational Changes

- Continue full time operation of Airport extraction wells RTW-1A, RTW-4A and RTW-6A. Maintain wells RTW-2A, RTW-3A and RTW-5A in standby mode. If TVOC concentrations above the capture goal of 10 µg/L are observed in any of the extraction wells or the monitoring wells adjacent to wells that are not operating, the well(s) will be put back into full-time operation. During the first quarter of 2022, extraction wells RTW-2A, RTW-3A, RTW-5A, and adjacent monitoring wells did not exceed TVOC concentrations of 10 µg/L.
- Maintain LIPA wells EW-1, EW-2, EW-3L and EW-4L in standby mode. These extraction wells may be restarted if TVOC concentrations rebound above the 50 μg/L capture goal in either the plume core monitoring wells or the extraction wells. During the first quarter of 2022, none of the LIPA monitoring wells or extraction wells detected TVOCs above the capture goal of 50 μg/L.
- Increase the sampling frequency for the 17 LIPA monitoring wells to quarterly in an effort to support the decision for a petition for closure. Based upon the low VOC concentrations for the past several years, submit a Petition for Closure of the LIPA system.

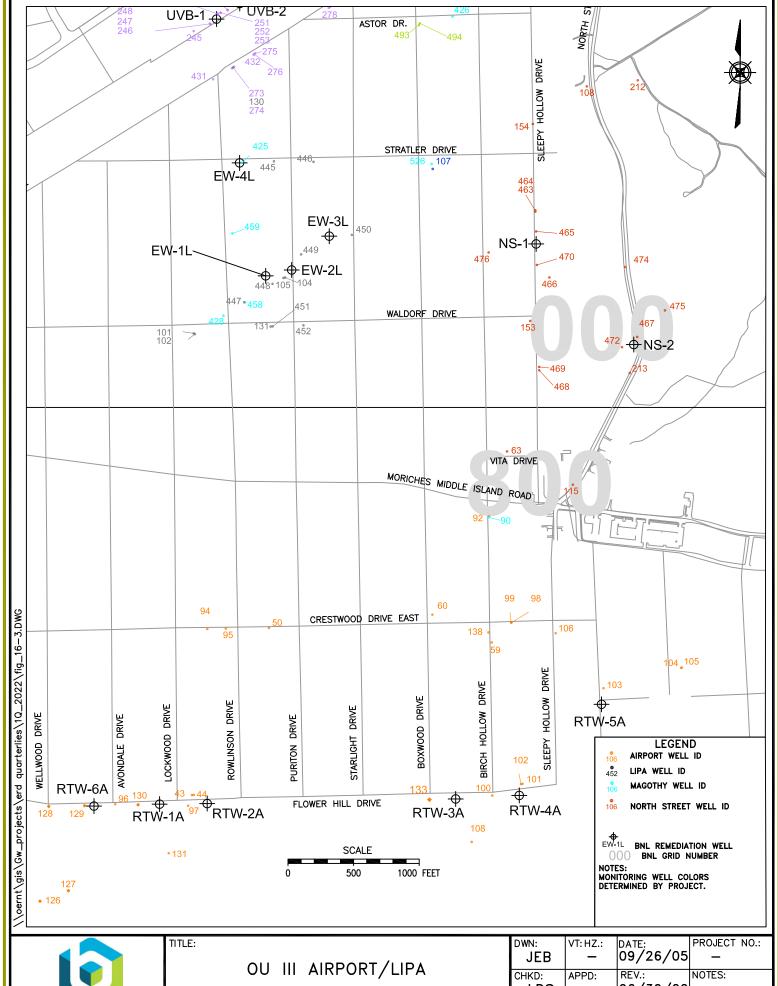

ENVIRONMENTAL PROTECTION DIVISION

SITEWIDE REMEDIATION SYSTEMS FIRST QUARTER 2022 OPERATIONS REPORT

DWN:	VT: HZ.:	DATE:	PROJECT NO.:
JEB	_	09/26/05	_
CHKD:			NOTES:
LDS		06/30/22	_
FIGURE N	0.:	16-3	

Table 16-3 OU III LIPA/Airport Monitoring Well Data 'Hits Only' January through March 2022

Site ID: 800-108

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/28/2022	0.24	1	-	UG/L	216.00	33	
Chloroform	03/28/2022	0.24	0.5	7020	UG/L	216.00	J	

Site ID: 800-131

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/21/2022	1.02	-	1	UG/L	194.00	200	
Carbon tetrachloride	03/21/2022	0.6	0.5	-	UG/L	194.00	26	20
Chloroform	03/21/2022	0.42	0.5	76 <u>22</u> 36	UG/L	194.00	J	8

Site ID: 800-133

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/28/2022	1.35		00	UG/L	225.00	2.	
1,1,1-Trichloroethane	03/28/2022	0.25	0.5		UG/L	225.00	J	
Chloroform	03/28/2022	1.1	0.5		UG/L	225.00	300	98

Site ID: 800-60

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	03/21/2022	0.57	-	-	UG/L	210.00	2.	
Chloroform	03/21/2022	0.57	0.5	-	UG/L	210.00	8	2

Table 16-4 OU III LIPA/Airport Extraction Well Data 'Hits Only' January through March 2022

Site ID: 000-453 (EW-1L)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	4.91		7722	UG/L	227.00	2	8 80790
1,1,1-Trichloroethane	01/26/2022	1.7	0.5	10-50	UG/L	227.00		
1,1-Dichloroethylene	01/26/2022	1.6	0.5		UG/L	227.00	-	10
Chloroform	01/26/2022	0.18	0.5		UG/L	227.00	J	48
Toluene	01/26/2022	0.81	0.5		UG/L	227.00	53	3
Trichloroethylene	01/26/2022	0.62	0.5		UG/L	227.00		8

Site ID: 000-455 (EW-2L)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	0.81	440		UG/L	234.00	2	3
1,1,1-Trichloroethane	01/26/2022	0.4	0.5	1221	UG/L	234.00	J	96
Trichloroethylene	01/26/2022	0.41	0.5		UG/L	234.00	J	

Site ID: 000-457 (EW-3L)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	1.8	-	1	UG/L	226.00	89	
Chloroform	01/26/2022	1.8	0.5	8 <u>22</u> 8	UG/L	226.00	35	% · · · ·

Site ID: 000-461 (EW-4L)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	6.17	-		UG/L	314.00		
Carbon tetrachloride	01/26/2022	0.92	0.5	-	UG/L	314.00		
Chloroform	01/26/2022	0.68	0.5		UG/L	314.00		
Tetrachloroethylene	01/26/2022	3.6	0.5		UG/L	314.00	5	
Trichloroethylene	01/26/2022	0.97	0.5	1075	UG/L	314.00	30	

Site ID: 800-109 (RTW-1A)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	2.25			UG/L	198.00	30	400
Carbon tetrachloride	01/26/2022	1.4	0.5	722	UG/L	198.00	5	
Chloroform	01/26/2022	0.56	0.5	10750	UG/L	198.00	30	
Trichloroethylene	01/26/2022	0.29	0.5		UG/L	198.00	J	

Site ID: 800-110 (RTW-2A)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	0.5	-	-	UG/L	198.00	36	94 TATE IN THE
Carbon tetrachloride	01/26/2022	0.31	0.5		UG/L	198.00	J	
Chloroform	01/26/2022	0.19	0.5	20	UG/L	198.00	J	

Table 16-4 OU III LIPA/Airport Extraction Well Data 'Hits Only' January through March 2022

Site ID: 800-111 (RTW-3A)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	1.16		77-27	UG/L	220.00	35	60
1,1,1-Trichloroethane	01/26/2022	0.25	0.5		UG/L	220.00	J	8
Carbon tetrachloride	01/26/2022	0.28	0.5		UG/L	220.00	J	
Chloroform	01/26/2022	0.26	0.5		UG/L	220.00	J	to the second
Trichloroethylene	01/26/2022	0.37	0.5		UG/L	220.00	J	88

Site ID: 800-112 (RTW-4A)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	1.41			UG/L	278.00		
Chloroform	01/26/2022	0.52	0.5	-	UG/L	278.00	200	
Trichloroethylene	01/26/2022	0.89	0.5		UG/L	278.00	55	66 5

Site ID: 800-132 (RTW-6A)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	6.86		-	UG/L	175.00		
Carbon tetrachloride	01/26/2022	1.8	0.5		UG/L	175.00	95	-
Chloroform	01/26/2022	0.36	0.5	-	UG/L	175.00	J	3
Trichloroethylene	01/26/2022	4.7	0.5		UG/L	175.00	35	- 1

Table 16-5 OU III LIPA/Airport Influent Data 'Hits Only' January through March 2022

Site ID: 800-122 (Combined Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	2.51	(UG/L	0.00		
Carbon tetrachloride	01/26/2022	0.74	0.5		UG/L	0.00	-	20 0
Chloroform	01/26/2022	0.37	0.5		UG/L	0.00	J	
Trichloroethylene	01/26/2022	1.4	0.5		UG/L	0.00	- 5	
8260 TVOC	02/07/2022	3.55			UG/L	0.00		
Carbon tetrachloride	02/07/2022	1	0.5		UG/L	0.00		
Chloroform	02/07/2022	0.35	0.5		UG/L	0.00	J	
Trichloroethylene	02/07/2022	2.2	0.5		UG/L	0.00	2.	
8260 TVOC	03/12/2022	4.22			UG/L	0.00		
1,1-Dichloroethylene	03/12/2022	0.19	0.5		UG/L	0.00	J	in the second
Carbon tetrachloride	03/12/2022	1.1	0.5		UG/L	0.00		88
Chloroform	03/12/2022	0.73	0.5		UG/L	0.00	5.	
Trichloroethylene	03/12/2022	2.2	0.5		UG/L	0.00		

Table 16-6 OU III LIPA/Airport Effluent Data 'Hits Only' January through March 2022

Site ID: 800-124 (System Effluent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/26/2022	0	/	1	UG/L	0.00	3	3
8260 TVOC	02/07/2022	0	122	220	UG/L	0.00	35	46
8260 TVOC	03/12/2022	0.17	1877	775	UG/L	0.00		
Chloroform	03/12/2022	0.17	0.5		UG/L	0.00	J	

Qualifiers:

- J = Estimated value.
- D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 17

Q1-2022 Operations Summary OU III Strontium-90 BGRR/WCF Treatment System

Process: Groundwater extraction with liquid phase granular activated carbon

treatment for volatile organic compounds, followed by clinoptilolite zeolite treatment for the removal of Sr-90, with discharge to dry wells.

Goal: Reach Maximum Contaminant Levels (MCLs) in core monitoring wells

within 70 years for the Upper Glacial aquifer (by 2070).

Start Date: June 2005



Table 17-1
OU III Strontium-90 BGRR/WCF Treatment System
Pumping Rates (gpm)

Extraction Well	SR-1	SR-2	SR-3*	SR-4*	SR-5*	SR-6*	SR-7*	SR-8*	SR-9
Site Id #	065- 368	065- 369	075- 676	075- 677	075- 678	065- 403	075- 702	075- 703	075- 704
Screen Interval (ft bls)	33-53	33.5- 53.5	51-71	35-75	35-75	85-105	82-102	77-97	67-87
Desired Flow Rate (gpm)	5	5	5	5	5	10	10	10	10
January (Avg gpm)	4.3	4.3	4.3	0	0	0	0	9.2	8.5
February "	5.4	5.4	4.7	0	0	0	0	0	10
March "	5.4	5.4	5.6	0	0	0	0	11.1	10
Actual (Avg. over Qtr.)	5.0	5.0	4.9	0	0	0	0	6.8	9.5

*Wells SR-4 and SR-5 were placed in standby mode in September 2016. Well SR-6 was placed in standby mode in October 2017. Wells SR-3 and SR-7 were placed in standby mode October 2018. Well SR-8 was placed in pulsed pumping mode in October 2018. Well SR-3 was put back in operation in February 2019.

Figure 17-1 Strontium-90 BGRR/WCF Treatment System Cumulative Millicuries Removed

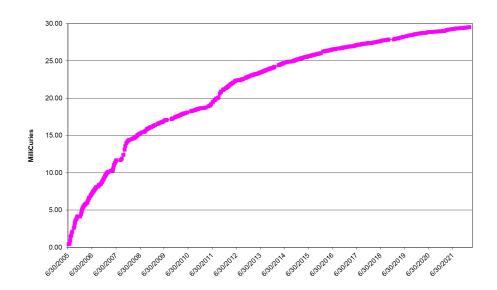


Figure 17-2 Strontium-90 BGRR/WCF Treatment System Influent Sr-90 Concentrations vs. Time

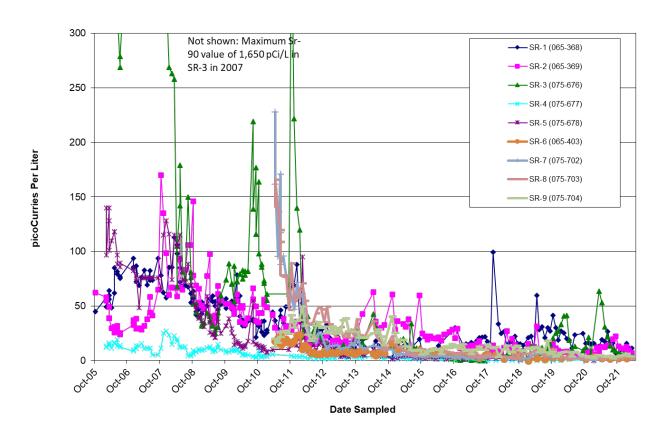


Table 17-2 Strontium-90 BGRR/WCF Treatment System Effluent Water Quality SPDES Equivalency Permit Concentrations January 1, 2022 – March 31, 2022

Parameter	Permit Limit	Max. Measured Value	Units	Frequency
Flow	75	37	GPM	Continuous
pH (range)	5.5 – 8.5	6.2-6.7	SU	Weekly
Strontium-90	8.0	2.8	PCi/L	Monthly ¹
Chloroform	7.0	<0.5	ug/L	Monthly ¹
1,1-Dichloroethane	5.0	<0.5	ug/L	Monthly ¹
Ethylbenzene	5.0	<0.5	ug/L	Monthly ¹
Methyl Chloride	5.0	<0.5	ug/L	Monthly ¹
Methylene Chloride	5.0	1.44	ug/L	Monthly ¹
Toluene	5.0	<0.5	ug/L	Monthly ¹
1,2,3-Trichlorobenzene	5.0	<0.5	ug/L	Monthly ¹
1,1,1-Trichloroethane	5.0	<0.5	ug/L	Monthly ¹
1,2,4-Trimethylbenzene	5.0	<0.5	ug/L	Monthly ¹
Xylene, total	10.0	<0.5	ug/L	Monthly ¹

¹ The minimum measurement frequency shall be monthly following a period of 24 consecutive weekly sampling events showing no exceedances of the stated discharge limitations.

System Operations

January 2022:

The system was off for four days due to electrical issues. The system treated approximately 1.3 million gallons of water.

February 2022:

The system ran normally for the month. Well SR-8 was off for pulsed-pumping. The system treated approximately 1.1 million gallons of water.

² Not detected.

March 2022:

The system ran normally for the month. The system treated approximately 1.6 million gallons of water.

Extraction wells SR-4 through SR-7 were off in stand-by mode for this quarter. The system treated approximately 4.0 million gallons of water during the first quarter of 2022.

As a follow-up to temporary wells installed in 2018, two additional temporary wells were installed in the first quarter of 2022 as part of an effort to track the migration of Sr-90 from the BGRR/WCF. The maximum Sr-90 concentration in the two temporary wells was 26 pCi/L in BGRR-GP-171. The temporary well locations are shown on Figure 17-3 and the data is presented and discussed in greater detail in the 2021 Groundwater Status Report.

Planned Operational Changes

- Continue operating wells SR-1 and SR-2 in full time mode, and maintain wells SR-4, SR-5, SR-6 and SR-7 in standby mode. If significant rebound occurs, place these extraction wells back in full time operation. Sr-90 concentrations in SR-4, SR-5, SR-6 and SR-7 have remained below the drinking water standard (DWS) since May 2016.
- Place extraction well SR-3 in standby mode following return to low Sr-90 concentrations in this well and source area monitoring well 075-701 in 2021 and the first quarter of 2022. The last Sr-90 detection above the DWS for SR-3 or 075-701 was in SR-3 in September 2021.
- Place extraction well SR-8 in standby mode as Sr-90 concentrations in this well have remained below the DWS since 2019.
- Place extraction well SR-9 in pulsed pumping mode based on Sr-90 concentrations remaining below DWS since June 2020.
- Complete the temporary well plume characterization along east-west transects immediately south of the HFBR and at Temple Place.



Table 17-3 OU III Strontium-90 BGRR/WCF Monitoring Well Data 'Hits Only' January through March 2022

Site ID: 075-664

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/13/2022	0.868	0.399	0.31	PCI/L	70.00	9	50:
Strontium-90	03/07/2022	2.26	0.769	0.617	PCI/L	68.00		21-

Site ID: 075-701

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/13/2022	5.16	1.3	0.929	PCI/L	58.00		57.
Strontium-90	02/11/2022	0.693	0.623	0.418	PCI/L	58.00	J	i i
Strontium-90	03/07/2022	1.89	0.794	0.625	PCI/L	58.00		

Table 17-4

OU III Strontium-90 BGRR/WCF Extraction Well Data 'Hits Only' January through March 2022

Site ID: 065-368 (SR-1)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/17/2022	15.6	1.05	1.08	PCI/L	0.00		20
Strontium-90	02/10/2022	11.5	2.14	1.49	PCI/L	0.00		25
Strontium-90	03/12/2022	11.5	0.787	1.08	PCI/L	0.00	- 37	(6

Site ID: 065-369 (SR-2)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/17/2022	12.7	0.653	0.717	PCI/L	0.00		
Strontium-90	02/10/2022	9.67	1.01	0.825	PCI/L	0.00	· /8	114
Strontium-90	03/12/2022	6.92	0.783	0.883	PCI/L	0.00		10

Site ID: 065-403 (SR-6)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/17/2022	2.01	0.839	0.539	PCI/L	0.00		

Site ID: 075-676 (SR-3)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/17/2022	5.08	1.01	0.702	PCI/L	0.00		
Strontium-90	02/10/2022	3.49	0.889	0.639	PCI/L	0.00	- 8	(6
Strontium-90	03/12/2022	3.94	0.769	0.716	PCI/L	0.00	(C. 18)	317

Site ID: 075-677 (SR-4)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/17/2022	1.93	0.683	0.459	PCI/L	0.00		

Site ID: 075-678 (SR-5)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/17/2022	4.48	1.18	0.823	PCI/L	0.00		i.

Site ID: 075-702 (SR-7)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/17/2022	3.35	0.692	0.491	PCI/L	0.00		

Site ID: 075-703 (SR-8)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/17/2022	3.54	0.933	0.624	PCI/L	0.00	0)	(6
Strontium-90	03/12/2022	1.84	0.794	0.605	PCI/L	0.00) N	

Site ID: 075-704 (SR-9)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	01/17/2022	6.49	0.973	0.744	PCI/L	0.00	- 22	
Strontium-90	02/10/2022	4.28	1.47	0.969	PCI/L	0.00	0)	(6

Table 17-4
OU III Strontium-90 BGRR/WCF Extraction Well Data
'Hits Only' January through March 2022

Site ID: 075-704 (SR-9)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
Strontium-90	03/12/2022	3.92	0.759	0.747	PCI/L	0.00		

Table 17-5 OU III Strontium-90 BGRR/WCF Influent Data 'Hits Only' January through March 2022

Site ID: 066-216 (Combined Influent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/14/2022	0.94	440	##	UG/L	0.00		
1,1,1-Trichloroethane	01/14/2022	0.39	0.5	220	UG/L	0.00	J	Ce
Methylene chloride	01/14/2022	0.55	0.5	2003	UG/L	0.00	J	
Strontium-90	01/14/2022	4.34	0.692	0.556	PCI/L	0.00		
8260 TVOC	02/10/2022	1.89	(43)	#40	UG/L	0.00		Para la companya di managara d
1,1,1-Trichloroethane	02/10/2022	0.36	0.5	229	UG/L	0.00	J	
Methylene chloride	02/10/2022	1.53	0.5	2004	UG/L	0.00	J	
Strontium-90	02/10/2022	5.37	0.622	0.473	PCI/L	0.00		
8260 TVOC	03/12/2022	0.43	489	##0	UG/L	0.00		
1,2,4-Trichlorobenzene	03/12/2022	0.43	0.5	229	UG/L	0.00	J	(e
Strontium-90	03/12/2022	6.09	0.789	0.844	PCI/L	0.00	(1)	

Table 17-6 OU III Strontium-90 BGRR/WCF Effluent Data 'Hits Only' January through March 2022

Site ID: 066-219 (System Effluent)

Chemical	Sample Date	Value	Det. Limit	Error	Units	Depth	Lab Qual	Review Qual
8260 TVOC	01/14/2022	0			UG/L	0.00		
Strontium-90	01/14/2022	1.92	0.79	0.518	PCI/L	0.00	- 00	£6
8260 TVOC	02/10/2022	1.44	223	223	UG/L	0.00	*	
Methylene chloride	02/10/2022	1.44	0.5	T-1	UG/L	0.00	J	
Strontium-90	02/10/2022	0.692	0.71	0.431	PCI/L	0.00	U	111
8260 TVOC	03/12/2022	0.94	1929	623	UG/L	0.00	- 00	10
1,2,4-Trichlorobenzene	03/12/2022	0.37	0.5	223	UG/L	0.00	J	
Methylene chloride	03/12/2022	0.57	0.5	155	UG/L	0.00	J	
Strontium-90	03/12/2022	2.8	0.979	0.665	PCI/L	0.00		

Qualifiers:

J = Estimated value.

D = Compound was identified in an analysis at a secondary dilution factor.

Organic Compounds:

B = Compound was found in both the sample And associated laboratory blank.

Inorganic Compounds:

B = Result Is between instrument detection limit And contract required reporting limit.

Section 18

Q-1 2022 Quarterly Monitoring Summary g-2 Source Area and Tritium Plume

1.0 Background

In November 1999, tritium was detected in the groundwater near the g-2 experiment at concentrations above the 20,000 pCi/L maximum contaminant level (MCL). Sodium-22 was also detected in the groundwater, but at concentrations well below the 400 pCi/L MCL. An investigation into the source of the contamination revealed that the tritium and sodium-22 originated from activated soil shielding located adjacent to the g-2 target building. Rainwater was able to infiltrate the activated soils and carry the tritium and sodium-22 into the groundwater. To prevent additional rainwater infiltration into the activated soil shielding, a concrete cap was constructed over the soil shielding in December 1999.

Following the concurrence of the NYSDEC, a Record of Decision (ROD) was signed by the U.S. DOE and U.S. EPA in early 2007. This ROD requires continued routine inspection and maintenance of the impermeable cap, groundwater monitoring of the source area to verify the continued effectiveness of the storm water controls and monitoring the tritium plume until it attenuates to less than the 20,000 pCi/L MCL.

2.0 Monitoring Activities

Surveillance of groundwater quality is accomplished using five wells located immediately downgradient of the source area, and 10 wells located further downgradient, southeast of AGS facility Building 912. The monitoring frequency for five wells located immediately downgradient of the source area wells is semi-annual, with samples collected during the 2nd and 4th quarters of the year. The 10 wells located downgradient of Building 912 are sampled during the 4th quarter.

Source Area Monitoring Results:

No samples were collected during the 1st Quarter. During the 4th Quarter 2021 sampling period, the maximum tritium concentration in source area monitoring wells was 6,390 pCi/L in well 054-124 (Figure 18-1). The overall reductions in tritium concentrations observed in source area monitoring wells indicate that the cap is effectively preventing rainwater infiltration into the activated soil shielding and the amount of residual tritium that is available to be flushed out of the deep vadose zone is decreasing.

3.0 Recommendations

- Continue to sample the five monitoring wells directly downgradient of the source area (near Building 912A) semiannually (2nd and 4th Quarters), and the 10 wells located near Building 912 annually (4th Quarter).
- Continue scheduled inspections and perform required maintenance of the g-2 cap.
- Monitoring results will be communicated to the regulatory agencies via quarterly and annual reports.

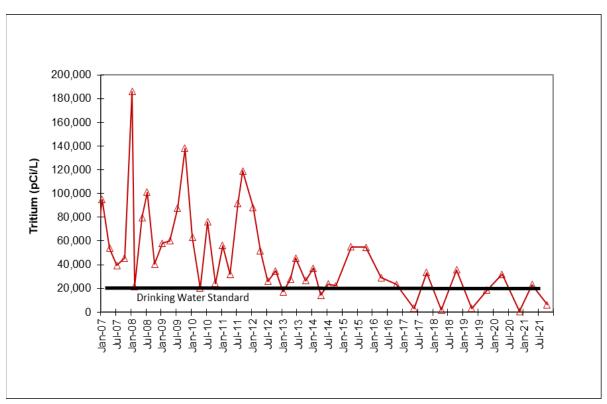


Figure 18-1. Maximum tritium concentrations observed from January 2007 through October 2021 in groundwater downgradient of the g-2 source area.

Section 19

Q-1 2022 Quarterly Monitoring Summary BLIP Source Area

1.0 Background

The Brookhaven Linac Isotope Producer (BLIP) is an active accelerator facility located in the central portion of the site. The BLIP facility has been in operation since 1972 and is a national resource for producing the radioisotopes that are crucial in nuclear medicine for both research and clinical use. BLIP also supports BNL's research on diagnostic and therapeutic radiopharmaceuticals.

Beam line operations have resulted in the activation of soils that surround the BLIP target vessel. These activated soils are approximately 30 feet below the BLIP building, in a small zone surrounding the target vessel. In 1998, low levels of tritium were detected in the groundwater near the BLIP facility experiment at concentrations of approximately three times the 20,000 pCi/L MCL. Sodium-22 was also detected in the groundwater, but the levels were less than the 400 pCi/L MCL. Corrective actions were implemented in 1998 to prevent additional rainwater from entering the activated soil. These included repairing and reconfiguring the building's roof gutters and downspouts, resealing the paved areas south of the building, and installing a concrete cap in the remaining areas around the building. In 2000, a colloidal silica grout was injected into the activated soil to further immobilize the tritium and sodium-22, and in 2004 an additional impermeable cap was constructed over the beam line that runs from the Linac to the BLIP facility.

Following the concurrence of the NYSDEC, a Record of Decision (ROD) was signed by the U.S. DOE and U.S. EPA in early 2007. This ROD requires continued routine inspection and maintenance of the impermeable cap and groundwater monitoring to verify the continued effectiveness of the storm water controls.

2.0 Monitoring Activities

Three groundwater monitoring wells are positioned immediately downgradient of the BLIP facility. The wells are currently monitored on a semi-annual basis (during the 2^{nd} and 4^{th} Quarters).

Monitoring Results:

No samples were collected during the 1st Quarter. During the 4th Quarter 2022 sample period, the maximum tritium concentration was detected in downgradient well 064-67 at 806 pCi/L. Since early 2006, tritium concentrations in the groundwater downgradient of BLIP have been continually less than the 20,000 pCi/L MCL (Figure 19-1). The overall reductions in tritium concentrations observed in the source area wells since 2006 indicate that the cap is effectively preventing rainwater infiltration into the activated soil shielding and the amount of residual tritium that is available to be flushed out of the deep vadose zone is decreasing.

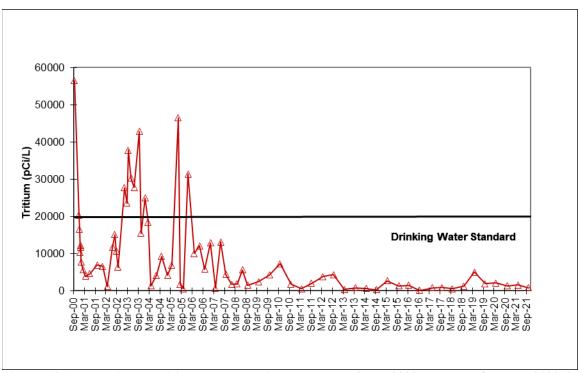


Figure 19-1. Maximum tritium concentrations observed from 2000 through October 2022 in groundwater immediately downgradient of the BLIP Facility.

3.0 Recommendations

The following are recommendations for the BLIP facility:

- Continue monitoring the three wells immediately downgradient of BLIP for tritium on a semiannual basis (2nd and 4th Quarters).
- Continue scheduled inspections and perform required maintenance of the BLIP cap.
- Monitoring results will continue to be communicated to the regulatory agencies via quarterly and annual reports.

Section 20 Q1-2022 Operations Summary OU III Building 452 Freon-11 Pump & Treat System (System Closed)

Process: Groundwater extraction and air stripping treatment, with discharge to a

drainage culvert leading to Recharge Basin HS.

Goal: Remediation of Freon-11 in the groundwater and reach Maximum

Contaminant Levels (MCLs) in core monitoring wells within 30 years for the Upper Glacial aquifer (by 2030). NYSDEC and EPA approved of the

Petition for Closure in August and September 2019, respectively.

Start Date: March 2012



Table 20-1 OU III Building 452 Freon-11 Pump & Treat System Pumping Rate (gpm)

Extraction Well	EW-18
Site Id#	095-316
Screened Interval (feet below grade)	55-65
Desired Flow Rate (GPM)	0*
System Closed	0*

^{*} The system was approved for closure in September 2019.

Figure 20-1
OU III Building 452 Freon-11 Pump & Treat System
Cumulative Mass Removal of Trichlorofluoromethane vs. Time

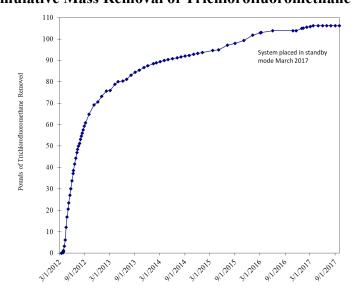


Figure 20-2 OU III Building 452 Freon-11 Pump & Treat System Influent Trichlorofluoromethane Concentrations vs. Time

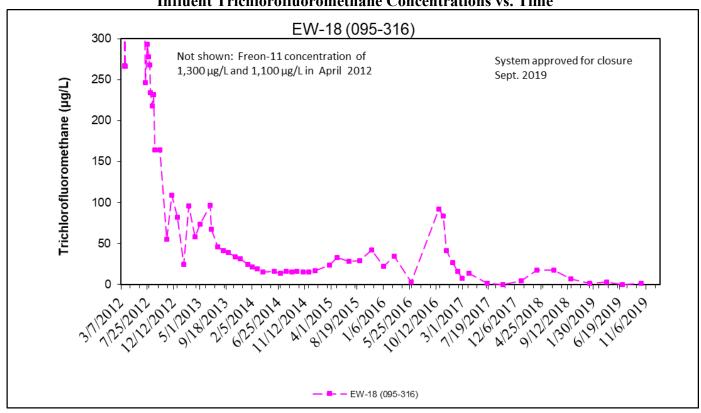


Table 20-2 Effluent Water Quality SPDES Equivalency Permit Concentrations (System Closed)

Parameter	Permit Limit	Max. Measured Value	Units	Frequency*
Flow	120	NA	GPM	Continuous
pH (range)	5.0 - 8.5	NA	SU	Weekly
Benzene	1.0	NA	ug/L	Monthly
Bromodichloromethane	50	NA	ug/L	Monthly
Carbon Tetrachloride	5.0	NA	ug/L	Monthly
Chloroform	7.0	NA	ug/L	Monthly
Dichlorodifluoromethane	5.0	NA	ug/L	Monthly
1,1-Dichloroethylene	5.0	NA	ug/L	Monthly
4-Isopropyltoluene	5.0	NA	ug/L	Monthly
Methyl Chloride	5.0	NA	ug/L	Monthly
Methylene Chloride	5.0	NA	ug/L	Monthly
Tetrachloroethylene	5.0	NA	ug/L	Monthly
Toluene	5.0	NA	ug/L	Monthly
1,2,3-Trichlorobenzene	5.0	NA	ug/L	Monthly
1,1,1-Trichloroethane	5.0	NA	ug/L	Monthly
Trichlorofluoromethane	5.0	NA	ug/L	Monthly
1,2,4-Trimethylbenzene	5.0	NA	ug/L	Monthly
Xylene (meta + para)	10.0	NA	ug/L	Monthly

NA = Not analyzed. The system is closed.

Note: Starting in June 2019, the flow from Bldg. 96 RTW-1 was increased to 60 gallons per minute and the water is being treated at the Building 452 Freon-11 treatment system due to the larger capacity of this system. Beginning with the July 2019 Discharge


Monitoring Report (DMR), the RTW-1 discharge is formally reported under the Freon-11 Equivalency Permit.

System Operations

Treatment for the former Freon-11 plume is complete. The air stripping treatment system is being used to treat the water from Building 96 extraction well RTW-1.

Planned Operational Changes

- Postpone decisions to abandon extraction well EW-18 and the remaining monitoring
 wells until the PFAS plume originating from the former firehouse area has been fully
 characterized and a determination is made on their utilization related to emerging
 contaminants.
- Maintain full-time operation of the Building 96 treatment well RTW-1. Continue to report the RTW-1 discharge under the Freon-11 equivalency permit discharge monitoring report.

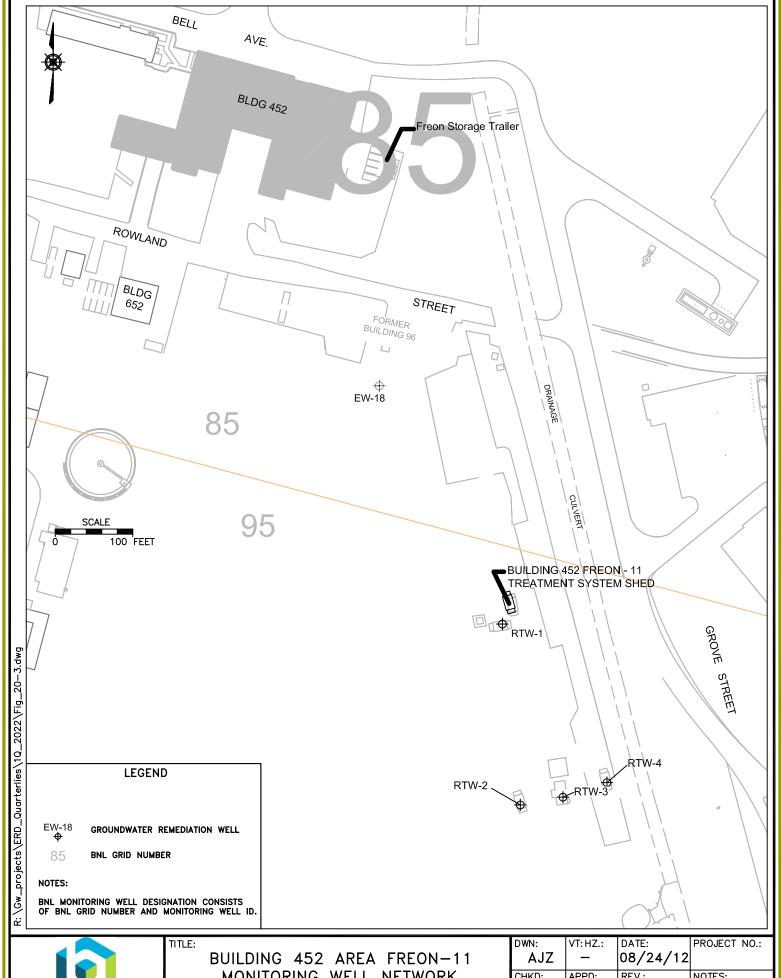



MONITORING WELL NETWORK

SITEWIDE REMEDIATION SYSTEMS FIRST QUARTER 2022 OPERATIONS REPORT

TES: