


Date (mm-dd-yyyy)	Issued For	Rev.
03-28-2008	TITLE II DESIGN 60% REVIEW SUBMITTAL	D
07-31-2008	TITLE II DESIGN 90% REVIEW SUBMITTAL	E
08-25-2008	TITLE II DESIGN 100% OWNER REVIEW	H
02-19-2009	TITLE II CONSTRUCTION BID ISSUE	O

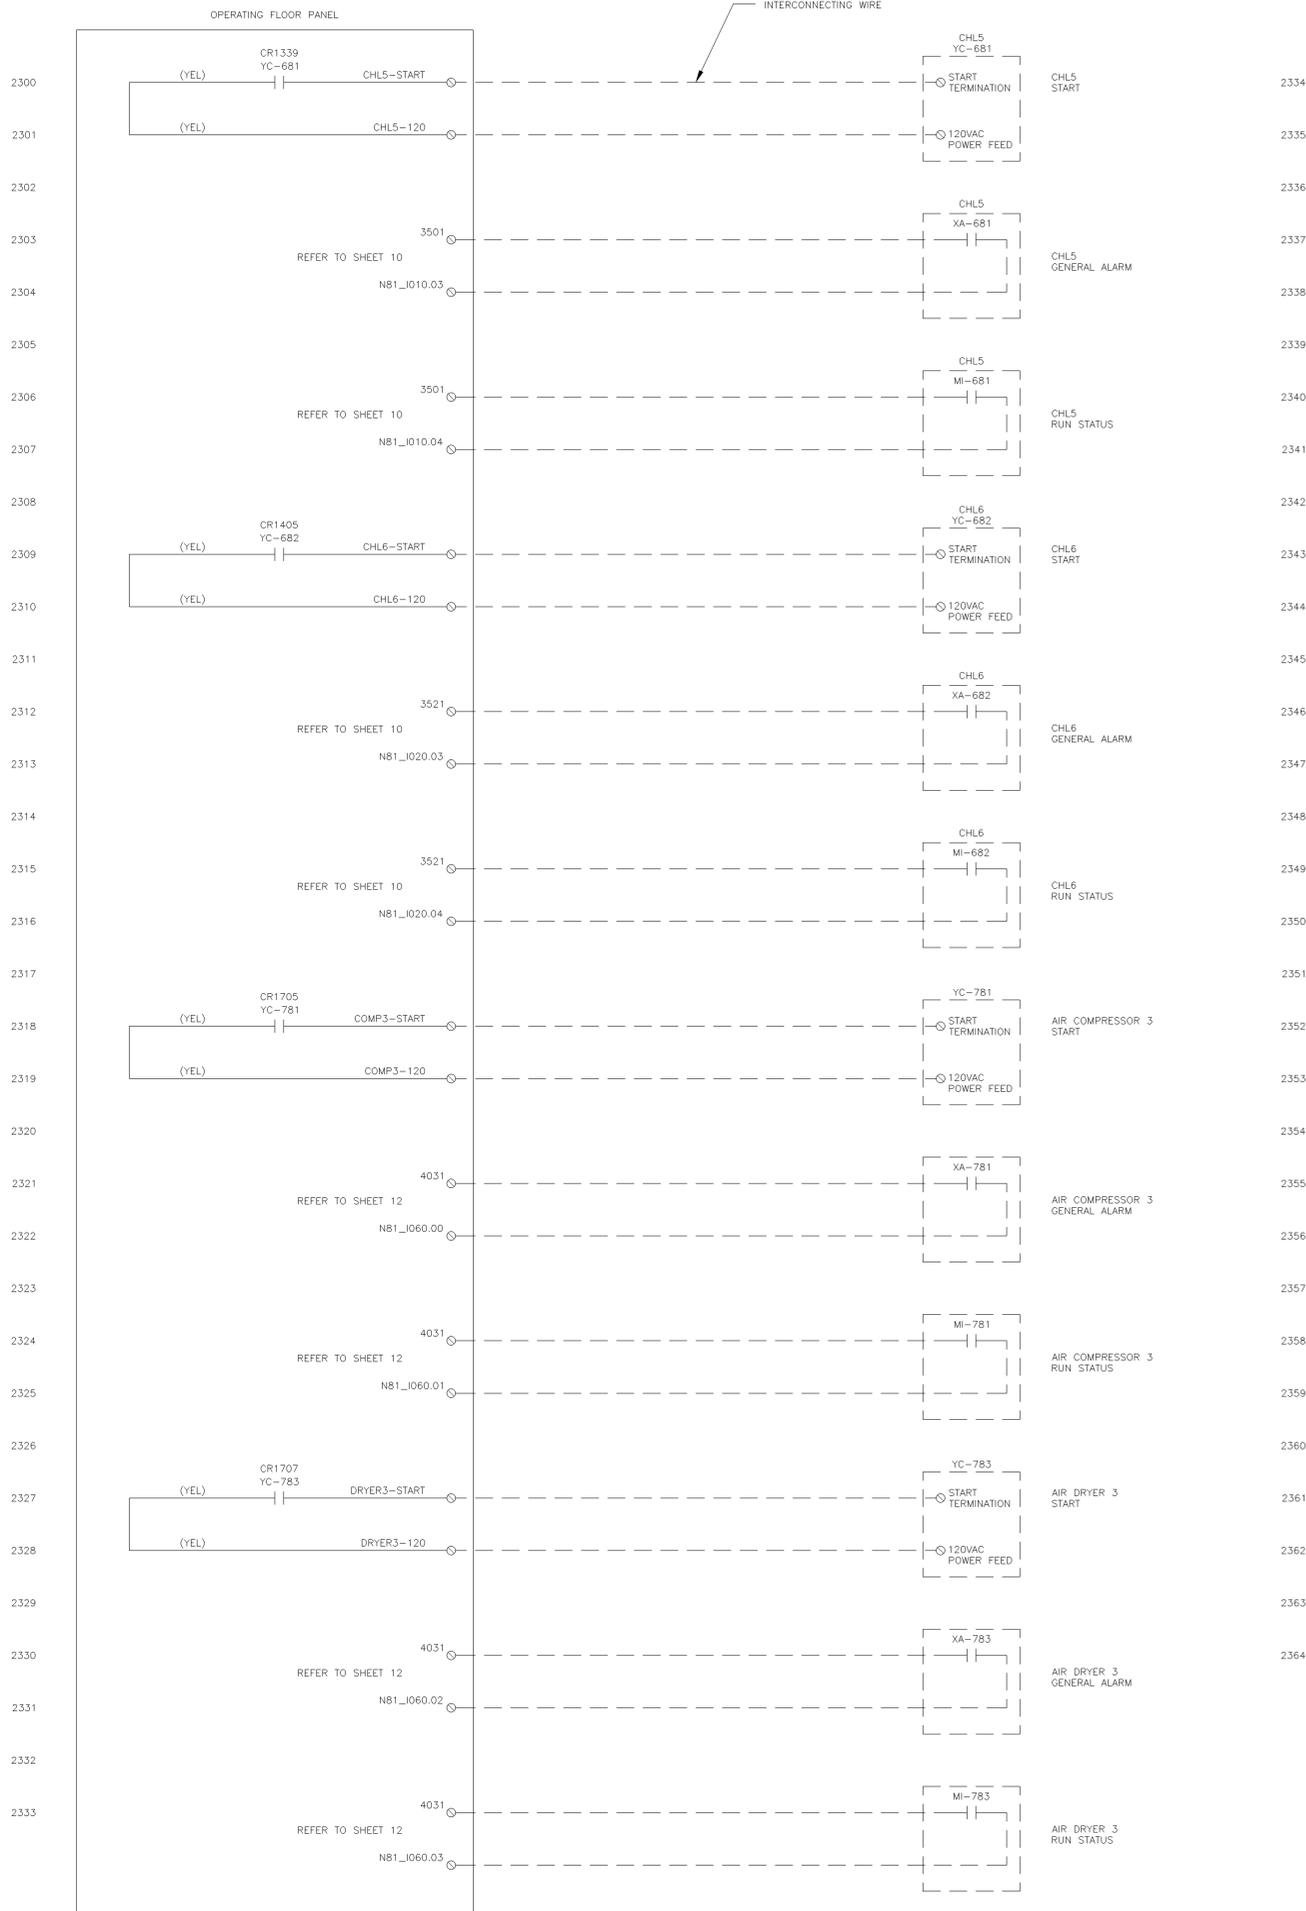

CHL5 START	2334
120VAC POWER FEED	2335
CHL5 GENERAL ALARM	2337
CHL5 RUN STATUS	2340
CHL6 START	2343
120VAC POWER FEED	2344
CHL6 GENERAL ALARM	2346
CHL6 RUN STATUS	2349
AIR COMPRESSOR 3 START	2352
120VAC POWER FEED	2353
AIR COMPRESSOR 3 GENERAL ALARM	2355
AIR COMPRESSOR 3 RUN STATUS	2358
AIR DRYER 3 START	2361
120VAC POWER FEED	2362
AIR DRYER 3 GENERAL ALARM	2364
AIR DRYER 3 RUN STATUS	2367

This drawing has been prepared solely for the use of Brookhaven National Laboratory and there are no representations of any kind made by Giffels Partnership to any party with whom Giffels Partnership has not entered into a contract.

This drawing shall not be used for construction purposes until the seal and signature of the responsible registrant appears on the drawing and proper permit forms and related fees are transmitted by the Owner, Owner's Agent or Contractor to the Authority Having Jurisdiction.

JOB NO.	SHEET NO.	REVISION	DATE	ENL.	APPD.	QA
UNDER CONTRACT WITH UNITED STATES DEPARTMENT OF ENERGY PLANT ENGINEERING DIVISION UPTON, NEW YORK 11973						
JOB TITLE CENTRAL CHILLED WATER FACILITY PHASE II			DWG. TITLE INTERLOCK CONNECTIONS			
IR/APPL/REV	NEW	DATE	ACCT. NO.	SHEET OF		
SCALE	NO SCALE	DWN. BY MC	REV'D BY BMC	JOB NO. 11705	23 37	
ESHD RISK LEVEL	APP'D. BY	BLDG. NO. 600	DWG. NO. M-631-23			
PATH:						

Giffels Partnership 25200 Telegraph Road, Suite 200 Southfield, Michigan 48033 USA Tel: 248-936-8000 Fax: 248-936-8111	Approved By	M. COORINGTON
	Project Manager	G. KAPLAN
	Project Engineer/Architect	M. COORINGTON
	Project No.	SF070003

Path Name: C:\vms\dms\brookhaven_national_laboratory\4070003\500--del\panel00percentdwg\11705-MG31-23.DWG
 Plot Date: 2/19/2009 10:56 AM
 User Name: Ed Fierdeli
 Page Set Up Name: -----