


Date (mm dd yyyy)	Issued For	Rev.
08-25-2008	TITLE II DESIGN 100% OWNER REVIEW	F
02-19-2009	TITLE II CONSTRUCTION BID ISSUE	0

1756-OF8
ANALOG OUTPUT
CHASSIS SLOT #13

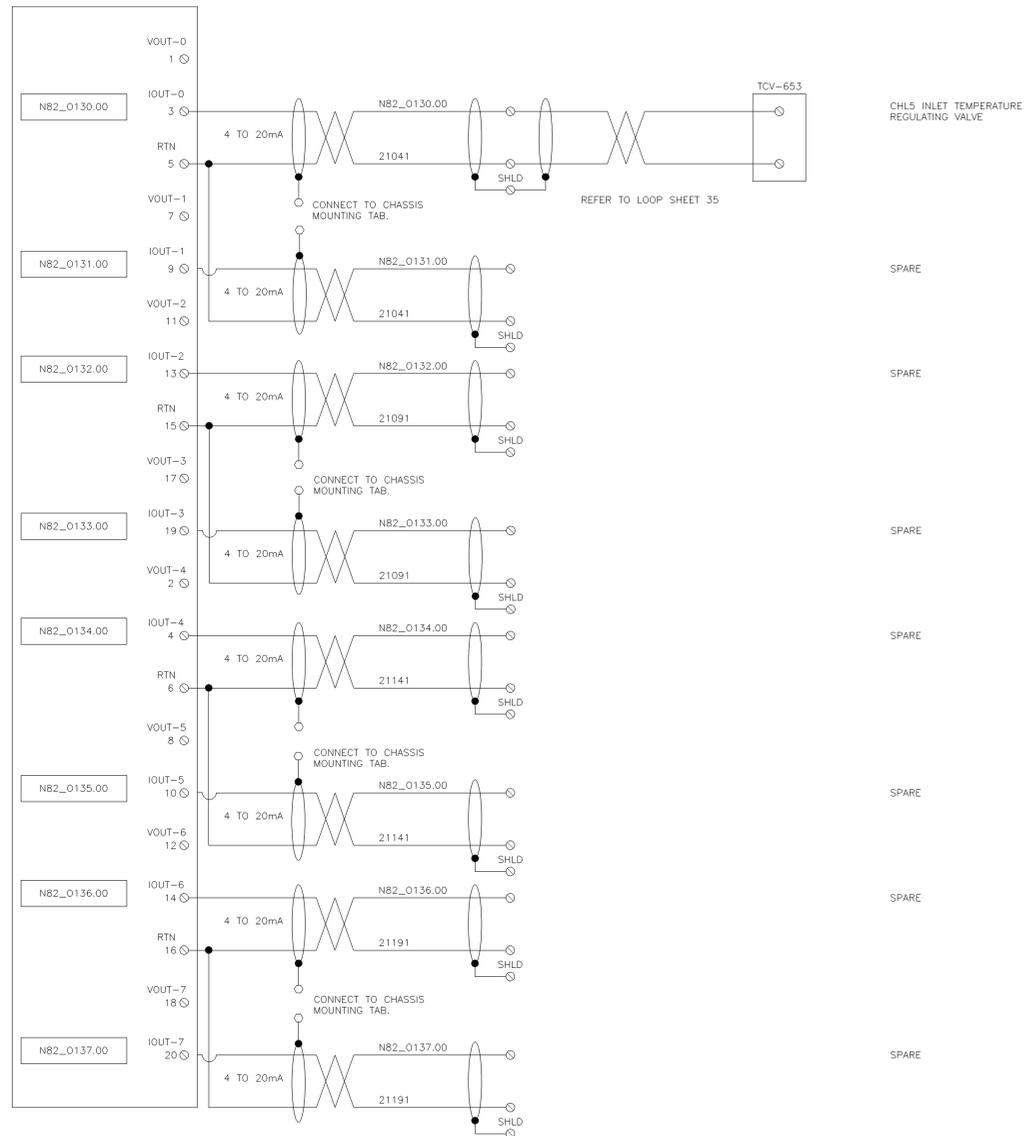

CHL5 INLET TEMPERATURE
REGULATING VALVE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SLOT 14 SPARE

CHASSIS MOUNTING TAB NOTE
USE ANY CHASSIS MOUNTING TAB THAT IS
DESIGNATED AS A FUNCTIONAL SIGNAL GROUND.

This drawing has been prepared solely for the use of Brookhaven National Laboratory and there are no representations of any kind made by Giffels Partnership to any party with whom Giffels Partnership has not entered into a contract.

This drawing shall not be used for construction purposes until the seal and signature of the responsible registrant appears on the drawing, and proper permit forms and related fees are transmitted by the Owner, Owner's Agent or Contractor to the Authority Having Jurisdiction.

JOB NO.	SHEET NO.	REVISION	DATE	ENR.	APPR.	QA
UNDER CONTRACT WITH UNITED STATES DEPARTMENT OF ENERGY PLANT ENGINEERING DIVISION UPTON, NEW YORK 11973						
JOB TITLE CENTRAL CHILLED WATER FACILITY PHASE II			DWG. TITLE SLOTS 13 ANALOG OUT AND 14 SPARE			
IR/APPL/REV	DATE	ACCT. NO.	SHEET OF		21 39	
SCALE NO SCALE	DWN. BY MC	REV'D BY MC	JOB NO. 11705	DWG. NO. M-632-21		
ES&H RISK LEVEL	APPR. BY	BLDG. NO. 600	PATH:			

Giffels, Partnership
25200 Telegraph Road, Suite 200
Southfield, Michigan 48033 USA
Tel: 248-936-8000
Fax: 248-936-8111

Approved By
M. CODRINGTON
Project Manager
G. KAPLAN
Project Engineer/Architect
M. CODRINGTON
Project No.
SF070003

Path Name: C:\Vimadadist\Brookhaven_national_laboratory\4070003\500--del\panel00percentdwg\11705-M632-21.DWG
 Plot Date/Time: 3/3/2009 9:48 AM Current File Size: 11705-M632-21.DWG
 Acad Version: 16.2s (LMS Tech)
 User Name: Ed Fierdeli