Date (mmm dd yyyy)	Issued For	Rev.
12-07-2007	TITLE II DESIGN 30% REVIEW SUBMITTAL	C
03-28-2008	TITLE II DESIGN 60% REVIEW SUBMITTAL	D
07-31-2008	TITLE II DESIGN 90% REVIEW SUBMITTAL	E
08-25-2008	TITLE II DESIGN 100% OWNER REVIEW	F
02-19-2009	TITLE II CONSTRUCTION BID ISSUE	0

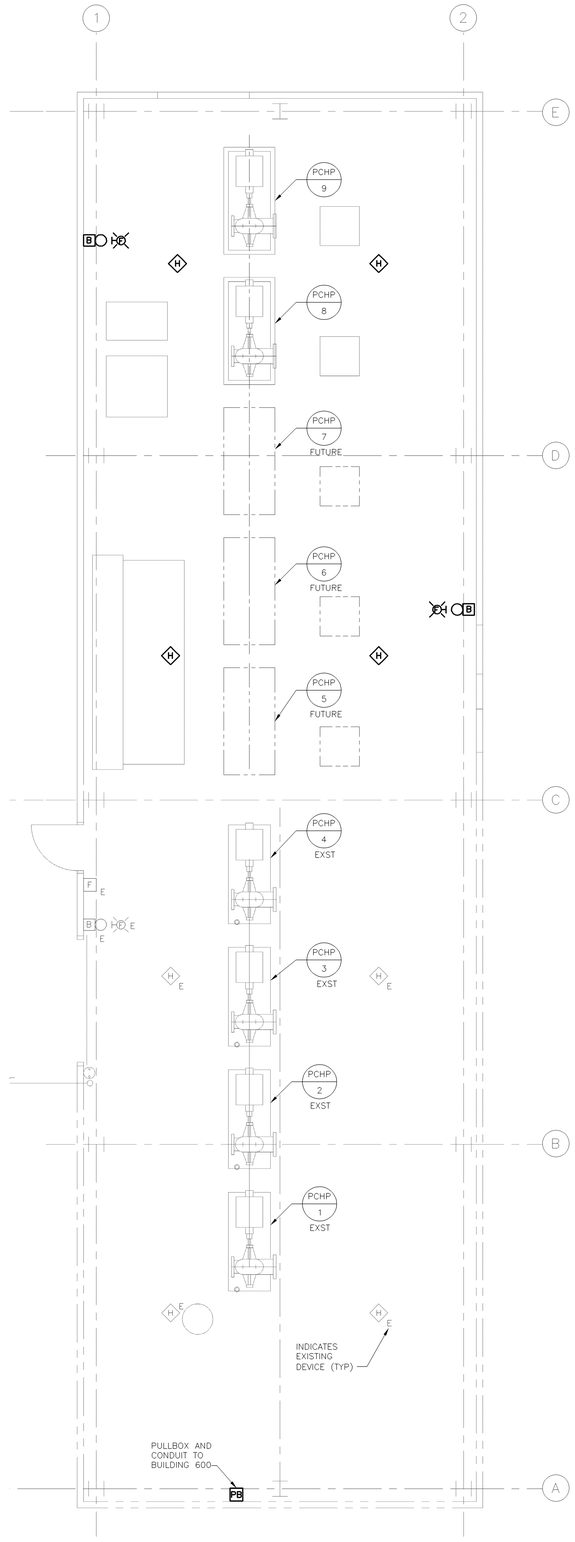

BUILDING 600A PUMP HOUSE AUX SYS PLAN

SCALE: 1/4" = 1'-0"

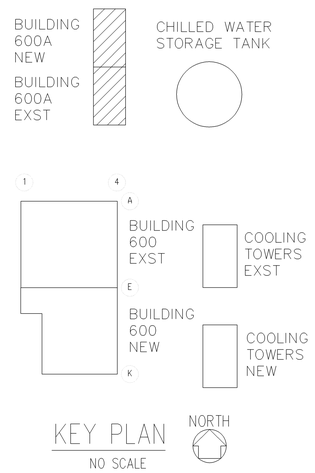

AUXILIARY SYSTEM GENERAL NOTES:

1. REFER TO DRAWING E-001 FOR ELECTRICAL ABBREVIATIONS. GENERAL NOTES AND DRAWING LIST AND DRAWING E-002 FOR ELECTRICAL SYMBOLS.
2. SEE DRAWING E-608 FOR FIRE ALARM RISER DIAGRAM.
3. SEE DRAWING E-609 FOR PAGING SYSTEM RISER DIAGRAM.
4. SEE DRAWING E-506 FOR AUXILIARY SYSTEM DETAILS.
5. SEE DRAWING EY-100 FOR BUILDING 600 PLAN.

This drawing has been prepared solely for the use of Brookhaven National Laboratory and there are no representations of any kind made by Giffels, Partnership to any party with whom Giffels, Partnership has not entered into a contract.

This drawing shall not be used for construction purposes until the seal and signature of the responsible registrant appears on the drawing, and proper permit forms and related fees are transmitted by the Owner, Owner's Agent or Contractor to the Authority Having Jurisdiction.

JOB NO.	SHEET	NO.	REVISION	DATE	DWN.	APP'D.	QA
		A					

BROOKHAVEN NATIONAL LABORATORY

UNDER CONTRACT WITH
UNITED STATES DEPARTMENT OF ENERGY
PLANT ENGINEERING DIVISION
UPTON, NEW YORK 11973

Giffels, Partnership
25200 Telegraph Road, Suite 200
Southfield, Michigan 48033 USA
Tel. 248-936-8000
Fax 248-936-8111

Approved By: R BARTOY
Project Manager: G. KAPLAN
Project Engineer/Architect: R MACK
Project No.: SF070003

JOB TITLE: CENTRAL CHILLED WATER FACILITY PHASE II		DWG. TITLE: BUILDING 600A AUX SYS PLANS	
ILR,GPP,LHI, HEM	DATE	ACCT. NO.	SHEET OF
SCALE: 1/4" = 1'-0"	DWN. BY: EA / REV'D BY: RM	JOB NO.: 11705	DWG. NO.: E-102
ESHQ RISK LEVEL	APP'D. BY: R BARTOY	BLDG. NO.: 600A	
PATH:			