



506A TYPICAL AUXILIARY SYSTEM DEVICE INSTALLATIONS
N.T.S.

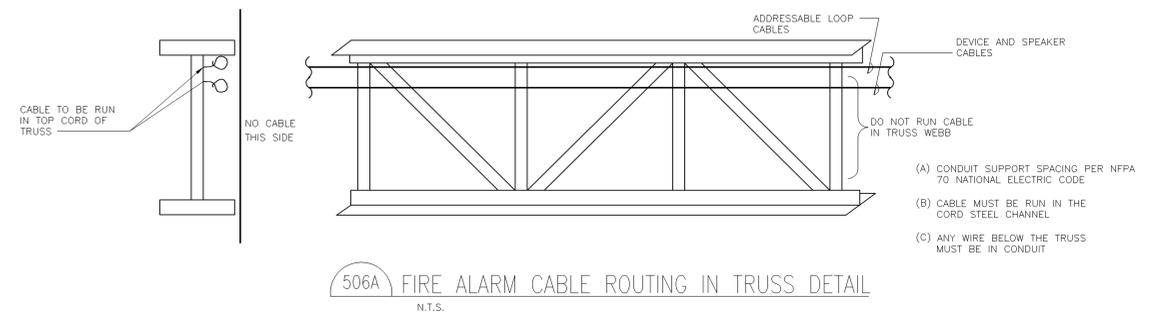

506A FIRE ALARM CABLE ROUTING IN TRUSS DETAIL
N.T.S.

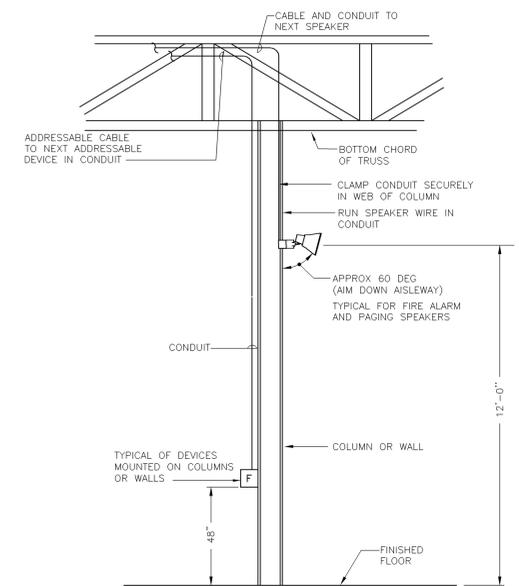

506B TYPICAL INSTALLATION OF AUXILIARY SYSTEM DEVICES ON COLUMNS/WALLS IN PLANT AREAS
N.T.S.

- NOTES:
- SEE DRAWING 000-E0-001 FOR DRAWING LIST, ABBREVIATIONS AND GENERAL NOTES.
 - SEE DRAWING 000-E0-002 FOR SYMBOL LIST.

This drawing has been prepared solely for the use of Brookhaven National Laboratory and there are no representations of any kind made by Giffels Partnership to any party with whom Giffels Partnership has not entered into a contract.

This drawing shall not be used for construction purposes until the seal and signature of the responsible registrant appears on the drawing and proper permit forms and related fees are transmitted by the Owner, Owner's Agent or Contractor to the Authority Having Jurisdiction.

Giffels Partnership
25200 Telegraph Road, Suite 200
Southfield, Michigan 48033 USA
Tel: 248-936-8000
Fax: 248-936-8111

Approved By: R. BARTOY
Project Manager: G. KAPLAN
Project Engineer/Architect: J. BOSSORY
Project No.: SF070003

JOB NO. SHEET NO. REVISION		DATE	ENL.	APPR.	QA
BROOKHAVEN NATIONAL LABORATORY					
UNDER CONTRACT WITH UNITED STATES DEPARTMENT OF ENERGY PLANT ENGINEERING DIVISION UPTON, NEW YORK 11973					
JOB TITLE CENTRAL CHILLED WATER FACILITY PHASE II			DWG. TITLE DETAILS		
DATE	DATE	ACCT. NO.	SHEET OF		
SCALE AS NOTED	DWN. BY RM	REV'D BY RM	JOB NO. 11705	DWG. NO.	
ESHD RISK LEVEL APP. BY R. BARTOY	BLDG. NO. 600	E-506			
PATH:					