Date (mmm dd yyyy)	Issued For	Rev.
07-31-2008	TITLE II DESIGN 90% REVIEW SUBMITTAL	E
08-25-2008	TITLE II DESIGN 100% OWNER REVIEW	F
02-19-2009	TITLE II CONSTRUCTION BID ISSUE	0

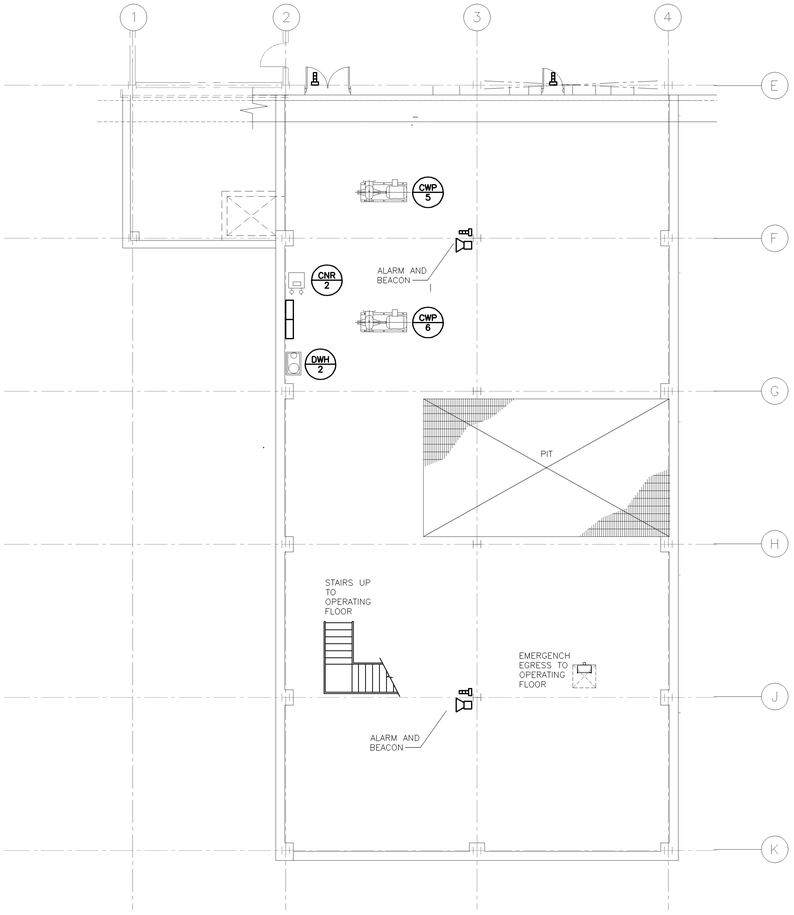

604A PIPE TUNNEL REFRIGERANT MONITORING SYSTEM PLAN

1/8" = 1'-0"

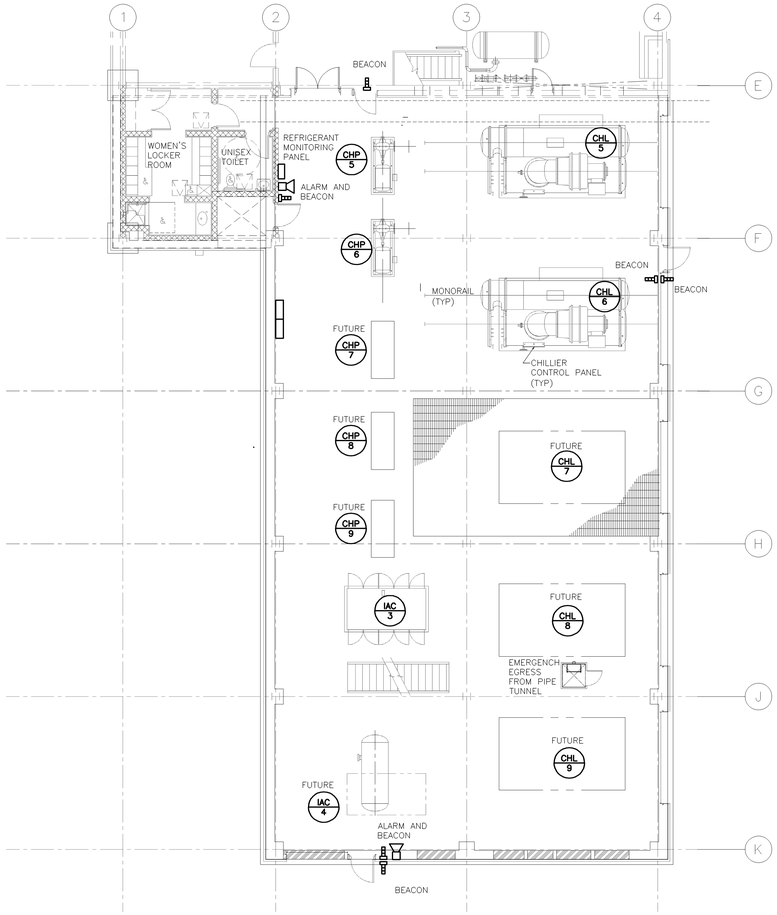

604B OPERATING FLOOR REFRIGERANT MONITORING SYSTEM PLAN

1/8" = 1'-0"

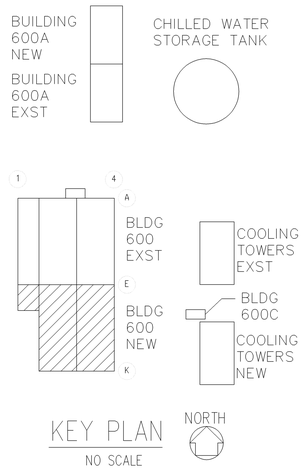

KEY PLAN

NO SCALE

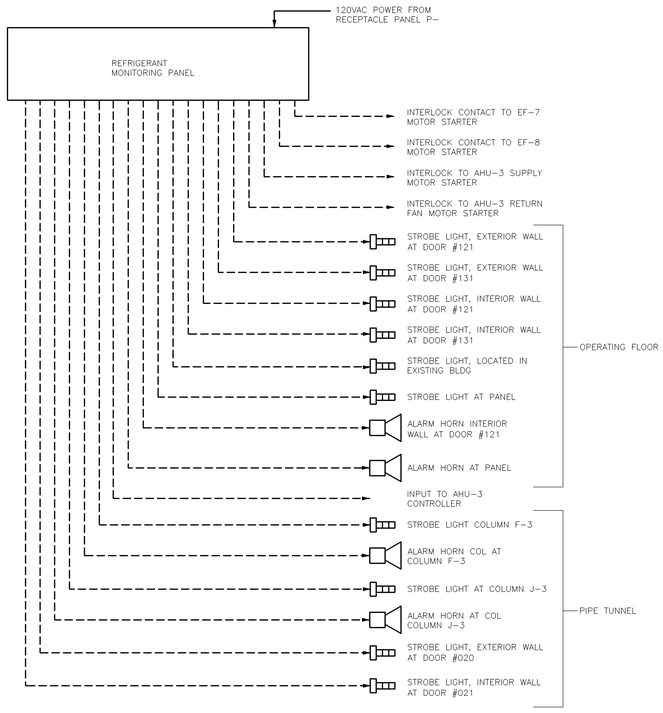

604C REFRIGERANT MONITORING SYSTEM DIAGRAM

NO SCALE

This drawing has been prepared solely for the use of Brookhaven National Laboratory and there are no representations of any kind made by Giffels, Partnership to any party with whom Giffels, Partnership has not entered into a contract.

This drawing shall not be used for construction purposes until the seal and signature of the responsible registrant appears on the drawing, and proper permit forms and related fees are transmitted by the Owner, Owner's Agent or Contractor to the Authority Having Jurisdiction.

NOTE:

1. FOR DETAILS OF THE REFRIGERANT MONITORING SYSTEM, SEE SPECIFICATION SECTION 13870.

Giffels, Partnership
25200 Telegraph Road, Suite 200
Southfield, Michigan 48033 USA
Tel. 248-936-8000
Fax 248-936-8111

Approved By: B NEWMAN
Project Manager: G. KAPLAN
Project Engineer/Architect: E PIENDEL
Project No. SF070003

JOB NO.	SHEET	NO.	REVISION	DATE	DWN.	APP'D.	QA
		1					

BROOKHAVEN NATIONAL LABORATORY

UNDER CONTRACT WITH
UNITED STATES DEPARTMENT OF ENERGY
PLANT ENGINEERING DIVISION
UPTON, NEW YORK 11973

JOB TITLE: CENTRAL CHILLED WATER FACILITY PHASE II		DWG. TITLE: REFRIGERANT MONITORING SYS PLAN	
ILR,GPP,LNI, HEM	DATE	ACCT. NO.	SHEET OF
SCALE: AS NOTED	DWN. BY: EP / REV'D BY: BN	JOB NO.: 11705	DWG. NO. MH-604
ESHQ RISK LEVEL	APP'D. BY: W HARRISON	BLDG. NO.: 600	
PATH:			