


Date (mm dd yyyy)	Issued For	Rev.
09-21-2007	TITLE 1 60% REVIEW	A
10-24-2007	TITLE 1 100% COMPLETE	B
07-31-2008	TITLE II DESIGN 90% REVIEW SUBMITTAL	E
08-25-2008	TITLE II DESIGN 100% OWNER REVIEW	F
02-19-2009	TITLE II CONSTRUCTION BID ISSUE	D

UL/cUL SYSTEM NO. C-AJ-8041

F RATING = 3-HR. T RATING = 0 AND 1 HR.
L RATING AT AMBIENT = 10 CFM/SQ FT
L RATING AT 400 F = LESS THAN 6 CFM/SQ FT

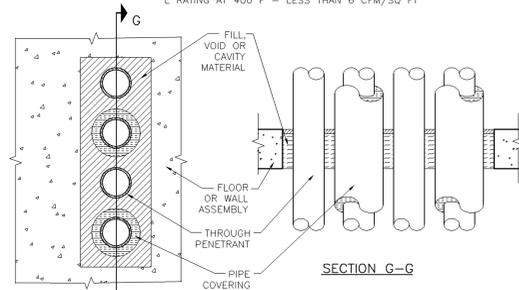

NOTE:

- FLOOR OR WALL ASSEMBLY - MIN 4-1/2 IN. THICK REINFORCED LIGHTWEIGHT OR NORMAL WEIGHT (100-150PCF) CONCRETE FLOOR OR MIN 5 IN. THICK REINFORCED LIGHTWEIGHT OR NORMAL WEIGHT (100-150 PCF) CONCRETE WALL. WALL MAY ALSO ANY UL CLASSIFIED CONCRETE BLOCKS* MAX DIAM OF OPENING IS 32 IN. SEE CONCRETE BLOCKS (CAZT) CATEGORY IN THE FIRE RESISTANCE DIRECTORY FOR NAMES OF MANUFACTURERS.
- THROUGH PENETRANTS-A MAX OF 4 PIPES, CONDUITS OR TUBING TO BE INSTALLED WITHIN THE OPENING. THE SPACE BETWEEN PIPES, CONDUITS OR TUBING SHALL BE 1-1/2 IN. THE SPACE BETWEEN PIPES, CONDUITS OR TUBING AND PERIPHERY OF OPENING SHALL BE MIN 1-5/8 IN. TO MAX 2-1/2 IN. PIPE, CONDUIT OR TUBING TO BE RIGIDLY SUPPORTED ON BOTH SIDERS OF FLOOR OR WALL ASSEMBLY. THE FOLLOWING TYPES AND SIZES OF METALLIC PIPES, CONDUITS OR TUBING MAY BE USED:
A. STEEL PIPE-NOM 3 IN. DIAM (OR SMALLER) SCHEDULE 10(ORHEAVIER) STEEL PIPE.
B. COPPER TUBING-COPPER TUBING NOM 3 IN. DIAM (OR SMALLER) TYPE L (OR HEAVIER)
C. COPPER PIPE - NOM 3 IN. DIAM (OR SMALLER) REGULAR (OR HEAVIER) COPPER PIPE.
D. CONDUIT-NOM 3 IN. DIAM (OR SMALLER) ELECTRICAL METALLIC TUBING OR STEEL CONDUIT.
- PIPE COVERING* (OPTIONAL)-MAX 1 IN. THICK HOLLOW CYLINDRICAL HEAVY-DENSITY (MIN 3.5 PCF) GLASS FIBER UNITS JACKETED ON THE OUTSIDE WITH AN ALL SERVICE JACKET. LONGITUDINAL JOINTS SEALED WITH METALFASTENERS OR FACTORY-APPLIED SELF-SEALING LAP TAPE. TRANSVERSE JOINTS SECURED WITH METAL FASTENERS OR WITH BUTT STRIP TAPE SUPPLIED WITH THE PRODUCT. A NOM ANNUAL SPACE OF 1-1/2 IN. IS REQUIRED WITHIN THE FIRESTOP SYSTEM. THE T RATING IS 1 HR WHEN 1 IN. THICK PIPE COVERING IS USED. THE T RATING IS 0 HR. WHEN PIPE COVERING IS LESS THAN 1 IN. OR IS OMITTED. SEE PIPE AND EQUIPMENT COVERING - MATERIALS (BRGU) CATEGORY IN THE BUILDING MATERIALS DIRECTORY FOR NAMES OF MANUFACTURERS. ANY PIPE COVERING MATERIAL MEETING THE ABOVE SPECIFICATIONS AND BEARING THE UL CLASSIFICATION MARKING WITH A FLAME SPREAD INDEX OF 25 OR LESS AND A SMOKE DEVELOPED INDEX OF 50 OR LESS MAY BE USED.
- PACKING MATERIAL-MIN 4 IN. THICKNESS OF MIN 4.0 PCF MINERAL WOOL BATT INSULATION FIRMLY PACKED INTO OPENING AS A PERMANENT FORM. PACKING MATERIAL TO BE RECESSED FROM TOP SURFACE OF FLOOR OR FROM BOTH SURFACES OF WALL AS REQUIRED TO ACCOMMODATE THE REQUIRED THICKNESS OF FILL MATERIAL.
- FILL, VOID OR CAVITY MATERIAL*-SEALANT-MIN 1/2 IN. THICKNESS OF FILL MATERIAL APPLIED WITHIN THE ANNULUS. FLUSH WITH TOP SURFACE OF FLOOR OR WITH BOTH SURFACES OF WALL.
HILTI CONSTRUCTION CHEMICALS, INC. - FS-ONE SEALANT
- CP 606 SILICONE FREE FLEXIBLE FIRESTOP SEALANT


*BEARING THE UL CLASSIFICATION MARKING

NOTE: ELECTRICAL ROOM WALL AND FLOOR ONLY

500J TYP. NO SCALE
MULTIPLE INSULATED/NON-INSULATED METAL PIPES THROUGH UP TO 3-HR. CONCRETE FLOOR/WALL OR BLOCK WALL

UL/cUL SYSTEM NO. C-AJ-1226

F RATING = 3-HR. T RATING = 0-HR.
L RATING AT AMBIENT = LESS THAN 1 CFM/SQ FT
L RATING AT 400 F = 4 CFM/SQ FT

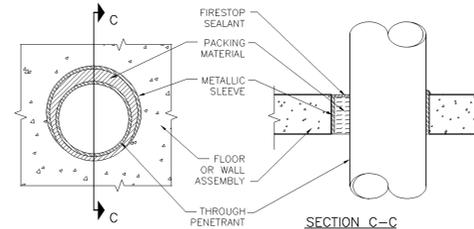


NOTE:


- FLOOR OR WALL ASSEMBLY - MIN 4-1/2 IN. THICK REINFORCED LIGHTWEIGHT OR NORMAL WEIGHT (100-150 PCF) CONCRETE. WALL MAY ALSO BE CONSTRUCTED OF ANY UL CLASSIFIED CONCRETE BLOCKS* MAX DIAM OF OPENING IS 32 IN. SEE CONCRETE BLOCKS (CAZT) CATEGORY IN THE FIRE RESISTANCE DIRECTORY FOR NAMES OF MANUFACTURERS.
- METALLIC SLEEVE - (OPTIONAL) NOM 3/2 IN. DIAM (OR SMALLER) SCHEDULE 40 (OR HEAVIER) STEEL SLEEVE CAST OR GROUTED INTO FLOOR OR WALL ASSEMBLY. FLUSH WITH FLOOR OR WALL SURFACES.
- THROUGH PENETRANT - ONE METALLIC PIPE OR CONDUIT TO BE INSTALLED EITHER CONCENTRICALLY OR ECCENTRICALLY WITHIN THE FIRESTOP SYSTEM. THE ANNULAR SPACE BETWEEN PIPE OR CONDUIT AND PERIPHERY OF OPENING SHALL BE MIN 0 IN. (POINT CONTACT) TO MAX 1-7/8 IN. PIPE OR CONDUIT TO BE RIGIDLY SUPPORTED ON BOTH SIDERS OF FLOOR OR WALL ASSEMBLY. THE FOLLOWING TYPES AND SIZES OF METALLIC PIPES OR CONDUITS MAY BE USED:
A. STEEL PIPE - NOM 3/2 IN. DIAM (OR SMALLER) SCHEDULE 10 (OR HEAVIER) STEEL PIPE.
B. COPPER PIPE - NOM 6 IN. DIAM (OR SMALLER) REGULAR (OR HEAVIER) COPPER PIPE.
C. COPPER TUBING - NOM 6 IN. DIAM (OR SMALLER) TYPE L (OR HEAVIER) COPPER TUBING.
D. CONDUIT - NOM 6 IN. DIAM (OR SMALLER) STEEL CONDUIT.
E. CONDUIT - NOM 4 IN. DIAM (OR SMALLER) STEEL ELECTRICAL METALLIC TUBING (EMT).
- FIRESTOP SYSTEM - THE FIRESTOP SYSTEM SHALL CONSIST OF THE FOLLOWING:
A. PACKING MATERIAL - MIN 4 IN. THICKNESS OF MIN 4 PCF MINERAL WOOL BATT INSULATION FIRMLY PACKED INTO OPENING AS A PERMANENT FORM. PACKING MATERIAL TO BE RECESSED FROM TOP SURFACE OF FLOOR OR FROM BOTH SURFACES OF WALL AS REQUIRED TO ACCOMMODATE THE REQUIRED THICKNESS OF FILL MATERIAL.
B. FILL, VOID OR CAVITY MATERIAL*- SEALANT - MIN 1/4 IN. THICKNESS OF FILL MATERIAL APPLIED WITHIN THE ANNULUS. FLUSH WITH TOP SURFACE OF FLOOR OR WITH BOTH SURFACES OF WALL. AT THE POINT CONTACT LOCATION BETWEEN PIPE AND CONCRETE, A MIN 1/4 IN. DIAM BEAD OF FILL MATERIAL SHALL BE APPLIED AT THE CONCRETE/PIPE INTERFACE ON THE TOP SURFACE OF FLOOR AND ON BOTH SURFACES OF WALL.
HILTI CONSTRUCTION CHEMICALS, INC. - FS-ONE SEALANT
- CP 606 SILICONE FREE FLEXIBLE FIRESTOP SEALANT

NOTE: ELECTRICAL ROOM WALL AND FLOOR ONLY

500F TYP. NO SCALE
METAL PIPE THROUGH A SLEEVE IN 3-HR. CONCRETE FLOOR/WALL OR BLOCK WALL

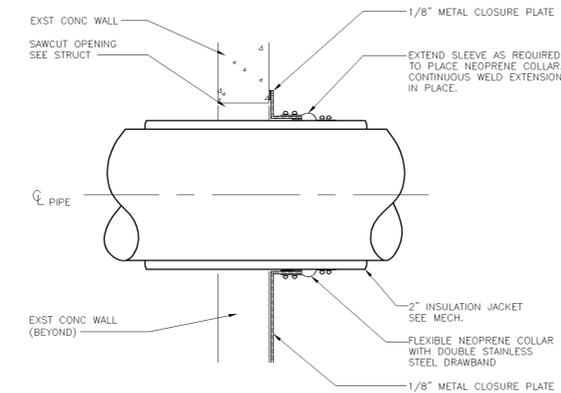


500G PIPE PENETRATION DETAIL
A-500 1 1/2" = 1'-0"

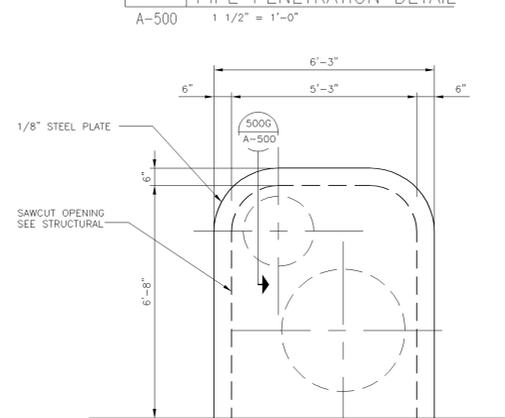


500H PIPE PENETRATION DETAIL
A-300 1 1/2" = 1'-0"


NOTE: SEE STRUCTURAL DETAIL 'E' ON SHEET SC-201 FOR ADDITIONAL DETAILS

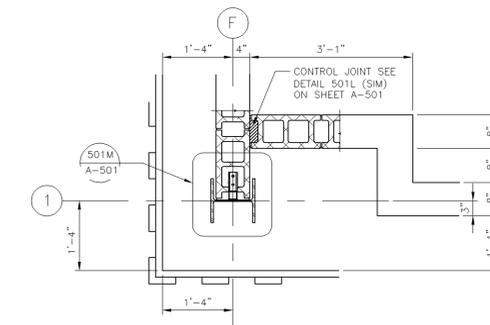


500A CORNER PLAN DETAIL
A-501 3/4" = 1'-0"

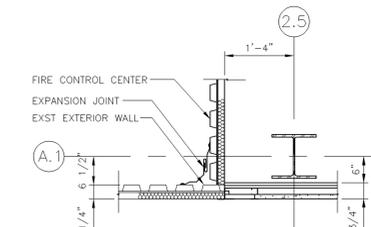

500B CORNER PLAN DETAIL
A-400 3/4" = 1'-0"

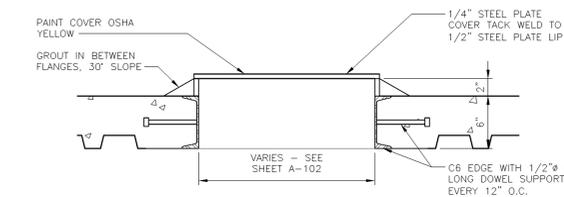

500C SLEEVE DETAIL
A-102 A-503 3/4" = 1'-0"

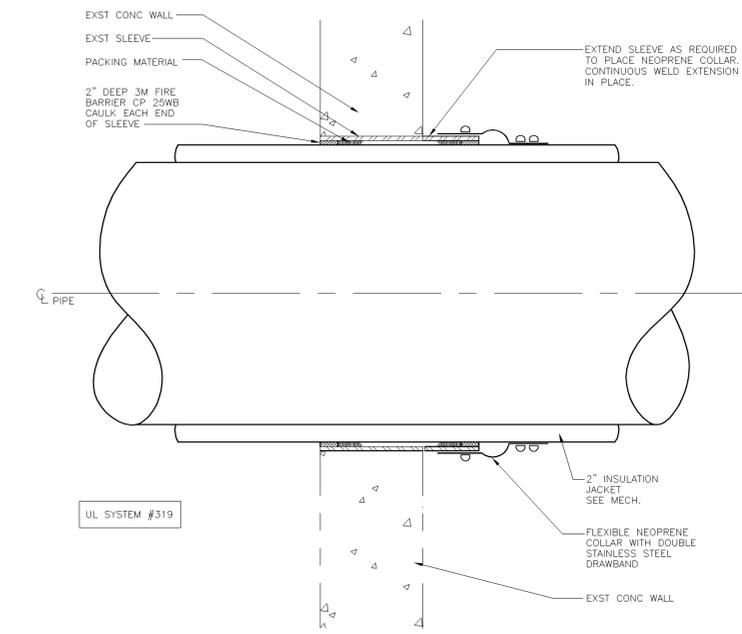

500D PIPE PENETRATION DETAIL
A-300 1 1/2" = 1'-0"

500L TYP. GUARDPOST DETAIL
A-600 3/4" = 1'-0"

This drawing has been prepared solely for the use of Brookhaven National Laboratory and there are no representations of any kind made by Brookhaven National Laboratory which has not entered into a contract.
This drawing shall not be used for construction purposes until the seal and signature of the responsible registrant appears on the drawing and proper permit forms and related fees are transmitted by the Owner's Agent to the Authority Having Jurisdiction.

		UNDER CONTRACT WITH UNITED STATES DEPARTMENT OF ENERGY PLANT ENGINEERING DIVISION UPTON, NEW YORK 11973	
JOB TITLE	CENTRAL CHILLED WATER FACILITY PHASE II	DWG. TITLE	ENLARGED DETAILS
ILLUSTRATOR	HEM	DATE	ACCT. NO. SF070003
SCALE	AS NOTED	DWG. BY	D O'B
ES&H RISK LEVEL	APPROV. BY	BLDG. NO.	600
Giffels, Partnership 25200 Telegraph Road, Suite 200 Southfield, Michigan 48033 USA Tel: 248-336-8500 Fax: 248-336-8111		Approved By D O'BEIRNE Project Manager G. KAPLAN Project Engineer/Architect D C SMITH Project No. SF070003	SHEET NO. 11705 A-500