Date (mmm dd yyyy)	Issued For	Rev.
12-07-2007	TITLE II DESIGN 30% REVIEW SUBMITTAL	C
03-28-2008	TITLE II DESIGN 60% REVIEW SUBMITTAL	D
07-31-2008	TITLE II DESIGN 90% REVIEW SUBMITTAL	E
08-25-2008	TITLE II DESIGN 100% OWNER REVIEW	F
02-19-2009	TITLE II CONSTRUCTION BID ISSUE	0
06-03-2009	REVIEW MODIFIED PER ADDENDUM 2	L
06-26-2009	MODIFIED PER ADDENDUMS 2 AND 3	1

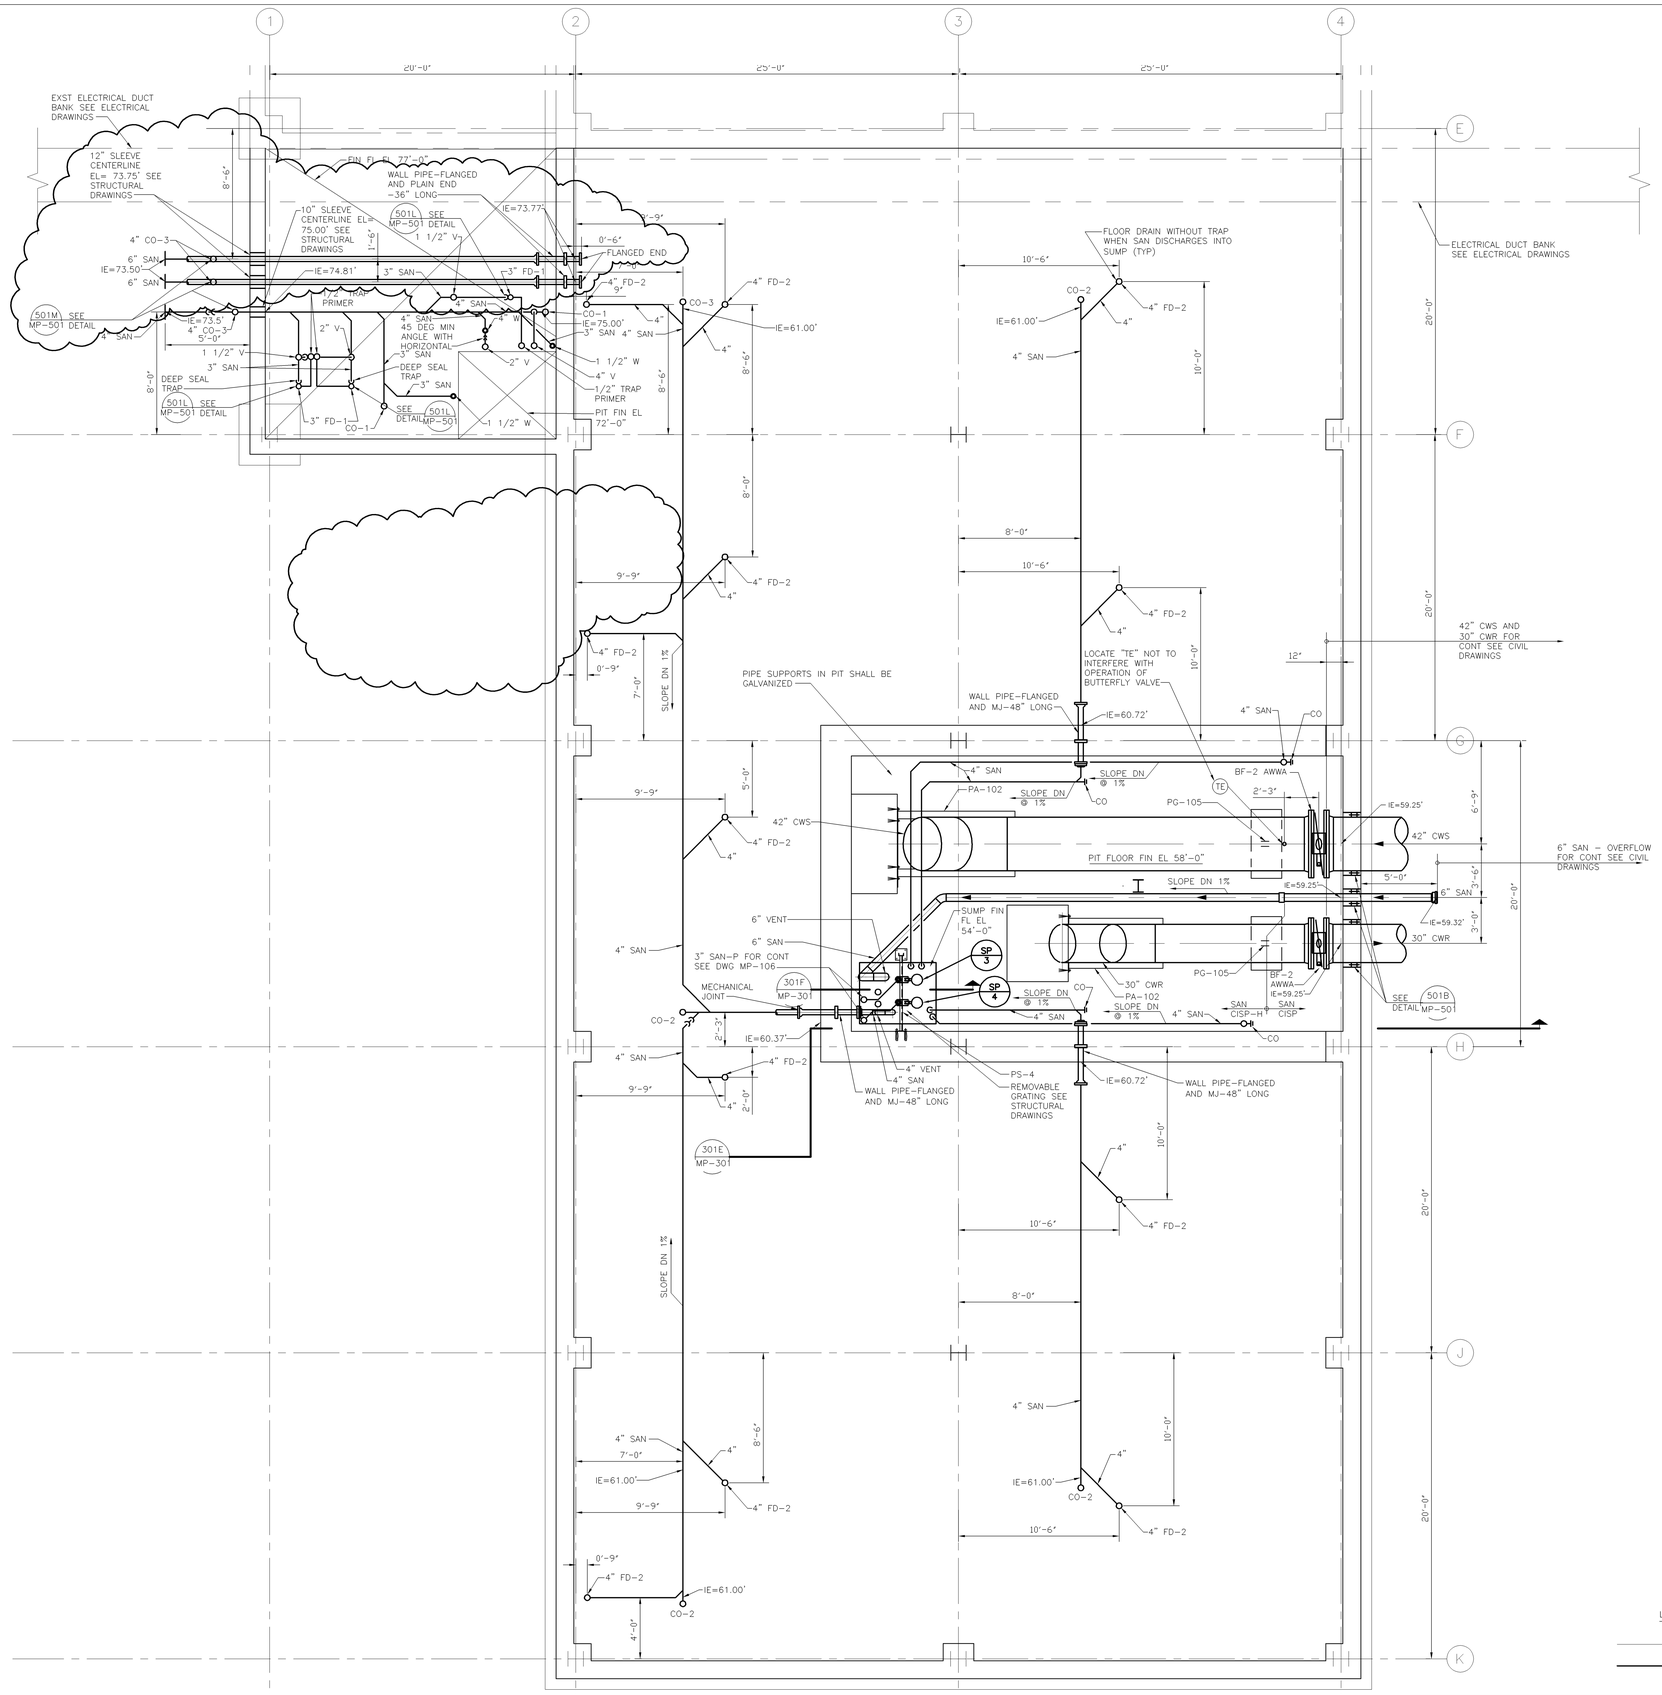

100A BUILDING 600 UNDERGROUND PLAN

1/4" = 1'-0"

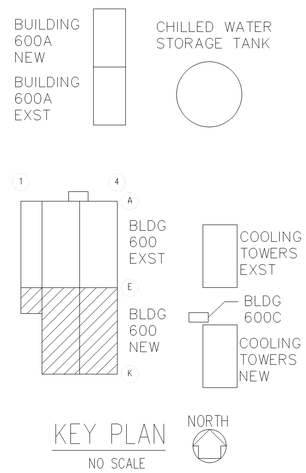

KEY PLAN

NO SCALE

This drawing has been prepared solely for the use of Brookhaven National Laboratory, and there are no representations of any kind made by Giffels, Partnership to any party with whom Giffels, Partnership has not entered into a contract.

This drawing shall not be used for construction purposes until the seal and signature of the responsible registrant appears on the drawing, and proper permit forms and related fees are transmitted by the Owner, Owner's Agent or Contractor to the Authority Having Jurisdiction.

It is a violation of New York State Law Article 145 for any person, unless he is acting under the direction of a licensed professional engineer or land surveyor, to alter an item in any way. If an item bearing the seal of an engineer or land surveyor is altered, the altering engineer or land surveyor shall affix to the item his seal and the notation "altered by" followed by his signature and the date of such alteration, and a specific description of the alteration.

JOB NO.	SHEET NO.	REVISION	DATE	DWN.	APP'D.	QA
		1				

LEGEND

EXISTING

NEW

Giffels, Partnership
25200 Telegraph Road, Suite 200
Southfield, Michigan 48033 USA
Tel. 248-936-8000
Fax 248-936-8111

Approved By: B NEWMAN
Project Manager: G. KAPLAN
Project Engineer/Architect: E PIENDEL
Project No. SF070003

BROOKHAVEN NATIONAL LABORATORY

UNDER CONTRACT WITH
UNITED STATES DEPARTMENT OF ENERGY
PLANT ENGINEERING DIVISION
UPTON, NEW YORK 11973

JOB TITLE	DWG. TITLE
CENTRAL CHILLED WATER FACILITY PHASE II	BUILDING 600 UNDERGROUND PLAN

ILR,GPP,LNI, HEM	DATE		ACCT. NO.	SHEET OF
SCALE 1/4"=1'-0"	DWN. BY EP	REV'D BY BN	JOB NO. 11705	DWG. NO. MU-100
ESHQ RISK LEVEL	APP'D. BY W HARRISON		BLDG. NO. 600	
PATH:				