

BNL Drinking Water: Step by Step From Source to Finished Product

STEP 1. Of the five in-service drinking-water wells, wells 4, 6 and 7 provide high-in-iron source water, which must be "finished" at BNL's Water Treatment Facility (WTF) before being distributed around site. At one of these wells, Phil Pizzo is seen performing preventive maintenance on a pump motor. Wells 10 and 11 pump water that is low in iron, so it does not require treatment. This water is simply chlorinated and pH-adjusted before entering the water distribution system.




— CN10-144-00

STEP 2. Chlorine is added to water from all the wells to kill microbes and oxidize iron. Joe Tullo is pictured inspecting a liquid sodium hypochlorite storage tank.



— CN10-143-01

STEP 3. Aeration reduces carbon dioxide gas and aids in iron oxidation. At the aeration tank, Phil Pizzo and Greg Stawski are seen sampling the water.

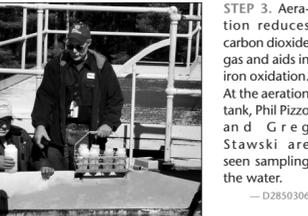


— D2850306

STEP 4. Lime is added to raise the pH and soften the water. Greg Stawski is pictured as he feeds lime into the hopper.



— D2800306

STEP 5. Polymer is added to aid in flocculation (see step 6). Richard Lutz (front) is seen adding polymer into a rapid-mix tank, as Phil Pizzo adjusts the flow rate.

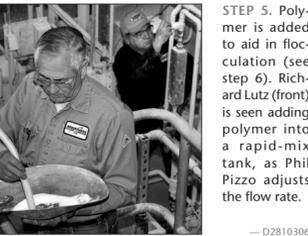

— D2810306



In the control room of BNL's Water Treatment Facility (WTF), Bldg. 624 on Upton Road, is Richard Lutz. — D2820306

Although BNL's "raw" water comes from five in-service, on-site drinking-water wells drilled into the Upper Glacial aquifer (see page 3), the Lab's "finished" drinking water is produced with pride by the staff of BNL's Water Treatment Facility (WTF) of the Energy & Utilities Division.

Producing BNL's finished water are six water-treatment engineers, each having New York State Department of Health (NYSDOH) grade IIA certification. In alphabetical order, they are: Tom Boucher, Jack Kulesa, Richard Lutz, Phil Pizzo, Greg Stawski, and Joe Tullo. They are supervised by Water System Supervisor Tony Ross, who is NYSDOH grade IA certified. WTF operations are overseen by Bill Chaloupka, who is Manager - Utilities within the Energy & Utilities Division.

To make what is called potable water for BNL's daily transient and resident population of approximately 3,000 people, WTF staff employ "federal public water system no. 511891." The centerpiece of this system is the WTF itself, located in and around Bldg. 624 on Upton Road. Able to handle up to 6 million gallons per day, the WTF was built in 1963 to remove iron and manganese from the Lab's source water. Over the years, the facility has undergone a series of upgrades, most recently in 1995-96.


The step-by-step flow of water through the water-treatment process and the on-the-job performance of the WTF's certified staff are shown in the photos on this page taken by BNL photographer Roger Stoutenburgh. — Marsha Belford

STEP 6. Flocculation, or the formation of particle aggregates which settle out of the water as sediment, begins in the retention tank. To help form "floc," water is sent from the retention tank to a slow-mix tank. Pictured at the retention tank, Jack Kulesa (left) is checking for floc.



— CN10-35-00

STEP 7. To remove all particles, filtration is performed using a rapid sand filter made up of sand and anthracite coal. Seen inspecting the valves in the filtration valve gallery are: (front to back) Richard Lutz, Phil Pizzo and Greg Stawski.

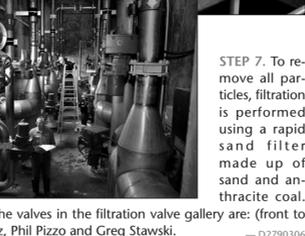

— D2790306

STEP 8. The wet well stores filtered water before it is pumped into the air-stripping towers. Viewed in the wet-well pump room, Richard Lutz (front) works on a check valve, while Jack Kulesa inspects pump seals.



— CN10-38-00

STEP 9. The air-stripping towers remove volatile organic compounds (VOCs) from water being treated. Pictured inspecting a tower is Joe Tullo.




— D2840306

STEP 10. Pictured at the clear well, where up to 250,000 gallons of "finished" water is stored before its final chlorination and distribution, Richard Lutz and Jack Kulesa take samples.



— CN10-146-00

STEP 11. The high-service pumps send finished water from the WTF to the two water towers on site. Joe Tullo is seen greasing a pump bearing.

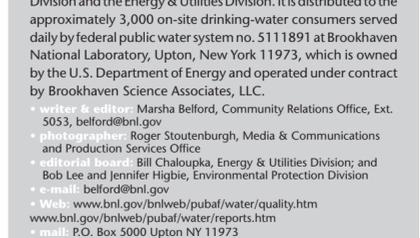

— D2830306

STEP 12. Water from the Lab's two storage towers is delivered on site at 55 to 70 pounds of pressure per square inch via 45 miles of distribution pipe. Viewed from its base is the larger of the Lab's towers, which holds one million gallons of water.

— CN10-44-00

STEP 13. Drinking water is sampled at different intervals in various locations, depending upon the test, and samples are analyzed by an independent, certified lab. Results are reported to the Suffolk County Department of Health Services and to BNL's Environmental Protection Division, which ensures that the Lab's water complies with all applicable regulations. Seen testing BNL water quality is Tom Boucher.

— CN10-41-00

Definition of Terms Used in the Consumer Confidence Report

- 90th percentile value: The reported copper and lead values represent the 90th percentile. A percentile is a value on a scale of 100 that indicates the percent of a distribution that is equal to or below it. The 90th percentile is equal to or greater than 90 percent of the lead and copper values detected by your water system.
- action level (AL): The concentration of a contaminant which, if exceeded, then triggers treatment and/or other requirements that a drinking-water supplier must follow.
- maximum contaminant level (MCL): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close as possible to what is called the maximum contamination level goal (MCLG).
- maximum contamination level goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.
- maximum residual disinfectant level (MRDL): The highest concentration of a disinfectant allowed in drinking water. Disinfectants have been proven to be necessary for controlling microbial contamination of water and eliminating water-borne illnesses.

- maximum residual disinfectant level goal (MRDLG): The concentration of a drinking-water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of using disinfectants to control microbial contamination.
- treatment technique: A required process intended to reduce the level of a contaminant in drinking water.
- micromhos per centimeter (µmhos/cm): A measure of the ability of water to conduct electricity. Conductivity effectively measures the concentration of ions, such as dissolved salts.
- milligrams per liter (mg/l): Equals one part of liquid per million parts of liquid, or parts per million (ppm).
- millirem per year (mrem/yr): A measure of radiation absorbed by the body.
- micrograms per liter (µg/l): Equals one part of liquid per billion parts of liquid, or parts per billion (ppb).
- picocuries per liter (pCi/L): A measure of radioactivity in water.
- million fibers per liter (MFL): A measure of asbestos fibers longer than 10 micrometers.

BNL Water Quality Consumer Confidence Report

This annual special edition of the Bulletin is published by the Community Education, Government & Public Affairs Directorate with the assistance of the Environmental Protection Division and the Energy & Utilities Division. It is distributed to the approximately 3,000 on-site drinking-water consumers served daily by federal public water system no. 5111891 at Brookhaven National Laboratory, Upton, New York 11973, which is owned by the U.S. Department of Energy and operated under contract by Brookhaven Science Associates, LLC.

• **writer & editor:** Marsha Belford, Community Relations Office, Ext. 5053, belford@bnl.gov
 • **photographer:** Roger Stoutenburgh, Media & Communications and Production Services Office
 • **editors:** Bill Chaloupka, Energy & Utilities Division; and Bob Lee and Jennifer Higbie, Environmental Protection Division
 • **e-mail:** belford@bnl.gov
 • **Web:** www.bnl.gov/bnlweb/pubaf/water/quality.htm
 www.bnl.gov/bnlweb/pubaf/water/reports.htm
 • **mail:** P.O. Box 5000 Upton NY 11973

the Bulletin

BROOKHAVEN
NATIONAL LABORATORY

Bulletin Special Edition

2010 BNL Water Quality Consumer Confidence Report

BNL's Drinking Water Complies With All Health, Safety Regulations

Last year, as in the past, Brookhaven Lab's drinking water and the supply system that produces it were in full compliance with all applicable county, state and federal regulations regarding drinking-water quality, monitoring, operations, and reporting.

In fact, the Energy & Utilities (E&U) Division, which is responsible for the Lab's drinking-water supply system, is proud to report that BNL's water has never reached or exceeded what are called primary maximum contaminant levels (MCLs), which safeguard drinking-water consumers' health.

To ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (EPA) and the New York State Department of Health (NYSDOH) have prescribed regulations that limit the amounts of certain contaminants in water provided by public water systems such as BNL's. Each drinking-water contaminant has an allowable MCL. Water for drinking that exceeds MCLs for one or more compounds is in violation of the law.

To provide the same protection to those who drink bottled water, the U.S. Food & Drug Administration has established regulations to limit contaminants in bottled water.

Of the 113 drinking-water contaminants for which BNL tests its drinking water at the well, after treatment at the Water Treatment Facility, or at the consumers' tap, only 18 compounds were detected in the Lab's drinking water in 2009 (see table on page 1, below; tables on pages 2 and 3; and the discussion of those compounds on page 3).

Reducing 'Rusty' Water Around the Site 2010 Water-Main Flush Program Started

On May 3rd, the water treatment engineers of BNL's Water Treatment Facility (WTF) began working their way around the site over a week to flush BNL's water mains. By systematically opening and closing fire hydrants from May 3rd through 7th, they began BNL's 2010 water-main flushing program.

According to the American Water Works Association, unidirectional flushing of water mains using fire hydrants within a water-distribution system is the most effective and economical way to cleanse a water-distribution system and, thereby, improve water quality.

Performed three times a year, on-site water-main flushing will also take place in July and September. Closer to the weeks selected in those months, the hydrant-flushing schedule will be announced via a Bulletin notice, broadcast e-mail, Web posting, and a flyer distributed to on-site residents.

Much of Long Island's groundwater is high in iron, as a result of naturally occurring iron-containing minerals within the aquifer. Water that enters BNL's distribution system, however, has very low iron for one of two reasons: either because it comes from one of the three drinking-water wells that produces water naturally low in iron; or because, if it comes from



Water Treatment Engineers Greg Stawski and Tom Boucher are at work reducing "rusty" water by systematically flushing BNL's water mains.

one of the three high-iron wells, the water is then treated in a multi-step process to remove iron at the Water Treatment Plant (see photo essay on page 4).

While being delivered around site via 45 miles of underground water mains, however, BNL water can and does pick up insoluble iron.

There are two sources of iron in BNL's water-distribution system: First, between 1941, when Camp Upton was reopened on the site during World War II, and 1963, when the WTF was commissioned, BNL did not treat its drinking water for iron; as a result, some 700 pounds of iron per year—or 7.7 tons over 22 years—was deposited. Second, the site has cast-iron and ductile iron water mains which add insoluble iron into the system as a result of oxidation.

Depending upon where a building is located along the water-distribution system, "rusty" water can be more or less of a problem. Because iron does not pose a health risk to most people at levels usually found in water, the EPA regulates it via secondary, or aesthetic, standards (see pages 2 and 3).

location	faucet	lead	copper	LEAD AT CONSUMERS' TAP*
				MCLG: 0 µg/l
				BNL range: <1 to 39 µg/l
				AL at the 90th percentile: 15 µg/l
				BNL 90th percentile value: 14 µg/l
				location of 90th percentile sample: Bldg. 170 bathroom
				location of highest sample: Bldg. 911 bathroom
				sampling date: 08/10/2009 violation? No
				COPPER AT CONSUMERS' TAP*
				MCLG: 1.3 mg/l
				BNL range: <0.005 to 0.580 mg/l
				AL at the 90th percentile: 1.3 mg/l
				BNL 90th percentile value: 0.180 mg/l
				location of 90th percentile sample: Bldg. 703 bathroom
				location of highest sample: Bldg. 911 bathroom
				sampling date: 08/10/2009 violation? No
				* Discussed in "2009: 18 Parameters Detected in BNL's Drinking Water," on page 3.

Visit the WTF: 6/25

Once you've looked at the pictures and read all about the Water Treatment Facility (WTF), why don't you come to see it for yourself—by going on a lunchtime tour for BNL employees, facility-users and other on-site guests.

Organized by Tour Program coordinator Elaine Lowenstein of the Community Relations Office, the WTF tour will take place on Friday, June 25th, from 12 noon to 1 p.m.

Meet in the upper lobby of Berkner Hall by 12 noon sharp!

— M.B.

What Is in Our Drinking Water?

Although rivers, lakes, streams, ponds, and reservoirs are all sources of tap and bottled drinking water, BNL and the rest of Long Island draw drinking water from groundwater wells that are drilled into the aquifer (see story below).

As water travels over land surfaces or through the ground, it dissolves naturally occurring minerals and radioactive material. In addition, water can pick up substances resulting from human activity or the presence of animals. Contaminants that may be present in water include:

- **microbial contaminants:** bacteria and viruses, which may come from sewage, livestock operations, wildlife, etc.
- **inorganic chemical contaminants:** dissolved salts and metals, which can occur naturally or result from storm-water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, farming, etc.
- **pesticides & herbicides:** substances for, respectively, eliminating problem insects and plants which may come from a variety of sources, such as agricultural operations, storm-water runoff, residential uses, etc.
- **organic chemical contaminants:** natural and synthetic compounds, including volatile organic compounds (VOCs). These chemicals are by-products of industrial processes and petroleum production, and they can also come from gas stations, storm-water runoff, septic systems, etc.
- **radioactive contaminants:** can be naturally-occurring, or from oil and gas production, mining activities, nuclear facilities, etc.

Because of the presence of contaminants, source water is often “finished,” or treated, to remove substances or reduce their concentration before that water is fit for human consumption (see photo essay on page 4).

2009 Analytical Data Inorganic Chemicals, Bacteria, Radioactivity

The following maximum values were measured in samples of well water or finished water at the Water Treatment Plant. The 13 parameters noted in this table as detected in BNL water are discussed on page 3.

WATER-QUALITY INDICATORS		
indicator	BNL sample	MCL
alkalinity*	54.0 mg/l	NS
ammonia	<MDL	NS
calcium*	13.0 mg/l	NS
chlorides*	44.0 mg/l	250 mg/l
color	<MDL	15 units
conductivity*	280 µmhos/cm	NS
cyanide	<MDL	NS
methylene blue active substances	<MDL	NS
nitrate*	0.7 mg/l	10 mg/l
nitrite	<MDL	1.0 mg/l
odor	<MDL	3 units
pH	5.3 standard units	NS
sulfates*	12.1 mg/l	250 mg/l
total coliform*	1 positive sample	ND
METALS		
metal	BNL sample	MCL
antimony	<MDL	6.0 µg/l
arsenic	<MDL	50 µg/l
barium*	0.038 mg/l	2.0 mg/l
beryllium	<MDL	4.0 µg/l
cadmium	<MDL	5.0 µg/l
chromium fluoride	<MDL	0.10 mg/l
iron*	2.8 mg/l	0.3 mg/l
lead	<MDL	15 µg/l
manganese*	0.25 mg/l	0.3 mg/l
mercury	<MDL	2.0 µg/l
nickel*	0.05 mg/l	0.1 mg/l
selenium	<MDL	50 µg/l
silver	<MDL	100 µg/l
sodium*	37.0 mg/l	NS
thallium	<MDL	2.0 µg/l
zinc*	0.030 mg/l	5.0 mg/l
OTHER		
parameter	BNL sample	MCL
asbestos	<MDL	7 MFL
RADIOACTIVITY		
parameter	BNL well max.	MCL
gross alpha*	2.28 pCi/l	15 pCi/l
gross beta*	3.61 pCi/l	4 mrem/yr
tritium	<MDL	20,000 pCi/l
radium-228*	1.85 pCi/l	5 pCi/l
strontium-90	<MDL	8 pCi/l

<MDL: less than the minimum detection limit. NS: drinking-water standard not specified. ND: not detected. * measure of water hardness or dissolved salts. * Discussed in “2009: 18 Parameters Detected in BNL’s Drinking Water,” page 3.

Regardless, drinking water — including bottled water — may reasonably be expected to contain at least small amounts of contaminants. The presence of contaminants, however, does not necessarily indicate that the water poses a health risk (see story on page 3).

Some people may be more vulnerable to illness-causing microorganisms or pathogens in drinking water than others. People whose immune systems are compromised may be particularly at risk of infections. Those people include: cancer patients who are undergoing chemotherapy, people who have undergone


Long Island’s ‘Sole Source’ Aquifer Is Brookhaven Lab’s Water Source

All of the water supplied by BNL comes from beneath the ground and, hence, is referred to as groundwater. That water is stored beneath the ground in a sandy, geological formation known as an aquifer. Water in the aquifer originates as precipitation that percolates down through the soil, and this groundwater may be source water for natural springs or man-made wells.

The Long Island aquifer system is made up of three primary formations (see diagram below): From the surface to about 150 feet down is the Upper Glacial aquifer, from 150 to 1,000 feet is the Magothy, and from 1,000 to about 2,000 feet is the Lloyd. Drilled into the Upper Glacial, the Lab’s five in-service drinking-water wells draw up to 1,000 gallons per minute, or about 1.15 million gallons of water a day for use as drinking water, process cooling water or fire protection. Last year, in total, BNL pumped some 524,725,000 gallons.

Long Island’s aquifer system is one of 72 “sole source” aquifers in the nation recognized under the aquifer-protection program authorized by the U.S. Safe Drinking Water Act. Long Island’s regional aquifer was so named on June 21, 1978, following a 1975 petition to the EPA by the Environmental Defense Fund.

— Marsha Belford

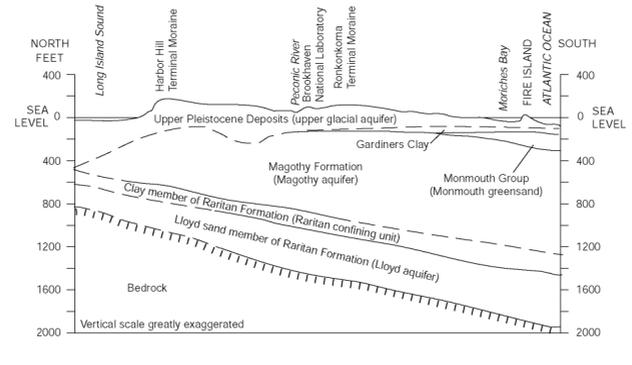

BNL’s Source Water Assessed

As required by the 1996 amendments to the Safe Drinking Water Act, an assessment of the source water used by BNL’s public water system was done by the New York State Department of Health (NYSDOH), as noted below. Based upon available hydrogeological, land use, and water-quality susceptibility information, the assessment of Brookhaven Lab’s source water provides the Laboratory with additional information for use in protecting the source of BNL’s drinking water.

As part of the assessment, known and possible contamination sources were evaluated. The assessment includes a susceptibility rating for each well, which is based on the risk posed by the presence of potential sources of contamination within the well’s contributing area and the likelihood that the contaminants will travel through the environment to reach the well.

Although the susceptibility rating is an estimate of the potential for source-water contamination, it does not mean that the water delivered to consumers is or will become contaminated. If a contaminant is present, then it does not necessarily mean that there is a health risk. For a discussion of contaminants detected in 2009, see “2009: 18 Parameters Detected in BNL’s Drinking Water” on page 3.

As the water is delivered to the consumer.

In addition, BNL has also identified that one well is susceptible to radionuclide contamination, specifically tritium. Although tritium has never been detected in this well, the Lab controls water-pumping operations to reduce the potential for impact. In addition to testing the supply-well water, BNL uses a network of groundwater-monitoring wells to track potential sources and contamination. If a supply well cannot provide water that meets drinking-water standards, then the Lab would immediately remove it from service.

A copy of the complete NYSDOH assessment may be reviewed by contacting either Doug Paquette, Ext. 7046, or Bob Lee, Ext. 3148.

organ transplants, persons with HIV/AIDS or other immune system disorders, and some elderly people and infants. These people or their care-givers should seek advice from their health-care providers.

Guidelines from the U.S. Environmental Protection Agency (EPA) and the U.S. Centers for Disease Control on ways to reduce the risk of illness by crypto-sporidium, giardia and other microbial pathogens are available from the EPA’s Safe Drinking-Water Hotline, (800) 426-4791.

More information about drinking-water contaminants can be obtained from the EPA at www.epa.gov/safewater; or from the NYSDOH at www.health.state.ny.us.

2009 Analytical Data Organic Compounds, Pesticides, Micro-Extractables

With one exception noted in the table below and discussed on page 3, the following compounds were not detected in source water from the Lab’s six drinking-water wells or finished water at the Water Treatment Facility:

compounds	BNL max.	MCL µg/l
dichlorodifluoromethane	<MDL	5
chloromethane	<MDL	5
vinyl chloride	<MDL	2
bromomethane	<MDL	5
chloroethane	<MDL	5
fluorotrchloromethane	<MDL	5
1,1-dichloroethene	<MDL	5
methylene chloride	<MDL	5
trans-1,2-dichloroethene	<MDL	5
1,1-dichloroethane	<MDL	5
cis-1,2-dichloroethene	<MDL	5
2,2-dichloropropane	<MDL	5
bromochloromethane	<MDL	5
1,1,1-trichloroethane	<MDL	5
carbon tetrachloride	<MDL	5
1,1-dichloropropene	<MDL	5
1,2-dichloroethane	<MDL	5
trichloroethene	<MDL	5
1,2-dichloropropane	<MDL	5
dibromomethane	<MDL	5
trans-1,3-dichloropropene	<MDL	5
cis-1,3-dichloropropene	<MDL	5
1,1,2-trichloroethane	<MDL	5
total trihalomethanes*	22.7	80
1,1,2,2-tetrachloroethane	<MDL	5
1,3-dichloropropane	<MDL	5
chlorobenzene	<MDL	5
bromobenzene	<MDL	5
1,2,3-trichloropropane	<MDL	5
2-chlorotoluene	<MDL	5
4-chlorotoluene	<MDL	5
1,3-dichlorobenzene	<MDL	5
1,4-dichlorobenzene	<MDL	5
1,2-dichlorobenzene	<MDL	5
1,2,4-trichlorobenzene	<MDL	5
hexachlorobutadiene	<MDL	5
tetrachloroethene	<MDL	5
1,1,2,2-tetrachloroethane	<MDL	5
1,2,3-trichlorobenzene	<MDL	5
benzene	<MDL	5
toluene	<MDL	5
ethylbenzene	<MDL	5
m,p-xylene	<MDL	5
p-xylene	<MDL	5
o-xylene	<MDL	5
styrene	<MDL	5
isopropylbenzene	<MDL	5
n-propylbenzene	<MDL	5
1,3,5-trimethylbenzene	<MDL	5
tert-butylbenzene	<MDL	5
1,2,4-trimethylbenzene	<MDL	5
sec-butylbenzene	<MDL	5
4-isopropyltoluene	<MDL	5
n-butylbenzene	<MDL	5
methyl tertiary butyl ether	<MDL	50
lindane	<MDL	0.2
heptachlor	<MDL	0.4
aldrin	<MDL	5
heptachlor epoxide	<MDL	0.2
dieldrin	<MDL	5
endrin	<MDL	0.2
methoxychlor	<MDL	40
toxaphene	<MDL	3
chlordan	<MDL	2
polychlorinated biphenyls (PCBs)	<MDL	0.5
2,4,5-TP (silvex)	<MDL	10
dinoseb	<MDL	50
dalapon	<MDL	50
pichloram	<MDL	50
dicamba	<MDL	50
pentachlorophenol	<MDL	1
hexachlorocyclopentadiene	<MDL	5
di(2-ethylhexyl)phthalate	<MDL	50
di(2-ethylhexyl)adipate	<MDL	50
hexachlorobenzene	<MDL	50
benzo(A)pyrene	<MDL	50
aldicarb sulfone	<MDL	NS
aldicarb sulfoxide	<MDL	NS
aldicarb	<MDL	NS
oxamyl	<MDL	50
3-hydroxycarbofuran	<MDL	50
carbofuran	<MDL	40
carbaryl	<MDL	50
methomyl	<MDL	50
glyphosate	<MDL	50
diquat	<MDL	50
ethylene dibromide	<MDL	0.05
1,2-dibromo-3-chloropropane	<MDL	0.2
2,4-D	<MDL	50
alachlor	<MDL	2
simazine	<MDL	50
atrazine	<MDL	3
metolachlor	<MDL	50
metribuzin	<MDL	50
butachlor	<MDL	50
propachlor	<MDL	50

<MDL: less than the minimum detection limit. NS: drinking-water standard not specified. * discussed in “2009: 18 Parameters Detected in BNL’s Drinking Water,” page 3.

2009: 18 Parameters Detected in BNL’s Drinking Water

As marked with an asterisk in the analytical data on pages 1 and 2, and on page 3 below, the 18 parameters discussed below were detected in BNL’s drinking water in 2009.

According to the U.S. Environmental Protection Agency, it is reasonable to expect that drinking water—including bottled water—may contain at least small amounts of some contaminants. The presence of contaminants, however, does not necessarily

BACTERIA		
• TOTAL COLIFORM*		
MCLG:	none	# positive samples: 1 detected: 07/01/09, Bldg. 648
MCL:	no positive sample	violation?: No
major sources in drinking water: Naturally present in the environment.		

* note: After the positive total coliform sample, subsequent samples were collected and none were positive. Since systems such as BNL’s that collect less than 40 samples per month are considered to be in violation only when two or more samples are total coliform positive, there was no violation resulting from this one positive sample.

RADIOACTIVITY		
• GROSS ALPHA		
MCLG:	0 pCi/l	BNL max.: 2.28 pCi/l detected: 10/20/09, Well #6
MCL:	15 pCi/l	BNL range: <0.80-2.28 pCi/l violation?: No
major sources in drinking water: Erosion of natural deposits.		

GROSS BETA		
MCLG:	0 pCi/l	BNL max.: 3.61 pCi/l detected: 10/20/09, Well #4
MCL:	4 mrem/year	BNL range: 0.72-3.61 pCi/l violation?: No
major sources in drinking water: Decay of natural deposits and man-made emissions.		

RADIUM-228		
MCLG:	5 pCi/l	BNL max.: 1.85 pCi/l detected: 10/20/09, Well #4
MCL:	5 mrem/year	BNL range: <0.44-1.85 pCi/l violation?: No
major sources in drinking water: Decay of natural deposits and man-made emissions.		

INORGANIC CONTAMINANTS		
• BARIUM		
MCLG:	2 mg/l	BNL max.: 0.038 mg/l detected: 06/04/09, well #4
MCL:	2 mg/l	BNL range: 0.022-0.038 mg/l violation?: No
major sources in drinking water: Erosion of natural deposits.		

CHLORIDES		
MCLG:	none	BNL max.: 44.0 mg/l detected: 06/04/09, well #4
MCL:	250 mg/l	BNL range: 30.0-44.0 mg/l violation?: No
major sources in drinking water: Naturally occurring or indicative of road-salt contamination.		

COPPER*		
COPPER AT THE CONSUMERS’ TAP*		
MCLG:	1.3 mg/l	BNL range: <0.005-0.580 mg/l AL at 90th percentile: 1.3 mg/l
# samples exceeding AL:	0 of 20	BNL value at 90th percentile: 0.18 mg/l
location of 90th percentile sample: Bldg. 703 bathroom		
location of highest sample: Bldg. 911 bathroom		
sampling date: 08/10/09 violation?: No		
major sources in drinking water: Corrosion of household plumbing.		

* note: These are the latest results from sampling at the consumers’ tap, which took place this year. Sampling will again take place in 2012; those results will be reported in 2013.

IRON		
MCLG:	none	BNL max.: 2.80 mg/l detected: 06/04/09, well #6
MCL:	0.3 mg/l	BNL range: <0.01-2.80 mg/l violation?: No
major sources in drinking water: Naturally occurring.		

LEAD AT THE CONSUMERS’ TAP*		
MCLG:	0 µg/l	BNL range: <1.0-39.0 µg/l AL at 90th percentile: 15 µg/l
# samples exceeding AL:	2 of 20	BNL value at 90th percentile: 14.0 µg/l
location of 90th percentile sample: Bldg. 170 bathroom		
location of highest sample: Bldg. 911 bathroom		
sampling date: 08/10/09 violation?: No		
major sources in drinking water: Corrosion of household plumbing, typically plumbing in older buildings.		

* note: These are the latest results from sampling at the consumers’ tap, which took place this year. Sampling will again take place in 2012; those results will be reported in 2013.

MANGANESE		
MCLG:	none	BNL max.: 0.25 mg/l detected: 06/04/09, Well #4
MCL:	0.3 mg/l	BNL range: <0.01-0.25 mg/l violation?: No
major sources in drinking water: Naturally occurring; indicative of landfill contamination.		

NICKEL		
MCLG:	none	BNL max.: 0.05 mg/l detected: 06/04/09, well #6
MCL:	0.1 mg/l	BNL range: <0.01-0.05 mg/l violation?: No
major sources in drinking water: Naturally occurring, or due to corrosion of household plumbing		

NITRATES		
MCLG:	10 mg/l	BNL max.: 0.70 mg/l
detected:	06/04 & 07/01/09, well #10, well #11 and Bldg. 185	
MCL:	10 mg/l	BNL range: <0.24-0.70 mg/l violation?: No
major sources in drinking water: Runoff from fertilizer use; leaching from septic tanks, and/or sewage; erosion of natural deposits.		

indicate that the water poses a health risk (see story, page 2). The 18 parameters detected in 2009 in drinking water were found at concentrations well below what are called the maximum contaminant level (MCL; see term definitions on page 4). Thus there were no violations of the federal Safe Drinking Water Act, as amended, or any other applicable government regulation. For more information on these contaminants, go to EPA’s Web site: www.epa.gov/safewater/hfacts.html.

SODIUM		
MCLG:	none	BNL max.: 37.0 mg/l detected: 07/01/09, Bldg. 185
MCL:	none	BNL range: 17.0-37.0 mg/l violation?: No
major sources in drinking water: Naturally occurring, or due to road salt, water softeners, and/or animal waste.		

SULFATES		
MCLG:	none	BNL max.: 12.1 mg/l detected: 01/09/09, Bldg. 185
MCL:	250 mg/l	BNL range: 8.3-12.1 mg/l violation?: No
major sources in drinking water: Naturally occurring.		

ZINC		
MCLG:	none	BNL max.: 0.03 mg/l detected: 06/04/09, well #4
MCL:	5 mg/l	BNL range: <0.01-0.03 mg/l violation?: No
major sources in drinking water: Naturally occurring, or due to mining waste or corrosion of household plumbing.		

VOLATILE ORGANIC CONTAMINANT		
TOTAL TRIHALOMETHANES		
TOTAL TRIHALOMETHANES AT THE WELL OR IN WTF EFFLUENT		
MCLG:	none	BNL max.: 22.7 µg/l detected: 07/21/09, well #4
MCL:	80 µg/l	BNL range: <0.5-22.7 µg/l violation?: No

TOTAL TRIHALOMETHANES AT CONSUMERS’ TAP		
MCLG:	none	BNL annual value: 13 µg/l detected: 09/10/09, Bldg. 363
MCL:	80 µg/l	BNL range: <0.5-22.7 µg/l violation?: No
major sources in drinking water: By-product of water chlorination, which is performed to kill harmful organisms. Trihalomethanes are formed when source water contains large amounts of organic matter. Total trihalomethanes is the sum of chloroform, bromodichloromethane, dibromochloromethane and bromoform.		

DISINFECTANT AND BY-PRODUCTS		
• CHLORINE RESIDUAL		
MCL		