

2018

BROOKHAVEN NATIONAL LABORATORY

Water Quality

CONSUMER CONFIDENCE REPORT

BNL publishes an annual water quality report to provide on-site drinking-water consumers with an overview of the Lab's water quality during the previous calendar year. The purpose of this report is to inform you about where your water comes from; what analytical tests are conducted; what they reveal; how the results compare to New York State standards; and to educate you about the importance of preventative measures. Educated consumers are more likely to help protect their drinking water sources.

BNL's drinking water and the supply and distribution system were in full compliance with all applicable county, state, and federal regulations regarding drinking-water quality, monitoring, operations, and reporting in 2017.

Overseeing the Lab's water supply system, which includes five wells dedicated to pumping drinking water and the on-site Water Treatment Facility, BNL's Energy & Utilities (E&U) Division is committed to providing over 3,000 employees, facility-users, contractors, and guests annually with safe drinking water.

BNL's drinking water is regularly tested using an independent laboratory approved by the New York State Department of Health (NYSDOH). Analytical data are reviewed by the Lab's Environmental Protection Division (EPD) to ensure that testing results comply with all applicable regulatory standards. In addition, E&U and EPD work with BNL's Groundwater Protection Group to make sure our potable-water supply is not adversely impacted by possible groundwater contamination or remediation operations.



For questions about this report, or to speak with someone regarding your drinking water, please contact:

- **Christopher Bruno, P.E.**
Manager, E&U Division
(631) 344-8262
- **Jason Remien**
EPD Manager
(631) 344-3477
- **Suffolk County Department of Health Services**
(631) 852-5810


Where Does Our Water Come From?

The Long-Island aquifer system is made up of three primary formations. From the surface to approximately 150 feet below is the Upper Glacial aquifer, from 150 to 1,000 feet below is the Magothy aquifer, and from 1,000 to about 1,600 feet below is the Lloyd aquifer. As designated by the U.S. Environmental Protection Agency (EPA), Long Island's aquifer system is one

of 78 "sole source" aquifers in the nation recognized under the aquifer-protection program authorized by the U.S. Safe Drinking Water Act.

The Lab's five in-service drinking-water wells draw up to 1,000 gallons per minute, or about 1.34 million gallons of water per day from the Upper Glacial aquifer to supply drinking

water, process cooling water, and fire protection. The water from three wells (4, 6, and 7) is processed at BNL's on-site Water Treatment Facility. Water from two other wells (10 and 11) is pumped directly to the distribution system after disinfection and pH adjustments. Last year, BNL pumped approximately 390 million gallons of water.

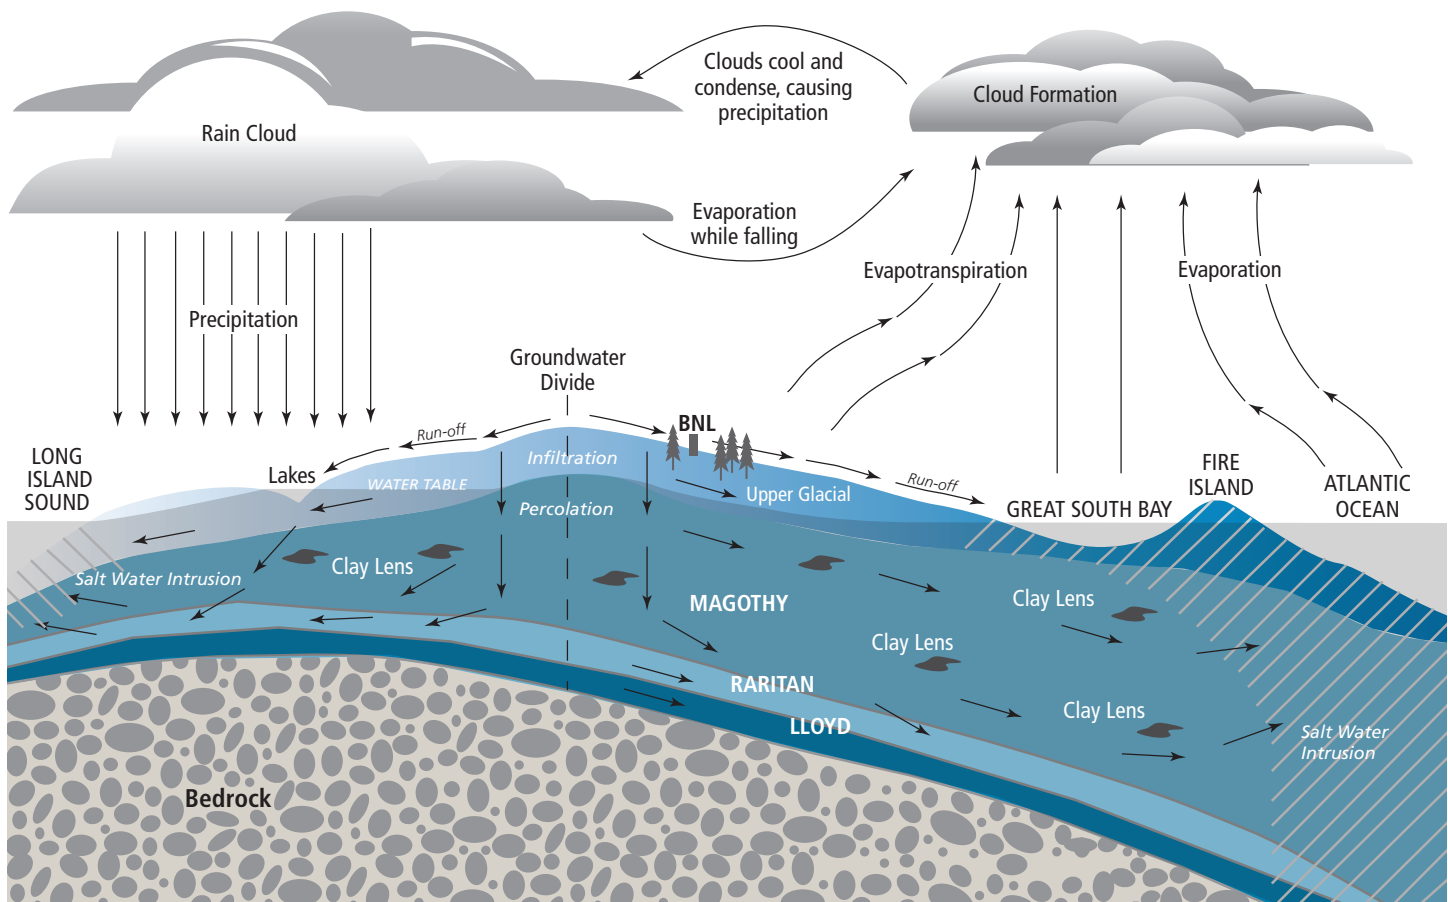

Long Island Aquifer System

What's in Our Drinking Water?

Although rivers, lakes, streams, ponds, and reservoirs are all sources of tap and bottled drinking water, most Long Island residents get their water from groundwater wells that are drilled into the underlying aquifer system. As water travels over land surfaces or through the ground, it dissolves naturally occurring minerals and radioactive material. Water can also pick up substances resulting from the presence of animals or from human activities. Contaminants that may be present in source water include: microbiological contaminants; inorganic contaminants; pesticides and herbicides; organic chemical contaminants; and radioactive contaminants.

In order to ensure that tap water is safe to drink, New York State and the EPA prescribe regulations which limit the amount of certain contaminants

in water provided by public water systems. In addition, regulations from NYSDOH and the Food and Drug Administration establish limits for contaminants in bottled water, which must provide the same protection for public health.

Source water is treated to remove substances or reduce their concentration before the water is fit for human consumption. Regardless, drinking water, including bottled water, may reasonably be expected to contain at least small amounts of contaminants; however, that does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling EPA's Safe Drinking Water Hotline at (1-800-426-4791).

Some people may be more vulnerable to disease-causing microorganisms or pathogens in drinking water than others. Immuno-compromised persons such as those with cancer undergoing chemotherapy, who have undergone organ transplants, with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice from their health care provider about their drinking water.

Guidelines from EPA and the Centers for Disease Control on appropriate means to reduce the risk of illness from *Cryptosporidium*, *Giardia*, and other microbial pathogens are also available at EPA's Safe Drinking Water Hotline.

BNL's Source Water Assessment

As required under the 1996 Safe Drinking Water Act, NYSDOH performed an assessment of the source water used by the Lab's public water system to evaluate known and possible contamination sources. The assessment includes a susceptibility rating for each well based on the risk posed by the presence of potential sources of contamination within the well's contributing area and the likelihood that the contaminants will travel through the environment to reach the well. Although the susceptibility rating is an estimate of the potential for source-water contamination, it does not mean that the water delivered to consumers is or will become contaminated. If a contaminant is present, it does not necessarily mean that there is a health risk.

Results from the assessment concluded that two on-site wells are rated as having a very high susceptibility to industrial solvents, primarily due to point sources of contamination along transportation routes and from previous spills within the source area. If industrial solvents were to impact water quality at a well, the contamination would be removed by treatment



facilities (air-stripping or carbon filtration) before the water is delivered to the consumer. BNL has also identified one well that is susceptible to radionuclide contamination, specifically tritium. Although tritium has never been detected in this well, the Lab controls water-pumping operations to reduce the potential for impact. In addition to testing the supply-well water, BNL uses a network of groundwater monitoring wells to track potential sources and contamination. If a supply well could not provide water that meets drinking-water standards, it would be immediately removed from service.

A copy of the complete assessment may be reviewed by contacting Doug Paquette (631) 344-7046 or Jason Remien (631) 344-3477.

Water Conservation Measures

BNL's water conservation program has achieved dramatic reductions in water use since the mid-1990's. The Lab continually evaluates water conservation as part of facility upgrades, such as replacing existing conventional plumbing fixtures with low-flow devices, or new construction. BNL's Water Management Plan describes how the Lab designs and operates buildings and facilities to be sustainable and water efficient. It also outlines our efforts to meet legislative requirements by implementing best-management practices and details the steps being implemented to reduce BNL's water consumption. For more information on BNL's water use efficiency and management, please see BNL's Site Sustainability Plan for fiscal year 2018 at <https://www.bnl.gov/about/sustainability/reports.php>.

To help the Lab conserve water, start by being conscious of your personal use, e.g., reduce faucet flow, decrease running water while not in use, and report any drips, leaks, or other plumbing problems promptly to your Facility Project Manager. Regarding process and research use, make sure temperature controls operate properly to minimize flow and specify re-circulating water or air-cooled systems for new devices.

While it is important to conserve water, the EPA encourages that you run your tap water for 30 seconds to 2 minutes and only use cold water for drinking or cooking. Due to the aging infrastructure at BNL, iron and lead may leach into the water from the pipes. Flushing the water will help to remove any contaminants that may have built up while the water was sitting in the pipes.



BNL's Water-Main Flush Program

In accordance with American Water Works Association recommendations, unidirectional flushing of water mains using fire hydrants within a water-distribution system is the most effective and economical way to cleanse and improve water quality.

Much of Long Island's groundwater is high in iron as a result of naturally occurring iron-containing minerals within the aquifer. The Lab's water-mains are flushed twice per year to improve the quality of the water delivered to facilities by the Lab's on-site taps, and to help eliminate rusty water.

Visit the Water Quality website at <http://www.bnl.gov/water/> for some tap-water recommendations to be sure your on-site drinking water is the best possible quality.



Water Treatment Process

BNL's Water Treatment Facility typically treats up to 2 million gallons of "raw" water per day to remove naturally occurring iron and manganese from the groundwater.

Of the five in-service drinking-water wells, Wells 4, 6, and 7 provide high-iron source water which must be passed through a sand filter before being distributed around the site. This water is chlorinated and the pH is adjusted before it enters the distribution system. Chlorine is a disinfection agent and prevents the spread of water borne diseases.

Water from Wells 4, 6, and 7 is aerated to reduce carbon dioxide gas and aid in iron oxidation. Lime is added to raise the pH and soften the water to provide for proper corrosion control. A polymer is added to aid in flocculation in the filtration process. Flocculation, or the formation of particle aggregates which settle out of the water as sediment, begins in the retention tank. To help form "floc," water is sent from the retention tank to a slow-mix tank.

Filtration is performed using a rapid sand filter made up of sand and anthracite coal to remove all particles. Filtered water is stored in the "wet well" before it is pumped into air-stripping towers, which remove volatile organic compounds, if present, from the water being treated.

Up to 250,000 gallons of treated water is stored at the clear well before its final chlorination and distribution. Pumps send finished water from the Water Treatment Facility to the two water towers on site. Wells 10 and 11 pump water that is low in iron, and does not require treatment for iron. However, they do receive chlorine for disinfection and sodium hydroxide for pH correction prior to being sent to the two water towers. The water from the two storage towers is delivered on site at 55 to 70 pounds of pressure per square inch via 45 miles of distribution pipe.

For more information on the Lab's water treatment process, visit the Water Quality website at <http://www.bnl.gov/water/index.php>.

BNL's 2017 Drinking Water Sampling Results

As shown by the table on Page 6 and 7, our water supply had zero violations. Through proper water sampling and testing, results show that 36 out of 238 contaminants tested have been detected; however, these contaminants were detected below the level allowed by the State. Other parameters tested for, but were less than the minimum detection limit (MDL), include:

1,1-dichloroethane	acetaminophen	dacthal	hexachlorocyclopentadiene	p-diethylbenzene
1,1-dichloroethene	acrylonitrile	dalapon	ibuprofen	pentachlorophenol
1,1-dichloropropene	alachlor	deisopropylatrazine	imidacloprid	phenytoin (dilantin)
1,1,1-trichloroethane	alachlor ESA	delta-BHC	imidacloprid urea	picaridin
1,1,1,2-tetrachloroethane	alachlor OA	desethylatrazine	isobutane	picloram
1,1,2-trichloroethane	aldicarb	di(2-ethylhexyl) adipate	isopropylbenzene	propachlor
1,1,2,2-tetrachloroethane	aldicarb sulfone	di(2-ethylhexyl) phthalate	lindane	propamocarb
1,2-dichlorobenzene	aldrin	dibromomethane	lithium	hydrochloride
1,2-dichloroethane	allyl chloride	dicamba	m,p-xylene	propanal
1,2-dichloropropane	alpha-BHC	dichlorodifluoromethane	malaoxon	propoxur
1,2,3-trichlorobenzene	aluminum	dichlorvos	mercury	radium-228*
1,2,3-trichloropropane	antimony	didealkylatrazine	metalaxyl	sec-butylbenzene
1,2,4-trichlorobenzene	arsenic	dieldrin	methacrylonitrile	siduron
1,2,4-trimethylbenzene	asbestos	diethyl ether	methiocarb	silver
1,2,4,5 tetramethylbenzene	atrazine	diethylstilbestrol	methiocarb sulfone	simazine
1,3-dichlorobenzene	benzene	diethyltoluamide (DEET)	methomyl	strontium-90
1,3-dichloropropane	benzo (A) pyrene	dimethyldisulfide	methoxychlor	styrene
1,3,5-trimethylbenzene	beryllium	dinoseb	methyl isothiocyanate	tebuthiuron
1,4-dichlorobenzene	beta-BHC	diquat	methyl methacrylate	tellurium
1,4-dichlorobutane	bisphenol A	diuron	methyl sulfide	tert-butylbenzene
1,4-dioxane	bisphenol B	d-Limonene	methyl tert-butyl ether	testosterone
1-bromo-2-chloropropane	bromobenzene	e. coli	methylene blue active substances (MBAS)	tetrachloroethene
1-naphthol	bromomethane	endosulfan I	methylene chloride	tetrachloroterephthalic acid
2,2-dichloropropane	butachlor	endosulfan II	metolachlor	tetrahydrofuran
2,3 dichloropropene	cadmium	endosulfan sulfate	metolachlor ESA	thallium
2,4,-D	caffeine	endothall	metolachlor metabolite	thorium
2,4,5,-TP (silvex)	carbaryl	endrin	metolachlor OA	titanium
2,6-dichlorobenzamide	carbofuran	equilin	metribuzin	toluene
2-bromo-1-chloropropane	carbon disulfide	estriol	molybdenum	total polychlorinated biphenals (PCBs)
2-butanone	carbon tetrachloride	estrone	monomethyltetrachloroterephthalate	toxaphene
2-chlorotoluene	cesium-137	ethyl methacrylate	n-butane	trans-1,2-dichloroethene
2-hydroxyAtrazine	chlordan	ethylbenzene	n-butylbenzene	trans-1,3-dichloropropene
3-hydroxycardofuran	chlorobenzene	fluoride	n-propylbenzene	trichlorfon
4,4 DDD	chlorodifluoromethane	freon-113	naphthalene	trichloroethene
4,4 DDE	chloroethane	gemfibrozil	nitrite	trichlorofluoromethane
4,4 DDT	chloromethane	geranium	odor	tritium
4-androstene-3,17-dione	chromium	glyphosate	orthophosphate	uranium
4-chlorotoluene	cis-1,2-dichloroethene	heptachlor	oxamyl	vinyl chloride
4-hydroxyphenytoin	cis-1,3-dichloropropene	heptachlor epoxide	o-xylene	zinc
4-isopropyltoluene	cobalt	hexachlorobenzene		
17 alpha ethynylestradiol	cyanide (as free cyanide)	hexachlorobutadiene		

Notes: *Radium-228 was tested in 2011 and will be retested in 2020.

Contaminants on this list include results from BNL compliance samples, surveillance samples, and Suffolk County Department of Health Services samples.

Types of Contaminants

- **disinfectant and disinfection by-products:** formed when disinfectants used in water treatment plants react with bromide and/or natural organic matter (i.e., decaying vegetation) present in the source water. Different disinfectants produce different types or amounts of disinfection by-products. Disinfection by-products for which regulations have been established have been identified in drinking water, including trihalomethanes, haloacetic acids, bromate, and chlorite.
- **inorganics:** dissolved salts and metals, which can occur naturally or result from storm-water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, farming, etc.
- **microbiological:** bacteria and viruses, which may come from sewage, livestock operations, wildlife, etc.
- **organic chemicals:** natural and synthetic compounds, including volatile organic compounds (VOCs). These chemicals are by-products of industrial processes, residential uses and petroleum production, and they can also come from gas stations, storm-water runoff, septic systems, etc.
- **perfluorinated compounds:** man-made compounds used in firefighting foams and stain proof coatings.
- **pesticides & herbicides:** substances for, respectively, eliminating problem insects and plants, which may come from a variety of sources, such as agricultural operations, storm-water runoff, residential uses, etc.
- **radioactive particles:** naturally occurring, or from oil and gas production, mining activities, nuclear facilities, etc.
- **synthetic organic chemicals:** man-made compounds used for a variety of industrial and agricultural purposes.
- **volatile organic compounds:** emitted by products including contaminants: paints and lacquer; paint strippers; cleaning supplies; pesticides, building materials and furnishings; office equipment such as copiers and printers; correction fluids and carbonless copy paper; graphics and craft materials including glues and adhesives; permanent markers; and photographic solutions.

CONTAMINANT AND UNIT OF MEASUREMENT	DATE OF DETECTION	VIOLATION (YES/NO)	LEVEL DETECTED	RANGE OF RESULTS	MCLG	REGULATORY LIMIT (MCL)	LIKELY SOURCE OF CONTAMINATION
DISINFECTANTS							
Chlorine Residual, Free (mg/L)	11/6/17	No	0.6	0.3 – 1.3	NS	4	Water additive to control microbes.
DISINFECTION BY-PRODUCTS							
Haloacetic Acids (µg/L)	8/7/17	No	6.8	3 – 6.8	NS	60	By-product of drinking water disinfection needed to kill harmful organisms.
Total Trihalomethanes (µg/L)	8/7/17	No	23.9	<0.5 – 23.9	NS	80	By-product of drinking water chlorination needed to kill harmful organisms; formed when source water contains large amounts of organic matter.
INORGANICS							
Ammonia (mg/L)	6/5/17	No	3.1	<0.10 - 3.1	NS	NS	Leaching from septic tanks and sewage.
Barium (mg/L)	6/5/17	No	0.055	<0.024 – 0.055	2	2	Erosion of natural deposits.
Bromide (mg/L)	3/22/17	No	0.39	<0.5 – 0.39 (a)	NS	NS	Naturally occurring.
Chloride (mg/L)	3/22/17	No	77	37.1 – 77	NS	250	Naturally occurring; indicative of road-salt contamination.
Color (units)	1/23/17	No	5	<5 – 5	NS	15	The presence of metals such as copper, iron, and manganese.
Hexavalent Chromium (µg/L)	3/22/17	No	0.56	<0.03 – 0.56	NS	NS	Erosion of natural deposits.
Iron (µg/L)	7/10/17	No	200	<50 – 200	NS	300	Corrosion of plumbing.
Manganese (µg/L)	3/22/17	No	9	<10 – 9 (a)	NS	300	Naturally occurring.
Magnesium (mg/L)	3/22/17	No	5	3.2 – 5.0	NS	NS	Naturally occurring.
Nickel (µg/L)	1/23/17	No	3.1	<0.79 – 3.1	NS	100	Nickel enters groundwater and surface water by dissolution of rocks and soils, from atmospheric fallout, or from biological decays.
Nitrates (mg/L)	6/5/17	No	0.75	<0.05 – 0.75	10	10	Erosion of natural deposits; runoff from fertilizer use; leaching from septic tanks and sewage.
Potassium (mg/L)	3/22/17	No	1.9	1.0 - 1.9	NS	NS	Naturally occurring.
Selenium (µg/L)	1/23/17	No	2.3	<2.0 – 2.3	50	50	Erosion of natural deposits.
Sodium (mg/L)	6/5/17	No	48.5	26 – 48.5	NS	NS	Naturally occurring; road salt; water softeners.
Strontium (µg/L)	3/22/17	No	59.9	35.2 – 59.9	NS	NS	Naturally occurring.

CONTAMINANT AND UNIT OF MEASUREMENT	DATE OF DETECTION	VIOLATION (YES/NO)	LEVEL DETECTED	RANGE OF RESULTS	MCLG	REGULATORY LIMIT (MCL)	LIKELY SOURCE OF CONTAMINATION
INORGANICS							
Sulfates (mg/L)	6/5/17	No	12.6	8.1 – 12.6	NS	250	Naturally occurring.
Tin (µg/L)	3/22/17	No	0.76	<0.5 - 0.76	NS	NS	Solder used in plumbing.
MICROBIOLOGICAL							
Total Coliform Bacteria	1/23/17	No	1	0 - 1	0	2 or more positive samples	Naturally occurring.
PERFLUORINATED COMPOUNDS							
PFBs (Perfluorobutanesulfonic Acid) (µg/L)	8/17/17	No	0.002	<0.002 – 0.002	NS	50	Used in firefighting foams and degradation of stain proof coatings.
PFHpA (Perfluoroheptanoic Acid) (µg/L)	8/17/17	No	0.003	<0.002 – 0.003	NS	50	Used in firefighting foams and degradation of stain proof coatings.
PFHxS (Perfluorohexanesulfonic Acid) (µg/L)	3/22/17	No	0.009	<0.002 – 0.009	NS	50	Used in firefighting foam.
PFOA (Perfluorooctanoic Acid) (ng/L)	8/17/17	No	6.66	<2 – 6.66	NS	70 (b)	Used in firefighting foam.
PFOS (Perfluorooctanesulfonic Acid) (ng/L)	8/17/17	No	17.6	<1.91 – 17.6	NS	70 (b)	Used in firefighting foam, fabric protection.
PFNA (Perfluorononanoic Acid) (µg/L)	8/17/17	No	0.003	<0.002 – 0.003	NS	50	Surfactant used for plastic production.
RADIOACTIVE PARTICLES							
Gross Alpha Activity (pCi/L)	4/20/17	No	1.42	<0.76 – 1.42	NS	15	Erosion of natural deposits.
Gross Beta Activity (pCi/L) (c)	10/12/17	No	4.99	0.76 – 4.99	NS	50	Decay of natural deposits and atmospheric fallout.
SYNTHETIC ORGANIC CHEMICALS							
Aldicarb sulfioxide (µg/L)	6/5/17	No	1.1	<0.5 - 1.1	1	4	Insecticide use.
VOLATILE ORGANIC COMPOUNDS							
Bromochloromethane (µg/L)	10/4/17	No	2.8	<0.5 – 2.8	NS	80**	By-product of drinking water chlorination needed to kill harmful organisms.
Bromoform (µg/L)	1/23/17	No	1.1	<0.5 - 1.1	NS	80**	By-product of drinking water chlorination needed to kill harmful organisms.
Chloroform (µg/L)	10/4/17	No	3.5	<0.5 – 3.5	NS	80**	By-product of drinking water chlorination needed to kill harmful organisms.
Dibromochloromethane (µg/L)	4/3/17	No	2.9	<0.5 – 2.9	NS	80**	By-product of drinking water chlorination needed to kill harmful organisms.
SAMPLING AT THE CONSUMER'S TAP (Tap water samples were collected throughout the Laboratory site) *							
CONTAMINANT AND UNIT OF MEASUREMENT	DATE OF SAMPLING (MO./YR.)	AL EXCEED-ANCE (YES/NO)	90th PER-CENTILE RESULT	RANGE OF RESULTS	MCLG	REGULATORY LIMIT (AL)	LIKELY SOURCE OF CONTAMINATION
Copper (mg/L)	8/10/17	No	0.04	<0.02 – 0.11	1.3	1.3	Corrosion of plumbing.
Lead (µg/L)	8/10/17	No	5.3	<1.0 – 22.6	0	15	Corrosion of plumbing.

Table Notes:

Table includes results from BNL compliance samples, surveillance samples, and Suffolk County Department of Health Services samples.

* Sampling at the consumer's tap for lead and copper is performed every 3 years; next sampling is scheduled for 2020.

** MCL is the sum of the four starred compounds (Bromochloromethane, Bromoform, Chloroform, and Dibromochloromethane).

NS = drinking-water standard not specified

WTP = Water Treatment Plant

(a) MDL's may vary throughout the year causing a positive detection below a previous detection limit.

(b) The EPA Health Advisory level for PFOA and PFOS is a combined total of 70 ng/L.

(c) The State considers 50 pCi/L to be the level of concern for beta particles.

Lead and Copper Testing

Lead and copper enters drinking water primarily through plumbing materials. In 1991, the EPA established a “lead and copper rule” to limit the concentration of lead and copper in public water. BNL is required to sample for lead and copper at 20 consumer taps every 3 years and to notify those occupants of the buildings tested with the results. Results from testing performed in 2017 are shown in the table to the right. While lead was detected in some samples, the action limit was not exceeded. Testing will be performed again in 2020.

If present, elevated levels of lead can cause serious health problems, especially for pregnant women, infants, and young children. It is possible that lead

levels in your building may be higher than at other buildings at the Laboratory as a result of materials used in your building's plumbing. Brookhaven Lab is responsible for providing high quality drinking water. When your water has been sitting in the pipes for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline (1-800-426-4791) or at <http://www.epa.gov/safewater/lead>.

Chlorine Disinfectant and Its By-Products

Each day, more than 200 million people in the U.S. consume water that has been disinfected to kill unwanted microorganisms found in source water. Worldwide, one of the most commonly used and effective disinfectants is chlorine. A form of chlorine known as sodium hypochlorite is used by BNL for disinfection of its potable water.

Although disinfectants are effective in killing unwanted microorganisms in source water, they can react with naturally occurring organic matter and inorganics to form disinfectant by-products which may pose health risks. Under the Safe Drinking Water Act, disinfectants and their by-products are regulated. The Lab had no violations in 2017; annual averages for chlorine

residual and by-products are based on results from finished tap water.

Disinfection Residual	2017 Annual Running Average	MRDLG
chlorine*	0.6 mg/L	4 mg/L
Disinfection By-product	2017 Annual Average	MCL
total trihalo-methanes ¹	23.9 µg/L	80 µg/L
haloacetic acids (five) ²	6.8 µg/L	60 µg/L

Notes:

* BNL range of results for chlorine is 0.3 - 1.3 mg/L; maximum found in Bldg. 930.

¹ Total trihalomethanes is the sum of the concentration of chloroform, bromodichloromethane, dibromochloromethane, and bromoform.

² Haloacetic acids (five) is the sum of the concentration of mono-, di-, and trichloroacetic acids, and mono- and dibromoacetic acids.

Other Water Quality Indicators

The following maximum values were measured in samples of well water or finished water at the BNL Water Treatment Plant. Although the Lab is required to test these indicators, there are no MCLs set for these parameters.

Other indicators tested, but not detected, include cyanide and methylene blue active substances.

Indicator	BNL Sample	MCL
alkalinity [†]	60.8 mg/L	NS
calcium [†]	17 mg/L	NS
conductivity [†]	359 µmhos/cm	NS
pH	6 standard units	NS

Notes:

NS = drinking-water standard not specified

† = measure of water hardness or dissolved salts

2017 Lead and Copper Sampling Results

Location	Faucet	Lead (µg/L)	Copper (mg/L)
Apt. 13D	kitchen	< MDL	0.01
Apt. 1A	kitchen	1.6	0.11
Apt. 24A	kitchen	6.8	0.007
Apt. 26B	kitchen	1.2	0.01
Apt. 28A	kitchen	1.2	0.006
Apt. 34E	kitchen	< MDL	0.014
Apt. 36B	kitchen	1.6	0.005
Apt. 40M	kitchen	< MDL	0.005
Apt. 42A	kitchen	< MDL	0.023
Apt. 4B	kitchen	4.1	0.009
Apt. 5B	kitchen	5.3	0.041
Apt. 6A	kitchen	1.3	0.01
Apt. 8C	kitchen	< MDL	0.016
Bldg. 153	bathroom	< MDL	0.036
Bldg. 170	bathroom	< MDL	0.008
Bldg. 371	bathroom	22.6	0.084
Bldg. 460	kitchen	3.6	0.105
Bldg. 535	bathroom	< MDL	0.041
Bldg. 703	bathroom	< MDL	0.025
Bldg. 911	bathroom	< MDL	0.011

Notes:

Action Level for Lead is 15 µg/L.

Action Level for Copper is 1.3 mg/L.



Definitions Used in this Report

- **90th percentile value:** The reported copper and lead values represent the 90th percentile. A percentile is a value on a scale of 100 that indicates the percent of a distribution that is equal to or below it. The 90th percentile is equal to or greater than 90 percent of the lead and copper values detected in the water system.
- **action level (AL):** The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a drinking-water supplier must follow.
- **maximum contaminant level (MCL):** The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLG as possible.
- **maximum contaminant level goal (MCLG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.
- **maximum residual disinfectant level (MRDL):** The highest level of a disinfectant allowed in drinking water. There is convincing evidence that the addition of disinfectants is necessary for control of microbial contaminants.
- **maximum residual disinfectant level goal (MRDLG):** The concentration of a drinking-water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of using disinfectants to control microbial contamination.
- **micrograms per liter ($\mu\text{g/L}$):** Equals one part of liquid in one billion parts of liquid or parts per billion (ppb).
- **micromhos per centimeter ($\mu\text{mhos/cm}$):** A measure of the ability of water to conduct electricity. Conductivity effectively measures the concentration of ions, such as dissolved salts.
- **milligrams per liter (mg/L):** Equals one part of liquid per million parts of liquid, or parts per million (ppm).
- **minimum detection limit (MDL):** The lowest level to which an analytical parameter can be measured with certainty by the analytical lab performing the measurement. While results below the MDL are sometimes measureable, they represent values that have a reduced statistical confidence associated with them (less than 95 percent confidence).
- **picocuries per liter (pCi/L):** Picocuries per liter is a measure of radioactivity in water equal to one trillionth of a curie.
- **nanograms per liter (ng/L):** Equals one part of liquid in one trillion parts of liquid or parts per trillion (ppt).
- **treatment technique (TT):** A required process intended to reduce the level of a contaminant in drinking water.
- **volatile organic contaminants (VOCs):** Organic chemicals that have a high vapor pressure at ordinary room temperature. Their high vapor pressure results from a low boiling point, which causes large numbers of molecules to evaporate or sublime from the liquid or solid form of the compound and enter the surrounding air. VOCs include both man-made and naturally occurring chemical compounds.



BNL's 2017 Surveillance/ Investigative Testing for Lead

In addition to the lead and copper sampling conducted under the EPA's Lead and Copper Rule (LCR), the Laboratory collects routine water samples in the apartment area and on request to determine lead levels and manage risk to residents. Any dwelling constructed prior to 1986 could have lead in the plumbing which can cause elevated levels of lead in the drinking water. BNL has a voluntary program to test for lead and, when necessary, has replaced plumbing or closed apartments for further investigation.

During surveillance sampling, two samples are collected; one as soon as water is turned on and one after the water is run for 30 seconds. The first sample helps determine how much lead may be in the immediate faucet and piping and determine if a replacement faucet would remove a source of the lead. The second sample may show if lead was used in the piping in the walls, flooring, or pipes running into the building.

In 2017, E&U conducted surveillance sampling on apartment kitchens and bathrooms under new guidance from the county health department. Apartments 3C and 3D had been previously closed due to high lead levels. They were reopened after replacing the main service running into Apartment 3 and additional sampling showed the lead levels were below the action level. Apartment 3A and 3B remained above the action level and remain closed. Apartment 11B was also reopened after the faucet was changed and the lead results were under the action level. All other apartments that tested over the LCR action level remained closed.

Bldg 935 Surveillance Testing for Lead (µg/L)					
Location	Sample 1	Sample 2	Sample 3	Sample 4	Sample 5
Men's Bathroom	54.4	22.8	5.03	10.7	1
Women's Bathroom	1.79	0.69	ND	ND	ND

Notes:
Action Level for Lead is 15 µg/L.
ND - Non Detection
Samples taken on 1/10/2017

It was determined that the source of lead is likely in the piping behind walls. Upon request, Building 129 was sampled with results showing lead over the action level in the first floor kitchen. Running the water for 30 seconds did lower the lead levels. Building 129 was already scheduled to be closed and the staff is in the process of being relocated.

Bldg. 935 was under investigation in 2016 and 2017 (Bldg. 935 Surveillance Testing for Lead). Results in 2017 revealed the presence of lead solder in the domestic water pipe feeding to the Men's bathroom. Although the faucets were initially replaced, test results continued to show lead above the action level. Plans were initiated in 2017 to replace piping in the walls. Bldg. 935 does provide a bottled water unit for visitor use.

As both a water provider and owner of the facilities, the Laboratory continues to improve infrastructure whenever possible and will continue to monitor for lead. Any apartment that tests over the action level will be closed and, if occupied, the residents notified and relocated. Federal regulation requires the Laboratory to notify its residents about the risks of lead and reminds all employees that running the water prior to use at work and at home may lower your risk of exposure.

Perfluorinated Compound Testing

In 2013, the EPA requested large water providers to start testing for Perfluorinated compounds (PFCs) under the third Unregulated Contaminant Monitoring Rule (UCMR 3). As a medium size system, BNL was not required to test for PFCs. In 2017, Suffolk County Department of Health Services began routine testing of all systems for six common PFCs found in drinking water. The results are provided on page 7 of this report. As a result, the Lab started routine quarterly testing of the supply wells for the six PFCs. New York State is currently reviewing a potential standard and may modify or implement new regulatory limits. Currently, Perfluorooctanoic Acid (PFOA) and Perfluorooctanesulfonic Acid (PFOS) have a combined EPA Health Advisory Limit of 70 ng/L (ppt). EPA's health advisories are non-enforceable and non-regulatory and provide technical information to states agencies and other public health officials on health effects, analytical methodologies, and treatment technologies associated with drinking water contamination. The other four PFCs fall under the New York State 50 µg/L (ppb) limit for unregulated contaminants. E&U is monitoring the sample results and can utilize existing Granular Activated Carbon filters at the wells to remove PFCs if necessary. All future results of PFC sampling or changes to the water system will be reported in the Annual Water Report. For further information, please contact Jason Remien (ext. 3477) or Chris Bruno (ext. 8262).

2017 Surveillance/Investigative Sampling for Lead				
Location	Faucet	Date	First Sample	Second Sample
			Lead (µg/L)	Lead (µg/L)
Apt. 2C*	Kitchen	9/13/17	70.9	2.61
Apt. 2C*	Kitchen	9/27/17	71.8	2.48
Apt. 3A*	Bathroom	2/3/17	28.8	1.45
Apt. 3A*	Kitchen	2/3/17	343	4.64
Apt. 3A*	Kitchen	9/13/17	135	11.5
Apt. 3A*	Kitchen	9/27/17	103	2.67
Apt. 3B*	Bathroom	2/3/17	72.8	1.75
Apt. 3B*	Kitchen	2/3/17	15.7	0.93
Apt. 3B*	Kitchen	9/13/17	265	3.07
Apt. 3B*	Kitchen	9/27/17	56.4	1.48
Apt. 3C	Bathroom	2/3/17	16	ND
Apt. 3C	Kitchen	2/3/17	3.44	ND
Apt. 3D	Bathroom	2/3/17	23.5	ND
Apt. 3D	Kitchen	2/3/17	1.75	ND
Apt. 10B*	Kitchen	9/13/17	77.7	4.4
Apt. 10B*	Kitchen	9/27/17	21.5	0.91
Apt. 10C*	Kitchen	9/13/17	86	5.85
Apt. 10C*	Kitchen	9/27/17	9.91	0.54
Apt. 11B	Bathroom	3/16/17	11.1	ND
Apt. 11B	Kitchen	3/16/17	9.96	0.57
Apt. 22D*	Bathroom	3/16/17	9.06	2.94
Apt. 22D*	Kitchen	3/16/17	36.9	ND
Apt. 22D*	Bathroom	4/21/17	46.7	3.08
Apt. 22D*	Kitchen	4/21/17	24.2	0.92
Apt. 22D*	Kitchen	9/13/17	408	7.49
Apt. 22D*	Kitchen	9/27/17	304	6.32
Apt. 34B*	Bathroom	3/16/17	1030	112
Apt. 34B*	Kitchen	3/16/17	2.16	4.18
Apt. 34B*	Bathroom	4/21/17	554	1.09
Apt. 34B*	Kitchen	4/21/17	3.36	ND

2017 Surveillance/Investigative Sampling for Lead				
Location	Faucet	Date	First Sample	Second Sample
			Lead (µg/L)	Lead (µg/L)
Apt. 34B*	Kitchen	9/13/17	42.9	1.06
Apt. 34B*	Kitchen	9/27/17	19.1	0.994
Apt. 40P*	Bathroom	3/16/17	19.7	0.81
Apt. 40P*	Bathroom	4/21/17	13.8	1.26
Apt. 40P*	Kitchen	3/16/17	3.33	0.59
Apt. 40P*	Kitchen	9/13/17	2.11	ND
Apt. 40P*	Kitchen	9/27/17	2.01	ND
Apt. 42CN*	Kitchen	9/13/17	24.5	1.8
Apt. 42CN*	Kitchen	9/27/17	35.4	0.9
Apt. 42DM*	Kitchen	9/13/17	9.83	1
Apt. 42DM*	Kitchen	9/27/17	48.3	1.28
Apt. 42EL*	Kitchen	9/13/17	24.2	1.97
Apt. 42EL*	Kitchen	9/27/17	50.4	0.63
Apt. 42FK*	Kitchen	3/11/17	71.7	2.58
Apt. 42FK*	Kitchen	9/27/17	147	0.92
Apt. 43CJ*	Kitchen	9/13/17	46.8	2.31
Apt. 43CJ*	Kitchen	9/27/17	93	1.15
Apt. 43DI*	Kitchen	9/13/17	78.8	2
Apt. 43DI*	Kitchen	9/27/17	114	1.93
Bldg. 129	1st floor kitchen	4/21/17	19.9	14.3
Bldg. 129	1st floor kitchen	5/3/17	20.7	12.1
Bldg. 129	2nd floor kitchen	4/21/17	3.55	0.74
Bldg. 129	2nd floor kitchen	5/3/17	2.99	0.64

Notes:

* - Apartment Closed
Action Level for Lead is 15 µg/L.
ND - Non Detection



The annual BNL Water Quality Consumer Confidence Report is published by the Environmental Protection Division and the Energy & Utilities Division, with assistance from the Stakeholder and Community Relations Office. It is distributed to approximately 3,300 on-site drinking water consumers served daily by federal public water system No. 5111891 at Brookhaven National Laboratory, Upton, New York 11973, which is managed by Brookhaven Science Associates for the U.S. Department of Energy's Office of Science.



Printed on 100% Recycled Paper

